


# OPC UA I/O User Manual

## V8.0, 2023/09

### U-7500 Series

#### IIoT OPC UA I/O Module

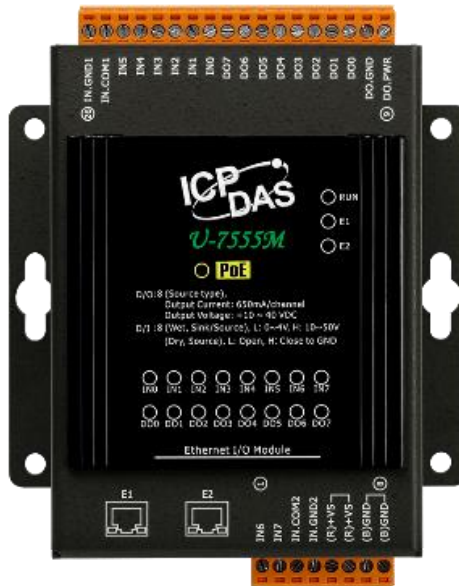

Technical support: [service@icpdas.com](mailto:service@icpdas.com)

Technical Editor: Tim Chen

Editor: Eva Li

Last Editor: Carol Hsu

---

## Warranty

---

All products manufactured by ICP DAS are under warranty regarding defective materials for a period of one year, beginning from the date of delivery to the original purchaser.

## Warning

---

ICP DAS assumes no liability for any damage resulting from the use of this product.  
ICP DAS reserves the right to change this manual at any time without notice.

The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, not for any infringements of patents or other rights of third parties resulting from its use.

## Copyright

---

Copyright @ 2020 by ICP DAS Co., Ltd. All rights are reserved.

## Trademark

---

The names used for identification only may be registered trademarks of their respective companies.

## Contact US

---

If you have any problem, please feel free to contact us.  
You can count on us for quick response.

Email: [service@icpdas.com](mailto:service@icpdas.com)

For more product information please refer to website: <https://www.icpdas.com>

## Revision History

This chapter provides revision history information to this document.

The table below shows the revision history.

Revision	Date	Description
V8.0	09/2023	8 <sup>th</sup> Version: Provide New Functions: 1. Modify the UA I/O manual introduction, features, and specifications. 2. Add Client Setting function 3. Add Client certificate function 4. Add EZ-UAQ Utility
V7.1	05/2023	7.1 <sup>th</sup> Version: Provide New Functions: 1. 1. 4.5.1 New Line function and step-by-step procedure in the event log. The setting is changed to 4.5.1.1 Main settings 2. Add new function 4.5.1.2 Sending messages to Line 3. 4.5.2 rule setting add 4.5.2.1 main settings, optimize the setting process 4. 4. (4.2.3) (4.2.4) (4.4.2) The Nickname name in the function of [Module Setting] → [I/O Setting] 5. 2.2.2 Original Utility changed to EZ-UAQ Utility content update
V7.0	02/2023	7 <sup>th</sup> Version: Provide New Models & New Functions: 1. Add new models (*18): U-7502M, 7515M, 7517M, 7518ZM/S, 7518ZM/S2, 7524M, 7528M, 7542M, 7544M, 7545M, 7550AM, 7551M, 7552M, 7553M, 7558M, 7559M, 7561M, 7567M 2. Add new function: Support IoTstar Cloud management software (3.5 and 4.5.6) 3. Add new models to each section of CH1. 4. 2.2.2 Utility upgrade 5. Add counter function to the I/O setting (4.2.1) 6. Add the Test function to the MQTT Setting. (3.2.1 and 4.4.1) 7. InduSoft changed to AVEVA Edge 8. lotstar added new features 9. Add 3.4 Common settings table for easy integration 10. Add 4.2.1 Overview 11. Alias changed to Nickname 12. chapter order changed Scaling 4.5.1→4.2.3
V6.0	04/2022	6 <sup>th</sup> Version: Provide New Models & New Functions: 1. Add new models: U-7517M-10 、U-7519ZM(/S, /S2) 2. Add more descriptions for the 3.3, 4.1, 4.4, and 4.5 sections. 3. Add new models to each section of CH1.
V5.0	01/2022	5 <sup>th</sup> Version: Provide New Functions 1. CH4.5.4: “Advanced Setting” add “Schedule” new sub-function.

Revision	Date	Description
		<p>2. CH4.5.3: “Rule Setting” add “Details item” that with “Unfold” and “Fold” button for full screen or un-full screen setting. In the “New Action” setting, add “Delay” item.</p> <p>3. CH3.4 Add RESTful API HTTPS section.</p> <p>4. Add new function to CH1</p>
V4.0	09/2021	<p>4<sup>th</sup> Version: Provide New Functions</p> <p>1. Add CH3.3 Rule Setting (Main new function: Logic)            * CH4.5 Advanced Setting: add 4.5.3 Rule Setting            * Setting the logic condition of I/O &amp; Virtual points: IF, THEN, ELSE</p> <p>2. Add CH3.4 Support RESTful API (Main new function)            * Read/write the I/O &amp; Virtual points via HTTP</p> <p>3. Add CH4.5.2 Event Log            * CH4.5 Advance Setting: add Event Log (provide log file download)</p> <p>4. Add CH4.1.3 NTP time calibration</p> <p>5. Strengthen information security protection functions (CH4.1.4)            * Increase the password length (&gt;6), including at least one uppercase, one lowercase letter and one number</p> <p>6. Add CH4.1.5 HTTPS Web Server            * Can upload certificate and private key</p> <p>7. Add CH4.1.6 Firewall Setting            * Allow/restrict remote device connection</p> <p>8. CH4.1.7 Modify firmware update time: 60 seconds =&gt; 2 minutes</p>

# Content of Table

<b>Revision History.....</b>	<b>3</b>
<b>Content of Table.....</b>	<b>5</b>
<b>1. UA I/O Introduction: .....</b>	<b>9</b>
1.1 Introduction .....	9
1.2 Features .....	11
1.3 Selection Guide .....	13
1.4 Specifications.....	15
1.4.1 Software Specifications (Series Common) .....	15
1.4.2 U-7502M Specifications.....	16
1.4.3 U-7504M Specifications.....	17
1.4.4 U-7515M Specifications.....	18
1.4.5 U-7517M Specifications.....	19
1.4.6 U-7517M-10 Specifications.....	20
1.4.7 U-7518ZM/S, U-7518ZM/S2 Specifications .....	21
1.4.8 U-7519ZM/S, U-7519ZM/S2 Specifications .....	22
1.4.9 U-7524M Specifications.....	23
1.4.10 U-7526M Specifications.....	24
1.4.11 U-7528M Specifications.....	25
1.4.12 U-7542M Specifications.....	26
1.4.13 U-7544M Specifications.....	27
1.4.14 U-7545M Specifications.....	28
1.4.15 U-7550AM Specifications .....	29
1.4.16 U-7551M Specifications.....	30
1.4.17 U-7552M Specifications.....	31
1.4.18 U-7553M Specifications.....	32
1.4.19 U-7555M Specifications.....	33
1.4.20 U-7558M Specifications.....	34
1.4.21 U-7559M Specifications.....	35
1.4.22 U-7560M Specifications.....	36
1.4.23 U-7561M Specifications.....	37
1.4.24 U-7567M Specifications.....	38
1.5 Wire Connections / Pin Assignments.....	39
1.5.1 U-7502M Wire Connections / Pin Assignments/Jumper Pic .....	39
1.5.2 U-7504M Wire Connections / Pin Assignments/Jumper Pic .....	40

1.5.3 U-7515M Wire Connections / Pin Assignments .....	41
1.5.4 U-7517M Wire Connections/Pin Assignments/Jumper Pic .....	42
1.5.5 U-7517M-10 Wire Connections/Pin Assignments/Jumper Pic .....	43
1.5.6 U-7518ZM Wire Connections/Pin Assignments .....	44
1.5.7 U-7519ZM Wire Connections/Pin Assignments/Jumper Pic .....	45
1.5.8 U-7524M Wire Connections/Pin Assignments/Jumper Pic .....	46
1.5.9 U-7526M Wire Connections/Pin Assignments/Jumper Pic .....	47
1.5.10 U-7528M Wire Connections/Pin Assignments/Jumper Pic .....	48
1.5.11 U-7542M Wire Connections/Pin Assignments .....	49
1.5.12 U-7544M Wire Connections/Pin Assignments .....	50
1.5.13 U-7545M Wire Connections/Pin Assignments .....	51
1.5.14 U-7550AM Wire Connections/Pin Assignments .....	52
1.5.15 U-7551M Wire Connections/Pin Assignments .....	53
1.5.16 U-7552M Wire Connections/Pin Assignments .....	54
1.5.17 U-7553M Wire Connections/Pin Assignments .....	55
1.5.18 U-7555M Wire Connections / Pin Assignments .....	56
1.5.19 U-7558M Wire Connections/Pin Assignments .....	57
1.5.20 U-7559M Wire Connections/Pin Assignments .....	58
1.5.21 U-7560M Wire Connections / Pin Assignments .....	59
1.5.22 U-7561M Wire Connections/Pin Assignments .....	60
1.5.23 U-7567M Wire Connections/Pin Assignments .....	61
1.6 Dimensions .....	62
U-7502M/U-7504M/U-7515M/U-7517M/U-7517M-10/U-7524M /U-7526M/U-7528M/U-7542M/U-7544M/U-7545M/U-7550AM /U-7551M/U-7552M/U-7553M/U-7555M/U-7558M/U-7559M /U-7560M/U-7561M/U-7567M Dimensions .....	62
U-7518ZM/U-7519ZM Dimensions .....	63
<b>2. Quick Start: Hardware/Network Connection.....</b>	<b>64</b>
2.1. Hardware Connection .....	64
2.1.1. Preparations for Devices .....	64
2.1.2. AI/AO Jumper Setting .....	64
2.1.3. Hardware Wiring.....	66
2.2. Network Connection .....	67
2.2.1. Connection by Factory Default Settings (For New UA).....	68
2.2.2. Connection by Utility Searching.....	71
<b>3. Main Function Settings.....</b>	<b>74</b>
3.1 Settings for Using OPC UA Connection.....	75
3.1.1 OPC UA Server Connection Settings (UA I/O) .....	76
3.1.2 OPC UA Client Side: AVEVA Edge Simple Application .....	77

3.1.3 Secure Encrypted Connection: OPC UA Certificate .....	78
3.2 Settings for Using MQTT Connection .....	79
3.2.1 Connecting to MQTT Broker .....	80
3.2.2 MQTT Client Setting of the UA I/O .....	81
3.2.3 Secure Encrypted Connection: MQTT Certificate .....	86
3.3 RESTful API: Read and Write I/O and Virtual Point .....	87
What is Restful API? .....	87
Use RESTful with UA I/O .....	87
RESTful Description .....	89
Use RESTful API HTTPS with UA I/O .....	92
3.4 Common settings table for easy integration .....	93
Setting Steps: .....	93
3.5 Rule Setting .....	95
Setting Steps: .....	95
3.6 IoTstar Connection Example .....	98
<b>4. Main Menu: Parameter Descriptions .....</b>	<b>100</b>
4.1 Main Menu - System Setting .....	100
4.1.1 Overview .....	100
4.1.2 Network Setting .....	101
Network Setting (LAN) .....	101
Hostname Setting .....	102
4.1.3 Time Setting .....	103
Date and Time Display .....	103
NTP time calibration .....	104
Set the time manually .....	104
4.1.4 Account Setting .....	105
Administrator Setting .....	105
User Setting .....	107
4.1.5 Web Server Setting .....	108
Web Server Setting .....	108
Https Web Server Setting .....	109
RESTful API	110
4.1.6 Firewall Setting .....	112
4.1.7 Firmware Setting .....	113
Restore Factory Setting .....	113
Update Firmware .....	115
Maintenance .....	117
4.2 Main Menu - Module Setting .....	118
4.2.1 I Overview .....	118
Function Overview .....	118
Download the file from device .....	119
4.2.2 I/O Setting .....	120

Digital Input.....	120
Digital Output.....	121
Analog Input.....	122
Analog Output.....	123
4.2.3 Scaling.....	124
4.2.4 I/O Status.....	125
Digital Input (& Counter) .....	125
Digital Output .....	126
Analog Input.....	127
Analog Output.....	128
4.2.5 Project File.....	129
Download the file from device.....	129
Upload the file to the device .....	130
4.3 Main Menu - OPC UA Setting .....	131
4.3.1 Server Setting .....	132
4.3.2 Server Certificate .....	133
4.3.3 Client Setting .....	134
4.3.4 Client Certificate .....	136
4.4 Main Menu – MQTT Setting.....	137
4.4.1 Connection Setting .....	137
4.4.2 Client Setting .....	138
4.4.3 Certificate .....	141
4.5 Main Menu – Advanced Setting.....	143
4.5.1 Event Log .....	143
4.5.1.1 Main Setting.....	143
4.5.1.2 Send Messages To Line.....	146
<b>Test Token</b> .....	146
<b>Line Setting</b> .....	146
4.5.2 Rule Setting .....	148
4.5.2.1 Main Setting.....	148
4.5.2.2. I/O Control .....	150
4.5.2.3 Schedule .....	152
4.5.3 IoTstar Setting .....	154
4.5.4 EZ-UAQ Utility .....	156
<b>5. Recovering Firmware Setting (Reset) .....</b>	<b>157</b>
<b>Appendix A. Menu Path Diagram Description .....</b>	<b>159</b>
<b>Appendix B. MQTT JSON Format of the UA I/O Series.....</b>	<b>160</b>
<b>Appendix C. Dead Band Description.....</b>	<b>161</b>



# 1. UA I/O Introduction:

**UA I/O series** is a series of **IIoT I/O modules** known as **U-7500 or U-7000**. This series built-in provides the communication protocol functions of the Industrial Internet of Things (IIoT), including OPC UA Server / Client, MQTT Client and Restful API functions. It allows users to choose the network communication method according to their needs and directly transfer the value of the I/O channel to the Cloud system or the field-side control system for displaying, analysis or strategy.

## 1.1 Introduction

**UA I/O modules** is a series of Ethernet I/O modules that supports the **OPC UA Server / Client, MQTT Client and RESTful API** services (and can be used simultaneously). Users can choose the networking mode according to their needs and environment, to transmit the values of built-in I/O channels to the Cloud system or field control system for displaying, analysis or strategy. Support Scaling. Let the analog signal be converted into a more readable value. Support logic function rule setting IF, THEN, ELSE, can set up logical condition/action for I/O and virtual point; Provide schedule function to execute the set rules at a specific time; and support RESTful API function, can read/write I/O and virtual point through HTTP or HTTPS (identity verification and communication encryption).

In the information security and data security of the platform connection method, the following functions are provided respectively to enhance the security of I/O networking:

Connectivity for various platforms	OPC UA, MQTT, RESTful API can be used simultaneously
Connect to Cloud	MQTT
Connect to SCADA	OPC UA, MQTT
Connect to MES	OPC UA
Connect to IT	MQTT, RESTful API (HTTP, HTTPS)
Information Security	HTTPS, Port Binding, Allowlist, ICMP drop
Data Security	Certificate(X.509), Communication Encryption(SSL/TLS)

UA I/O Series provides a Web-based User Interface (Web UI) to configure the module, control the output channels, monitor the connection, and I/O status via a normal web browser. It is easy, fast, and no extra APP needed.

### OPC UA Architecture:



## MQTT Architecture:



## 1.2 Features

- **Built-in OPC UA Server Service**  
Compliance with IEC 62541 Standard. Provides functions of Active Transmission, Transmission Security Encryption (SSL/TLS), User Authentication (X.509 Certificates / Account password), Communication Error Detection and Recovery, etc. to connect SCADA or OPC UA Clients. Recommend to keep the maximum number of sessions within 3 connections.
- **Built-in OPC UA Client Service**  
Compliance with IEC 62541 Standard. Provides Transmission Security Encryption ( SSL / TLS ), User Authentication (X.509 Certificates / Account password), and OPC UA Server Connectivity.
- **Built-in MQTT Client Service**  
Build-in MQTT Client Service (Compliance with MQTT V.3.1.1 protocol). Provides functions of IoT Active M2M Transmission, QoS (Quality of Service), Retains Mechanism, Identity Authentication, Encryption, Last Will, etc.
- **Support RESTful API function**  
Support to read/write I/O and Virtual points via HTTP.  
Provide high-security HTTPS (identity verification and communication encryption) to read/write I/O and Virtual points.
- **Support to Execute OPC UA, MQTT, and RESTful API Communication at the Same Time.**
- **Support IoTstar Cloud Management Software**  
UA I/O factory version 9.7 and later supports this function.
- **Support Scaling**  
AI/AO modules support Scaling. Let the analog signal be converted into a more readable value.
- **Support logic function Rule Setting: IF, THEN, ELSE**  
Users can set up logical condition/action for I/O and virtual point.
- **Support Schedule**  
Provide schedule function to execute the set rules at a specific time.
- **Support Event Log**  
When the I/O value changes, record the current I/O value for easy device tracking in the future.
- **Built-in Web Server to Provide the Web User Interface**  
UA I/O Series provides a Web-based User Interface (Web UI) to configure the module, control the output channels, monitor the connection, and I/O status via a normal web browser. It is easy, fast,

and no extra APP needed.

### ■ **Diversified Choices**

Different models provide different AI, AO, DI, or DO channels, and users can choose the desired model according to the needs of the case.

### ■ **Dual-port Ethernet Switch for Daisy-Chain Topology**

Provide dual-port Ethernet switch for Daisy-Chain Topology. The cabling of Daisy-Chain Topology is much easier, and the total costs of cables and switches are significantly reduced.

### ■ **IEEE 802.3af-compliant Power over Ethernet (PoE)**

UA I/O follows IEEE 802.3af (classification, Class 2) compliant Power over Ethernet (PoE) specification. It allows receiving power from PoE enabled network by Ethernet pairs. This feature provides greater flexibility and efficiency to simplify system design, save space, and reduce wirings and power sockets.

## 1.3 Selection Guide

### U-7500 Series UA I/O Selection Guide:

U-7500 Series OPC UA I/O Module Selection Guide								
Module	AI		AO		DI		DO	
	Ch.	Type	Ch.	Type	Ch.	Type	Ch.	Type
U-7502M	3	±150 mV, ±500 mV, ±1 V, ±5 V, ±10 V +0 mA ~ +20 mA, ±20 mA, 4 ~ 20 mA	-	-	6	Wet (Sink/Source)	3	Power Relay, Form A (SPST N.O.)
U-7504M	4	±500mV, ±1V, ±5V, ±10V, 0~20mA, ±20mA, 4~20mA	4	0~5V, ±5V, 0~10V, ±10V, 0~20mA, 4~20mA	4	Dry (Source), Wet (Sink)	-	-
U-7515M	7	Pt100, Pt1000, Ni120, Cu100, Cu1000	-	-	-	-	-	-
U-7517M	8	±150 mV, ±500 mV, ±1 V, ±5 V, ±10 V ±20 mA, 0 ~ 20 mA, 4 ~ 20 mA	-	-	-	-	4	Isolated Open Collector (Sink)
U-7517M-10	10 / 20	±150mV, ±500mV, ±1V, ±5V, ±10V, ±20mA, 0~20mA, 4~20mA	-	-	-	-	-	-
U-7518ZM/S	10	±15 mV, ±50 mV, ±100 mV, ±500 mV, ±1 V, ±2.5 V ±20 mA, 0 ~ 20 mA, 4 ~ 20 mA Thermocouple: J, K, T, E, R, S, B, N, C, L, M, LDIN43710	-	-	-	-	3	Isolated Open Collector (Sink)
U-7518ZM/S2								
U-7519ZM/S	10	±15mV, ±50mV, ±100mV, ±150mV, ±500mV, ±1V, ±2.5V, ±5V, ±10V, ±20mA, 0~20mA, 4~20mA Thermocouple: J, K, T, E, R, S, B, N, C, L, M, LDIN43710	-	-	-	-	3	Isolated Open Collector (Sink)
U-7519ZM/S2								
U-7524M	-	-	4	0~5V, ±5V, 0~10V, ±10V, 0~20mA, 4~20mA	5	Dry (Source) Wet (Skin)	5	Isolated Open Collector (Sink)
U-7526M	6	±500 mV, ±1V, ±5V, ±10V, 0~20mA, ±20mA, 4~20mA	2	0~5V, ±5V, 0~10V, ±10V, 0~20mA, 4~20mA	2	Dry (Source) Wet (Skin)	2	Isolated Open Collector (Sink)
U-7528M	-	-	8	0~5V, ±5V, 0~10V, ±10V, 0~20mA, 4~20mA	-	-	-	-
U-7542M	-	-	-	-	-	-	16	Isolated Open Collector (Sink)

U-7500 Series OPC UA I/O Module Selection Guide								
Module	AI		AO		DI		DO	
	Ch.	Type	Ch.	Type	Ch.	Type	Ch.	Type
U-7544M	-	-	-	-	8	Wet (Sink/Source)	8	Isolated Open Collector (Sink)
U-7545M	-	-	-	-	-	-	16	Isolated Open Collector (Source)
U-7550AM	-	-	-	-	12	Dry (Source) Wet (Sink)	6	Isolated Open Collector (Sink)
U-7551M	-	-	-	-	16	Wet (Sink/Source)	-	-
U-7552M	-	-	-	-	8	Wet (Sink/Source)	8	Isolated Open Collector (Source)
U-7553M	-	-	-	-	16	Dry (Source)	-	-
U-7555M	-	-	-	-	8	Dry (Source), Wet (Sink,Source)	8	Isolated Open Collector (Source)
U-7558M	-	-	-	-	8	Wet (Sink/Source)	-	-
U-7559M	-	-	-	-	8	Wet (Sink/Source)	-	-
U-7560M	-	-	-	-	6	Wet (Sink/Source)	6	Power Relay Form A (SPST N.O.)
U-7561M	-	-	-	-	-	-	11	Power Relay, Form A (SPST N.O.)
U-7567M	-	-	-	-	-	-	8	Power Relay, Form A (SPST N.O.)

## 1.4 Specifications

### 1.4.1 Software Specifications (Series Common)

UA I/O Software Specifications (Series Common)	
Protocol	
OPC UA Server / Client	<ul style="list-style-type: none"> <li>● OPC Unified Architecture: 1.02</li> <li>● Core Server Facet</li> <li>● Data Access Server Facet</li> <li>● Method Server Facet</li> <li>● UA-TCP UA-SC UA Binary</li> <li>● User Authentication:               <ul style="list-style-type: none"> <li>- Anonymous</li> <li>- Username/Password</li> <li>- X.509 Certificate</li> </ul> </li> <li>● Security Policy:               <ul style="list-style-type: none"> <li>- None</li> <li>- Basic128Rsa15 (Sign, Sign &amp; Encrypt)</li> <li>- Basic256 (Sign, Sign &amp; Encrypt)</li> </ul> </li> <li>● Can Execute with MQTT and RESTful API Communication Simultaneously</li> <li>● Max. Session Connections: 3 (Server only)</li> </ul>
MQTT Client	<ul style="list-style-type: none"> <li>● Connect to the MQTT Broker to read or control the I/O channel value by the publish/subscribe messaging mechanism. (MQTT Ver. 3.1.1; TLS Ver. 1.2)</li> </ul>
RESTful API	<ul style="list-style-type: none"> <li>● User can read/write the I/O &amp; Virtual points through HTTP or HTTPS.</li> </ul>
Function	
Web Interface for Configuration	<ul style="list-style-type: none"> <li>● The system operation can be performed through the browser without installing software tools.</li> <li>● Use AES 256 encryption algorithm to encrypt web page setting data for general communication.</li> <li>● HTTPS upgrades the security of web communication.</li> </ul>
Scaling	<ul style="list-style-type: none"> <li>● Convert the analog signal to a more readable value.</li> <li>● Function is only available for modules with AI/AO.</li> </ul>
Security	<ul style="list-style-type: none"> <li>● Information Security: Provide HTTPS, Port Binding, Allowlist, ICMP drop functions.</li> <li>● Data security: Provide Certificate (X.509), Communication Encryption (SSL/TLS) functions.</li> </ul>
Rule Setting	<ul style="list-style-type: none"> <li>● Provide simple logic condition rule setting, let UA I/O do automatic condition judgment and action control, to achieve simple intelligentization.</li> </ul>
Schedule	<ul style="list-style-type: none"> <li>● Provide schedule function to execute the set rules at a specific time.</li> </ul>
Event Log	<ul style="list-style-type: none"> <li>● When the I/O value changes, record the current I/O value for easy device tracking in the future.</li> </ul>
IoTstar Setting	<ul style="list-style-type: none"> <li>● Support IoTstar cloud management software developed by ICP DAS.</li> </ul>

## 1.4.2 U-7502M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±2 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter

Power	
Reverse Polarity Protection	Yes
Consumption	4.1 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 to +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	3 (Differential)
Type	Voltage, Current
Range	±150 mV, ±500 mV, ±1 V, ±5 V, ±10 V 0 to 20 mA, ±20 mA, 4 to 20 mA(Jumper Selectable)
Resolution	16-bit
Accuracy	Normal Mode: ±0.1% Fast Mode: ±0.5% or better
Sampling Rate	Normal Mode: 10 samples/second (Total) Fast Mode: 50 samples/second (Total)
Input Impedance	Voltage: 2 MΩ Current: 125 Ω
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Overvoltage Protection	240 Vrms
Overcurrent Protection	50 mA at 110 VDC (max.)
Individual Channel Configuration	Yes
Open Wire Detection	Yes
Zero Drift	±20 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation

Digital Input/Counter	
Channels	6
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	+10 ~ +50 VDC
OFF Voltage Level	+4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ, 0.5W
Overvoltage Protection	+70 VDC

Relay Output	
Channels	3
Type	Power Relay, Form A (SPST N.O.)
Contact Rating	5 A @ 250 VAC/24 VDC (Resistive Load)
Operate Time	6 ms (Typical)
Release Time	3 ms (Typical)
Electrical Endurance	10 <sup>5</sup> ops.
Mechanical Endurance	2 × 10 <sup>7</sup> ops.
Power on Value	Programmable
Safe Value	Programmable



### 1.4.3 U-7504M Specifications

#### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
EFT (IEC 61000-4-4)	±2 kV for Power Line
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter

Power	
Reverse Polarity Protection	Yes
Consumption	5.5 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

#### I/O Specifications

Analog Input	
Channels	4 (Differential)
Type	Voltage, Current
Range	±500 mV, ±1 V, ±5 V, ±10 V 0 to 20 mA, ±20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	16-bit
Accuracy	Normal Mode: ±0.1% Fast Mode: ±0.5% or better
Sampling Rate	Normal Mode: 10 samples/second (Total) Fast Mode: 50 samples/second (Total)
Input Impedance	Voltage: 2 MΩ Current: 125 Ω
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Common Voltage Protection	±200 VDC
Overvoltage Protection	240 Vrms
Overcurrent Protection	50 mA at 110 VDC (max.)
Individual Channel Configuration	Yes
Open Wire Detection	Yes
Zero Drift	±20 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation

Analog Output	
Channels	4
Type	Voltage, Current
Range	+0 to +5 VDC, ±5 VDC, +0 to +10 VDC, ±10 VDC, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	12-bit
Accuracy	±0.1% of FSR
Open Wire Detection	For 4 ~ 20 mA only
Voltage Output Capability	10 V @ 20 mA
Current Load Resistance	400 Ω
Individual Channel Configuration	Yes
Power-on Value	Programmable
Safe Value	Programmable

Digital Input/Counter	
Channels	4
Type	Dry Contact Wet Contact
ON Voltage Level	Dry: Open Wet: +1 VDC (max.)
OFF Voltage Level	Dry: Close to GND Wet: +3.5 to +30 VDC
Max. Count	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Effective Distance	500m (max.)
Overvoltage Protection	+30 VDC

## 1.4.4 U-7515M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 3000 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±2 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.2 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	7 (Differential)
Type	RTD (2-wire, 3-wire)
Sensor Type	Pt100, Pt1000, Ni120, Cu100, Cu1000
Resistance Measurement	3.2 kΩ (max.)
Resolution	16-bit
Accuracy	±0.05%
Sampling Rate	12 samples/second (Total)
Input Impedance	> 1 MΩ
Common Mode Rejection	150 dB
Normal Mode Rejection	100 dB
Overvoltage Protection	+120 VDC
Individual Channel Configuration	Yes
Open Wire Detection	Yes
3-wire RTD Lead Resistance Elimination	Yes
Zero Drift	±0.5 μV/°C
Span Drift	±20 μV/°C

## 1.4.5 U-7517M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±2 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	4.4 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	8 (Differential)
Type	Voltage, Current
Range	±150 mV, ±500 mV, ±1 V, ±5 V, ±10 V ±20 mA, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	16-bit
Accuracy	Normal Mode: ±0.1% Fast Mode: ±0.5% or better
Sampling Rate	Normal Mode: 10 samples/second (Total) Fast Mode: 50 samples/second (Total)
Input Impedance	Voltage: 2 MΩ Current: 125 Ω
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Common Voltage Protection	±200 VDC
Overvoltage Protection	240 Vrms
Overcurrent Protection	50 mA at 110 VDC (max.)
Individual Channel Configuration	Yes
Open Wire Detection	For 4 ~ 20 mA only
Zero Drift	±20 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation
Digital Output	
Channels	4
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	700 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.6 U-7517M-10 Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±2 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.8 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	10 differential or 20 single-ended (Note1), software selectable
Type	Voltage, Current
Range	±150 mV, ±500 mV, ±1 V, ±5 V, ±10 V, ±20 mA, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	16-bit
Accuracy	Normal Mode: ±0.1% Fast Mode: ±0.5% or better
Sampling Rate	Normal Mode: 10 samples/second (Total) Fast Mode: 50 samples/second (Total)
Input Impedance	Voltage: 2 MΩ (Differential), 1 MΩ (Single-ended) Current: 125 Ω
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Common Voltage Protection	±200 VDC
Overvoltage Protection	Differential: 240 Vrms Single-ended: 150 Vrms
Overcurrent Protection	50 mA at 110 VDC (max.)
Individual Channel Configuration	Yes
Open Wire Detection	For 4 ~ 20 mA only
Zero Drift	±20 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation

## 1.4.7 U-7518ZM/S, U-7518ZM/S2 Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	RJ-45 x 2, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.3 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 114 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	10 (Differential)
Type	Voltage, Current, Thermocouple
Temperature Output Consistency	Yes
Stable Temperature Output in the Field	Yes
Range	±15 mV, ±50 mV, ±100 mV, ±500 mV, ±1 V, ±2.5 V ±20 mA, 0 to 20 mA, 4 to 20 mA (Requires Optional External 125 Ω Resistor) Thermocouple (J, K, T, E, R, S, B, N, C, L, M, and LDIN43710)
Resolution	16-bit
Accuracy	±0.1% of FSR or better
Sampling Rate	10 Samples/Second (Total)
Input Impedance	> 300 kΩ
Common Mode Rejection	150 dB (min.)
Normal Mode Rejection	100 dB
Overvoltage Protection	240 Vrms
Individual Channel Configuration	Yes
Open Wire Detection	Yes
Zero Drift	±0.5 µV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation

Digital Output	
Channels	3
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	700 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.8 U-7519ZM/S, U-7519ZM/S2 Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.6 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 114 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	10 (Differential)
Type	Voltage, Current, Thermocouple
Temperature Output Consistency	Yes
Stable Temperature Output in the Field	Yes
Range	±15 mV, ±50 mV, ±100 mV, ±150 mV, ±500 mV, ±1 V, ±2.5 V, ±5 V, ±10 V ±20 mA, 0 to 20 mA, 4 to 20 mA (Requires Optional External 125 Ω Resistor) Thermocouple (J, K, T, E, R, S, B, N, C, L, M, and LDIN43710)
Resolution	16-bit
Accuracy	±0.1% of FSR or better
Sampling Rate	10 Samples/Second (Total)
Input Impedance	> 300 kΩ
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Overvoltage Protection	240 Vrms
Individual Channel Configuration	Yes
Open Wire Detection	Yes
Zero Drift	±0.5 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation
Digital Output	
Channels	3
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	700 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable



## 1.4.9 U-7524M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter

Power	
Reverse Polarity Protection	Yes
Consumption	5.5 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Output	
Channels	4
Type	Voltage, Current
Range	+0 to +5 VDC, ±5 VDC, +0 to +10 VDC, ±10 VDC, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	12-bit
Accuracy	±0.1% of FSR
Open Wire Detection	For 4 ~ 20 mA only
Voltage Output Capability	10 V @ 20 mA
Current Load Resistance	500 Ω
Individual Channel Configuration	Yes
Power-on Value	Programmable
Safe Value	Programmable

Digital Input/Counter	
Channels	5
Type	Dry Contact, Wet Contact
ON Voltage Level	Dry: Close to GND Wet: +1 VDC (max.)
OFF Voltage Level	Dry: Open Wet: +3.5 ~ +30 VDC
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Effective Distance	500m (max.)
Overvoltage Protection	+30 VDC
Digital Output	
Channels	5
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	600 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.10 U-7526M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
EFT (IEC 61000-4-4)	±2 kV for Power Line
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter

Power	
Reverse Polarity Protection	Yes
Consumption	5.2 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Analog Input	
Channels	6 (Differential)
Type	Voltage, Current
Range	±500 mV, ±1V, ±5 V, ±10 V 0 to 20 mA, ±20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	16-bit
Accuracy	Normal Mode: ±0.1% Fast Mode: ±0.5% or better
Sampling Rate	Normal Mode: 10 samples/second (Total) Fast Mode: 50 samples/second (Total)
Input Impedance	Voltage: 2 MΩ Current: 125 Ω
Common Mode Rejection	86 dB (min.)
Normal Mode Rejection	100 dB
Common Voltage Protection	±200 VDC
Overvoltage Protection	240 Vrms
Overcurrent Protection	50 mA at 110 VDC (max.)
Individual Channel Configuration	Yes
Open Wire Detection	For 4 ~ 20 mA only
Zero Drift	±20 μV/°C
Span Drift	±25 ppm/°C
Isolation	±400 VDC, Virtual Channel to Channel Isolation
Analog Output	
Channels	2
Type	Voltage, Current
Range	+0 to +5 VDC, ±5 VDC, +0 to +10 VDC, ±10 VDC, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	12-bit
Accuracy	±0.1% of FSR

Open Wire Detection	For 4 ~ 20 mA only
Voltage Output Capability	10 V @ 20 mA
Current Load Resistance	500 Ω
Individual Channel Configuration	Yes
Power-on Value	Programmable
Safe Value	Programmable

Digital Input/Counter	
Channels	2
Type	Dry Contact Wet Contact
ON Voltage Level	Dry: Close to GND Wet: +1 VDC (max.)
OFF Voltage Level	Dry: Open Wet: +3.5 to +30 VDC
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Effective Distance	500m (max.)
Overvoltage Protection	+30 VDC
Digital Output	
Channels	2
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	700 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power-on Value	Programmable
Safe Value	Programmable



### 1.4.11 U-7528M Specifications

#### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	6.0 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

#### I/O Specifications

Analog Output	
Channels	8
Type	Voltage, Current
Range	+0 to +5 VDC, ±5 VDC, +0 to +10 VDC, ±10 VDC, 0 to 20 mA, 4 to 20 mA (Jumper Selectable)
Resolution	12-bit
Accuracy	±0.1% of FSR
Open Wire Detection	For 4 ~ 20 mA only
Voltage Output Capability	10 V @ 10 mA
Current Load Resistance	500 Ω
Individual Channel Configuration	Yes
Power-on Value	Programmable
Safe Value	Programmable

## 1.4.12 U-7542M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 3750 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.4 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Output	
Channels	16
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+ 3.5 ~ + 50 VDC
Load Current	650 mA/channel at 25°C Direct Drive Power Relay Module
Overvoltage Protection	+60 VDC
Overload Protection	1.3 A
Short-circuit Protection	Yes
Power-on Value	Programmable
Safe Value	Programmable

### 1.4.13 U-7544M Specifications

#### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.5 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

#### I/O Specifications

Digital Input/Counter	
Channels	8
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	+10 ~ +50 VDC
OFF Voltage Level	+4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ
Overvoltage Protection	+70 VDC
Digital Output	
Channels	8
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+ 3.5 ~ + 50 VDC
Load Current	650 mA/channel at 25°C Direct Drive Power Relay Module
Overvoltage Protection	+60 VDC
Overload Protection	1.4 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.14 U-7545M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 3750 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.1 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Output	
Channels	16
Type	Isolated Open Source
Sink/Source (NPN/PNP)	Source
Load Voltage	+10 ~ +40 VDC
Load Current	600 mA/channel
Overvoltage Protection	+47 VDC
Overload Protection	1.4 A (with short-circuit protection)
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.15 U-7550AM Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Swtich Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	2.9 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	12
Type	Dry Contact, Wet Contact
Sink/Source (NPN/PNP)	Dry: Source Wet: Sink
ON Voltage Level	Dry: Close to GND Wet: 1 VDC (max.)
OFF Voltage Level	Dry: Open Wet: +3.5 ~ +50 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ
Overvoltage Protection	+60 VDC
Digital Output	
Channels	6
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Sink
Load Voltage	+5 ~ +50 VDC
Load Current	500 mA/channel
Overvoltage Protection	+60 VDC
Overload Protection	1.3 A
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.16 U-7551M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Swtich Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.1 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	16
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	+10 ~ +50 VDC
OFF Voltage Level	+4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ
Overvoltage Protection	+70 VDC

## 1.4.17 U-7552M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±2 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.5 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	8
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	+10 ~ +50 VDC
OFF Voltage Level	+4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ
Overvoltage Protection	+70 VDC
Digital Output	
Channels	8
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Source
Load Voltage	+10 ~ +40 VDC
Load Current	650 mA/channel at 25°C
Overvoltage Protection	+47 VDC
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.18 U-7553M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	4.1 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	16
Type	Dry Contact
Sink/Source (NPN/PNP)	Source
ON Voltage Level	Close to GND
OFF Voltage Level	Open
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Effective Distance	500m (max.)



## 1.4.19 U-7555M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
EFT (IEC 61000-4-4)	±2 kV for Power Line
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	4.0 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	8
Type	Dry Contact Wet Contact
Sink/Source (NPN/PNP)	Dry: Source Wet: Sink/Source
On Voltage Level	Dry: Close to GND Wet: +10 ~ +50 VDC
OFF Voltage Level	Dry: Open Wet: +4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Effective Distance	500m (max.)
Input Impedance	10 kΩ
Overvoltage Protection	+70 VDC
Digital Output	
Channels	8
Type	Isolated Open Collector
Sink/Source (NPN/PNP)	Source
Load Voltage	+10 ~ +40 VDC
Load Current	650 mA/Channel at 25°C
Overvoltage Protection	+47 VDC
Short-circuit Protection	Yes
Power on Value	Programmable
Safe Value	Programmable

## 1.4.20 U-7558M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	2.7 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	8
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	80 ~ 250 VAC ±90 ~ ±250 VDC
OFF Voltage Level	30 VAC (max.) ±30 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	150 kΩ
Overvoltage Protection	300 VAC

## 1.4.21 U-7559M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 2500 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	2.7 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	8
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	10 ~ 80 VAC ±15 ~ ±80 VDC
OFF Voltage Level	3 VAC (max.) ±3 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	30 kΩ
Overvoltage Protection	120 VAC

## 1.4.22 U-7560M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication (Programmable)
Isolation	
2-way Isolation	I/O: 3000 VDC
EMS Protection	
EFT (IEC 61000-4-4)	±4 kV for Power Line
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Swtich Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	3.8 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, non-condensing

### I/O Specifications

Digital Input/Counter	
Channels	6
Type	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
ON Voltage Level	+10 ~ +50 VDC
OFF Voltage Level	+4 VDC (max.)
Max. Counts	4,294,967,295 (32-bit)
Frequency	100 Hz
Min. Pulse Width	5 ms
Input Impedance	10 kΩ
Overvoltage Protection	+70 VDC

Relay Output	
Channels	6
Type	Power Relay, Form A (SPST N.O.)
Contact Rating	5 A @ 250 VAC/24 VDC (Resistive Load)
Operate Time	10 ms (max.)
Release Time	5 ms (max.)
Electrical Endurance	10 <sup>5</sup> ops.
Mechanical Endurance	2 × 10 <sup>7</sup> ops.
Power on Value	Programmable
Safe Value	Programmable

### 1.4.23 U-7561M Specifications

#### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 3000 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	4.6 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing

#### I/O Specifications

Relay Output	
Channels	11
Type	Power Relay, Form A (SPST N.O.)
Contact Rating	5 A @ 250 VAC/24 VDC (Resistive Load)
Operate Time	10 ms (max.)
Release Time	5 ms (max.)
Electrical Endurance	10 <sup>5</sup> ops.
Mechanical Endurance	2 × 10 <sup>7</sup> ops.
Power on Value	Programmable
Safe Value	Programmable

## 1.4.24 U-7567M Specifications

### System Specifications

CPU Module	
CPU	32-bit CPU (400 MHz)
Watchdog Timer	Module, Communication(Programmable)
Isolation	
2-way Isolation	I/O: 3000 VDC
EMS Protection	
ESD (IEC 61000-4-2)	±4 kV Contact for each terminal ±8 kV Air for random point
EFT (IEC 61000-4-4)	±4 kV for Power Line
Surge (IEC 61000-4-5)	±2 kV for Power Line
LED Indicators	
Status	Run, Ethernet, I/O
Ethernet	
Ports	2 x RJ-45, 10/100 Base-TX, Switch Ports
PoE	Yes
LAN bypass	Yes
Security	ID, Password and IP Filter
Power	
Reverse Polarity Protection	Yes
Consumption	4.1 W
Powered from PoE	IEEE 802.3af, Class2
Powered from Terminal Block	+12 ~ +48 VDC
Mechanical	
Dimensions (mm)	97 x 120 x 47 (W x L x H)
Installation	DIN-Rail mounting
Environment	
Operating Temperature	-25 °C ~ +75 °C
Storage Temperature	-30 °C ~ +80 °C
Humidity	10 ~ 90% RH, Non-condensing



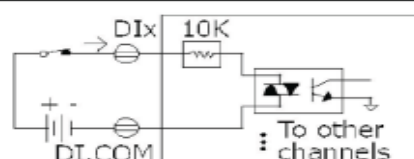
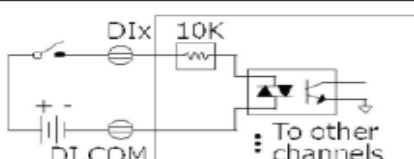
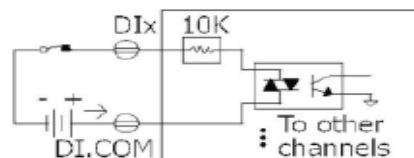
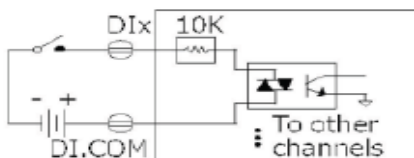
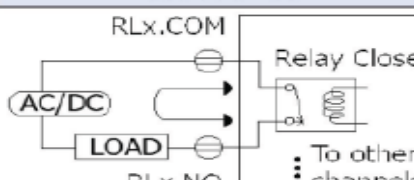
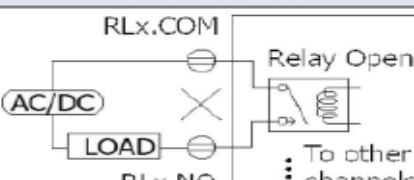
### I/O Specifications

Relay Output	
Channels	8
Type	Power Relay, Form A (SPST N.O.)
Contact Rating	5 A @ 250 VAC/24 VDC (Resistive Load)
Operate Time	10 ms (max.)
Release Time	5 ms (max.)
Electrical Endurance	10 <sup>5</sup> ops.
Mechanical Endurance	2 × 10 <sup>7</sup> ops.
Power on Value	Programmable
Safe Value	Programmable


## 1.5 Wire Connections / Pin Assignments

### 1.5.1 U-7502M Wire Connections / Pin Assignments/Jumper Pic

#### Wire Connections

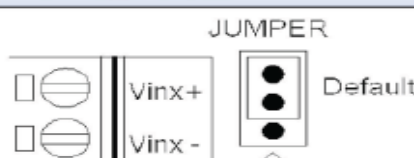
Voltage Input		Current Input	
			
Digital Input/Counter	Readback as 1	Readback as 0	
	+10 ~ +50 VDC	OPEN or <4 Vdc	
Sink			
Source			
Power Relay	ON State Readback as 1	OFF State Readback as 0	
	Relay Close	Relay Open	
Relay Output			

#### Pin Assignments

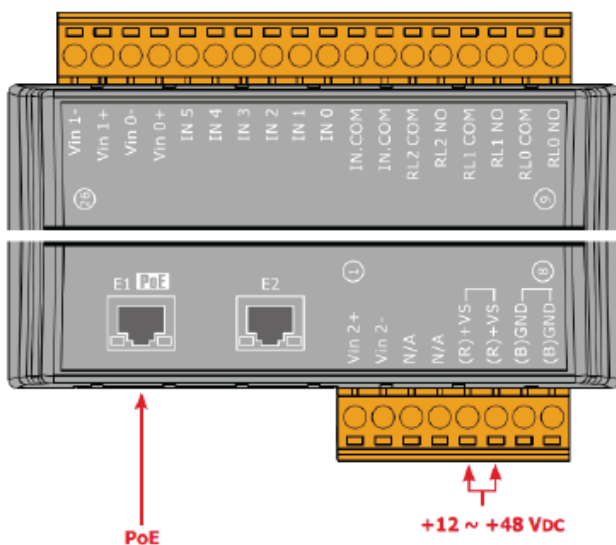


#### Jumper Location

U-7502M		
Channel	Vin1±	Vin0±
Jumper	J2	J1
Location	Jumper →	

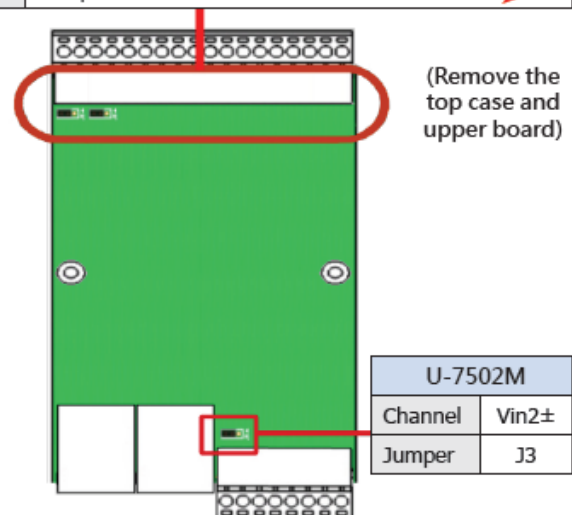


## 1.5.2 U-7504M Wire Connections / Pin Assignments/Jumper Pic


### Wire Connections

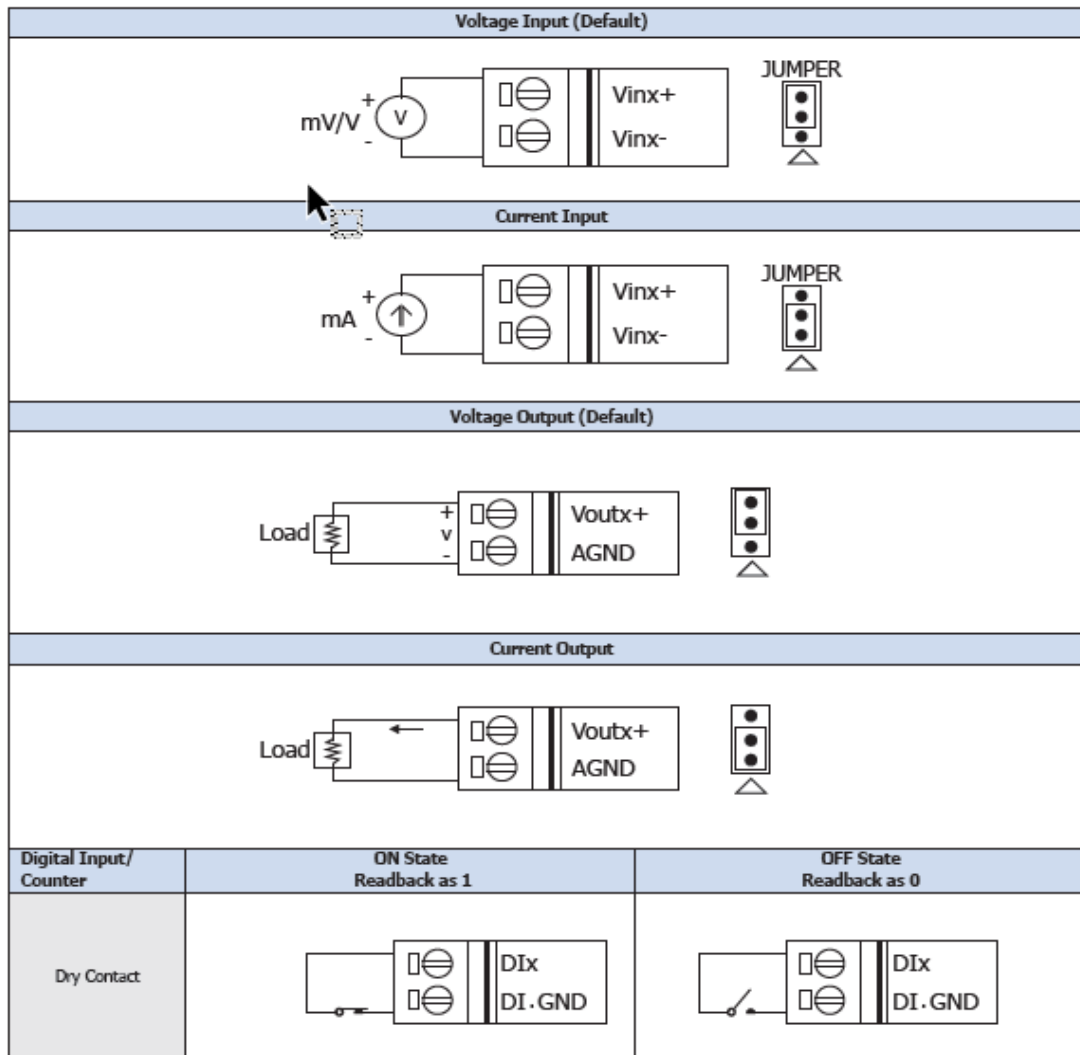


### Pin Assignments

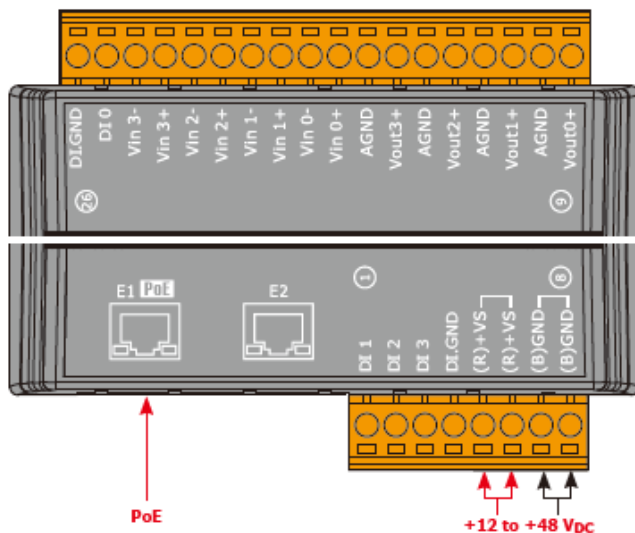

### Jumper Location

U-7504M								
Channel	Vin3	Vin2	Vin1	Vin0	Vout3	Vout2	Vout1	Vout0
Jumper	J4	J3	J2	J1	J8	J7	J6	J5
Location	Jumper 							

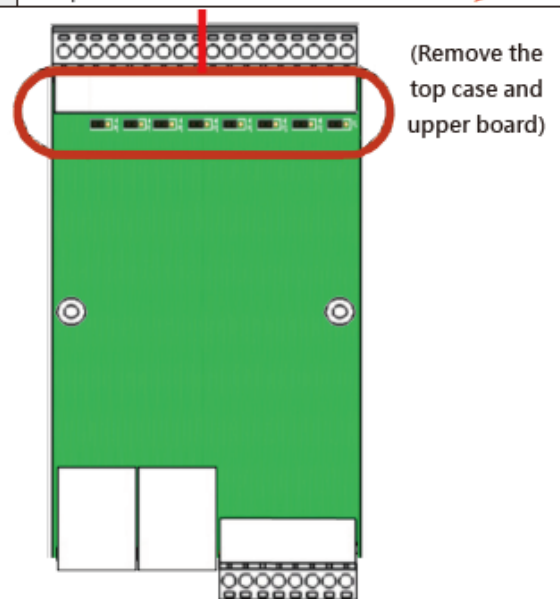




### 1.5.3 U-7515M Wire Connections / Pin Assignments

#### Wire Connections


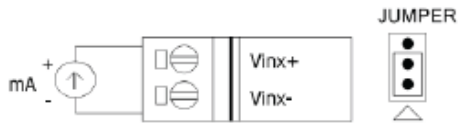
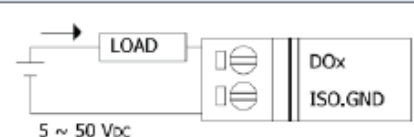
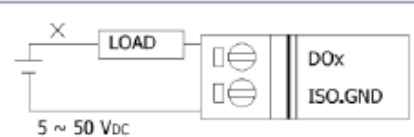
Open Collector (Sink)	CH0, 1, 2, 5 and 6	CH3 and CH4
2-wire of RTD		
3-wire of RTD		

#### Pin Assignments

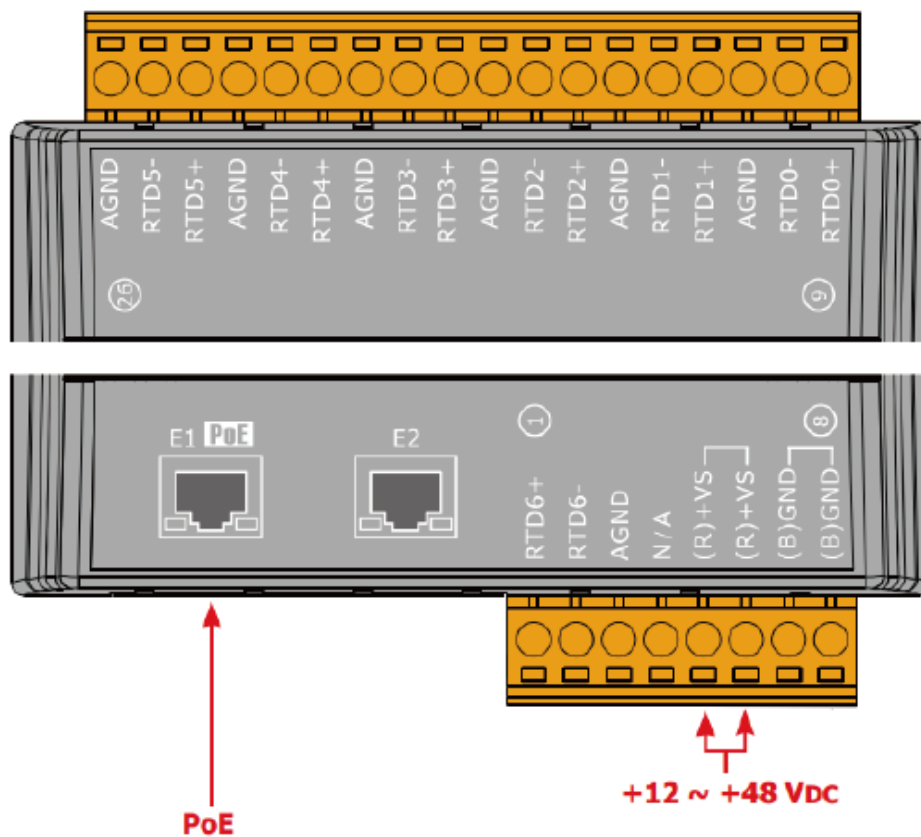


## 1.5.4 U-7517M Wire Connections/Pin Assignments/Jumper Pic

### Wire Connections


Voltage Input		Current Input
		
Digital Output	ON State Readback as 1	OFF State Readback as 0
Open Collector (Sink)		

### Pin Assignments

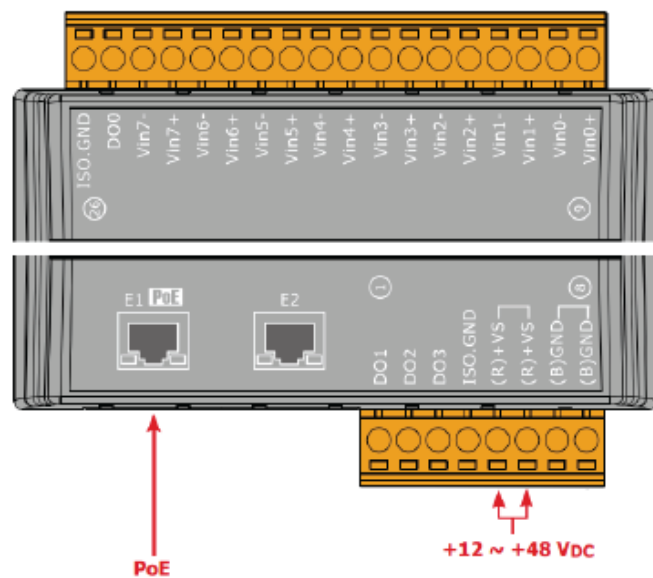


### Jumper Location

U-7517M								
Channel	Vin7±	Vin6±	Vin5±	Vin4±	Vin3±	Vin2±	Vin1±	Vin0±
Jumper	J8	J7	J6	J5	J4	J3	J2	J1
Location	Jumper →							

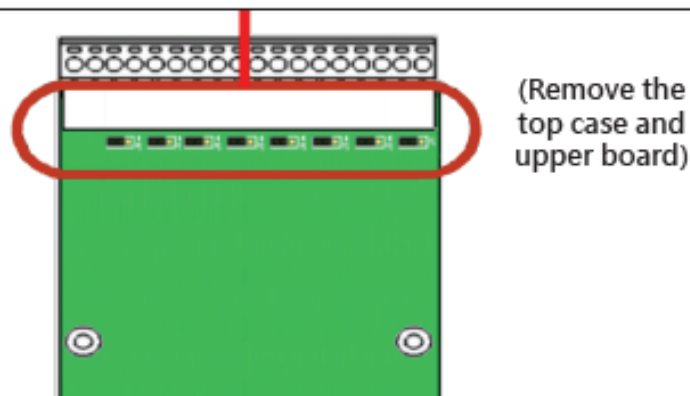


## 1.5.5 U-7517M-10 Wire Connections/Pin Assignments/Jumper Pic

### Wire Connections

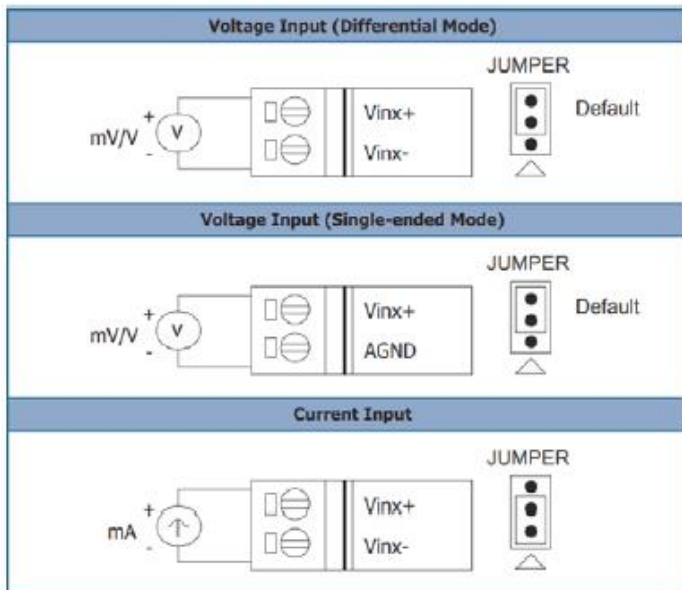


### Pin Assignments

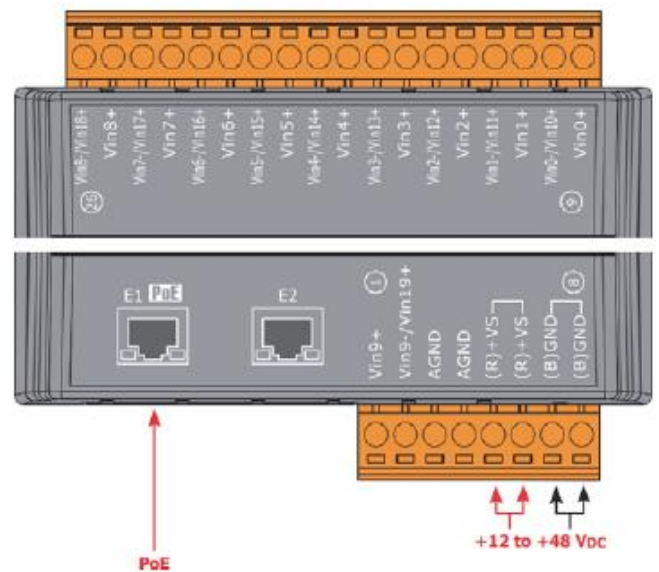

### Jumper Location

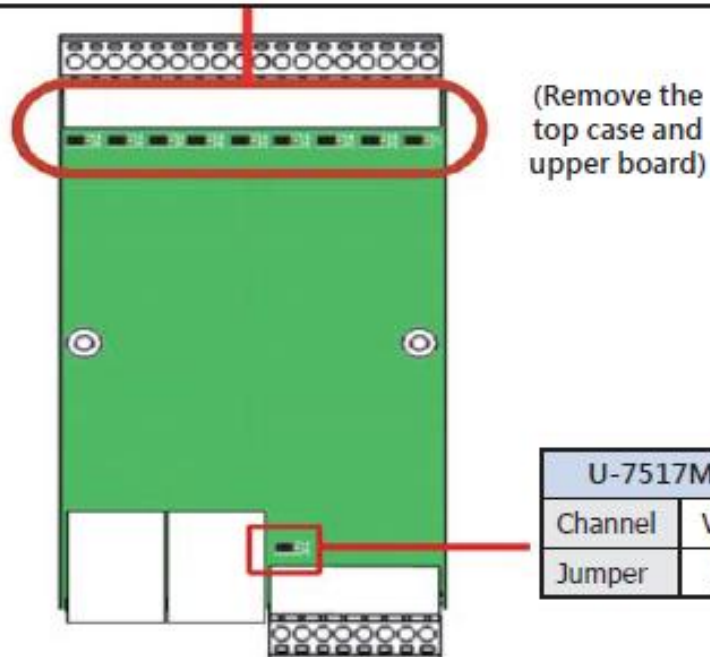




U-7517M-10									
Channel	Vin8±	Vin7±	Vin6±	Vin5±	Vin4±	Vin3±	Vin2±	Vin1±	Vin0±
Jumper	J9	J8	J7	J6	J5	J4	J3	J2	J1
Location	Jumper								




U-7517M-10	
Channel	Vin9±
Jumper	J10

## 1.5.6 U-7518ZM Wire Connections/Pin Assignments

### Wire Connections

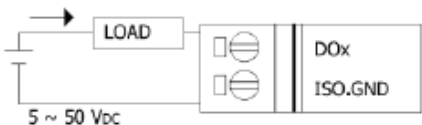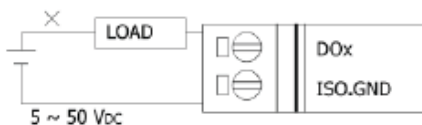
Voltage Input (Default)		
		
Thermocouple Input (Default)		
		
Current Input		
		Note: When connecting to a current source, an optional external 125 Ω resistor is required.
Digital Output	ON State Readback as 1	OFF State Readback as 0
Open Collector (Sink)		

### Pin Assignments

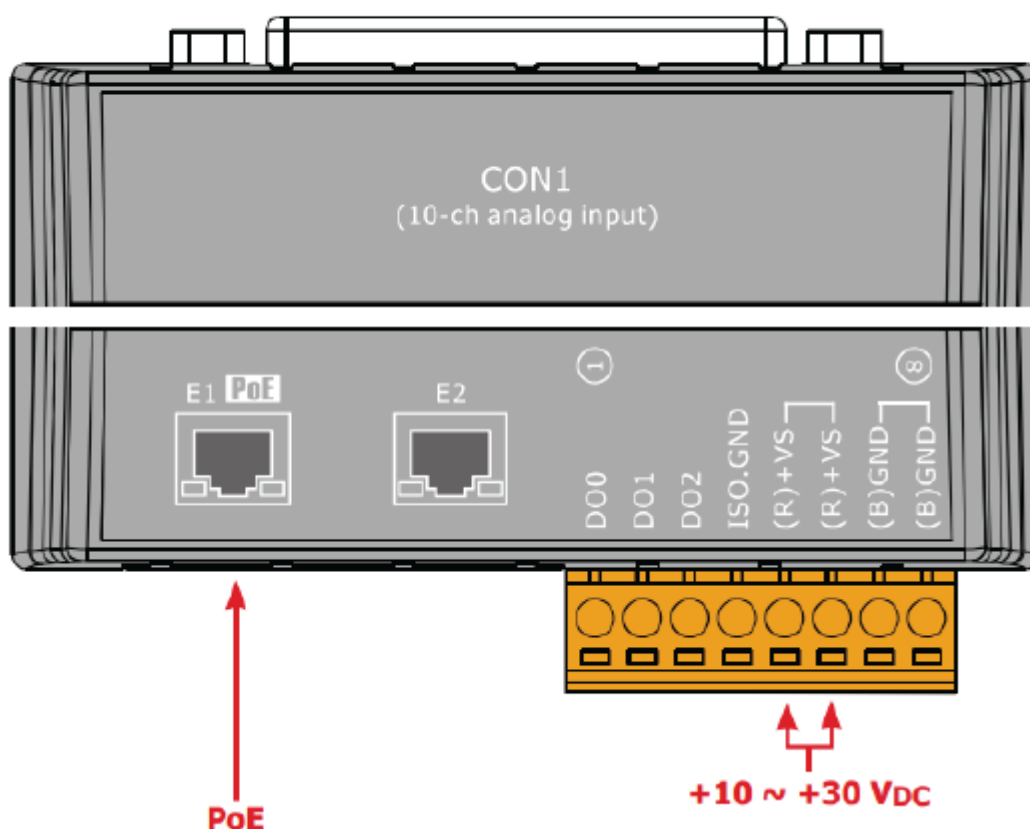


## 1.5.7 U-7519ZM Wire Connections/Pin Assignments/Jumper Pic

### Wire Connections

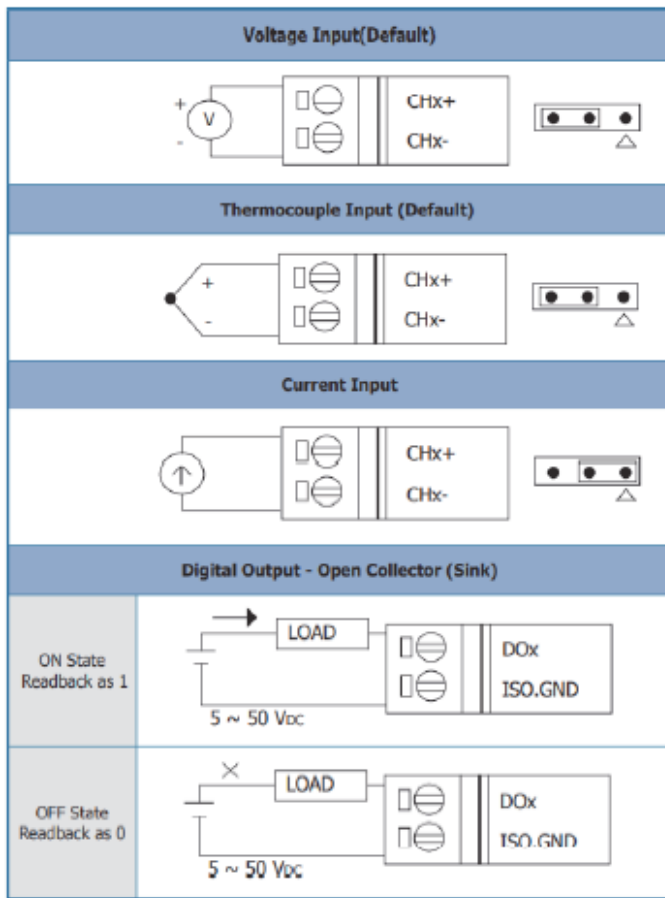


### Pin Assignments

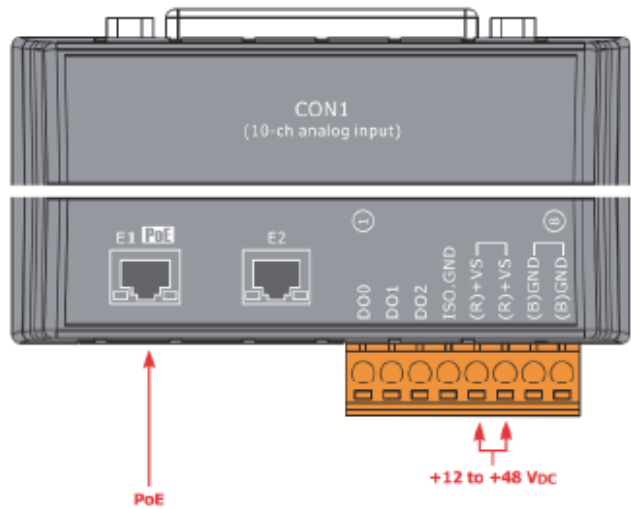

### Jumper Location

U-7519ZM										
Channel	CH0±	CH1±	CH2±	CH3±	CH4±	CH5±	CH6±	CH7±	CH8±	CH9±
Jumper	J1	J2	J3	J4	J5	J6	J7	J8	J9	J10
Location	Jumper →									

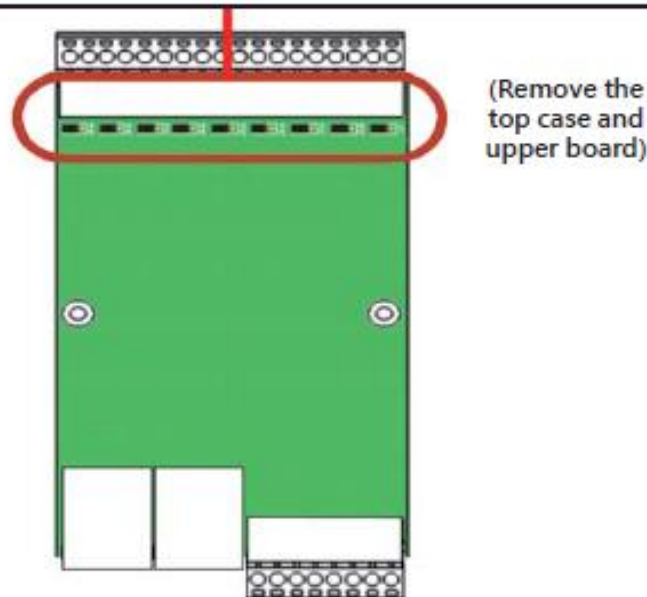


## 1.5.8 U-7524M Wire Connections/Pin Assignments/Jumper Pic

### Wire Connections


Digital Input/Counter	ON State Readback as 1	OFF State Readback as 0
Dry Contact		
Digital Input/Counter	ON State Readback as 1	OFF State Readback as 0
Wet Contact		
Digital Output	ON State Readback as 1	OFF State Readback as 0
Open Collector (Sink)		
<b>Voltage Output</b>		
<b>Current Output</b>		

### Pin Assignments

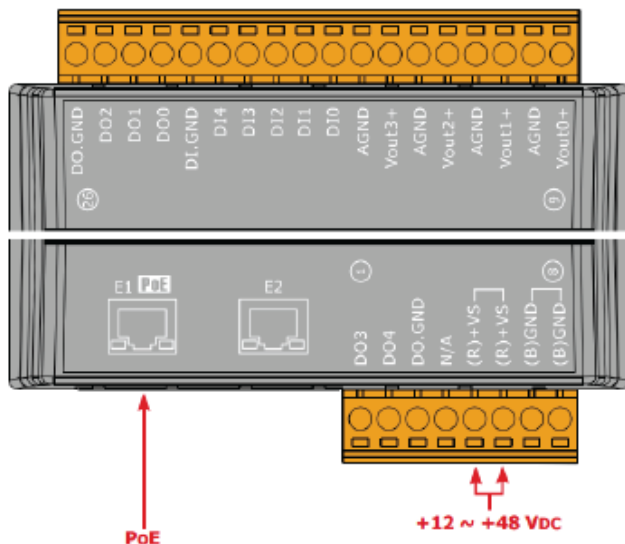


### Jumper Location

U-7524M				
Channel	Vout3+	Vout2+	Vout1+	Vout0+
Jumper	J4	J3	J2	J1
Location	Jumper →			

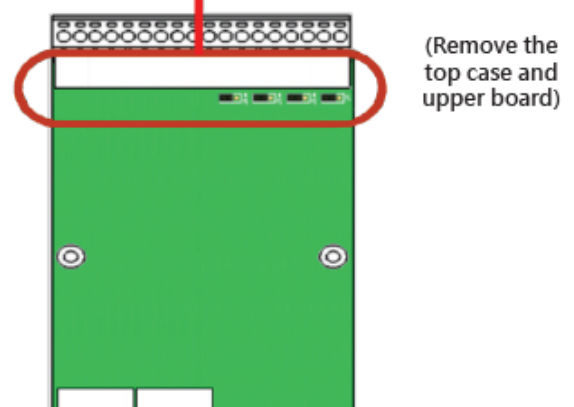


## 1.5.9 U-7526M Wire Connections/Pin Assignments/Jumper Pic

### Wire Connections

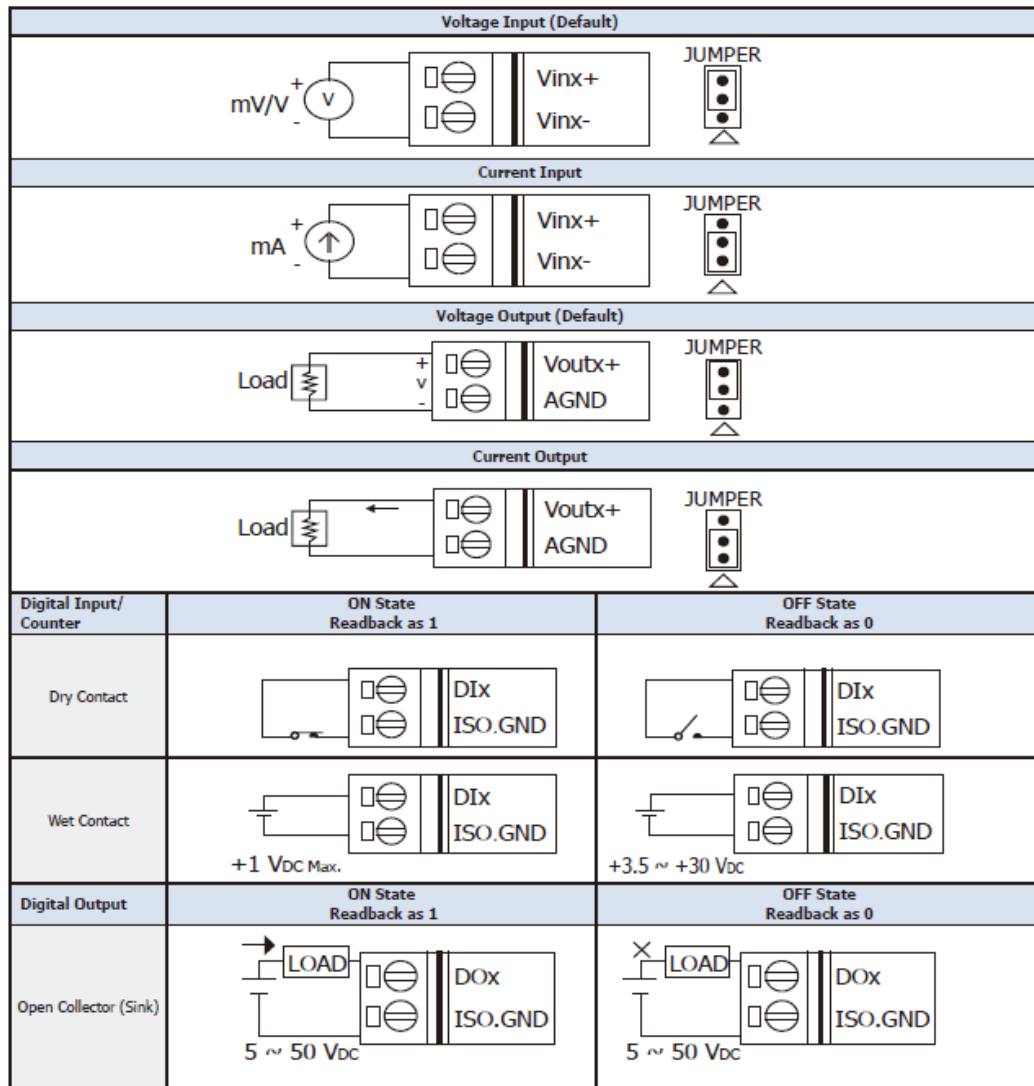


### Pin Assignments

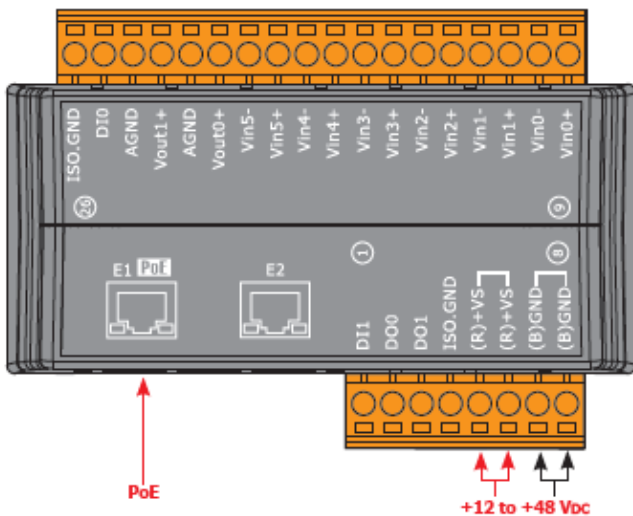

### Jumper Location







U-7526M								
Channel	Vout1	Vout0	Vin5	Vin4	Vin3	Vin2	Vin1	Vin0
Jumper	J8	J7	J6	J5	J4	J3	J2	J1
Location	Jumper →							

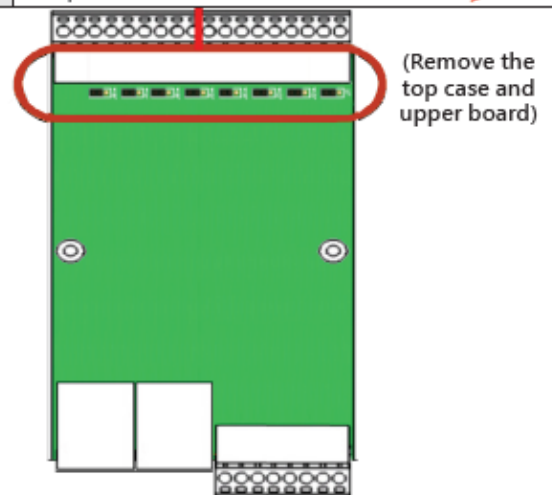




### 1.5.10 U-7528M Wire Connections/Pin Assignments/Jumper Pic


#### Wire Connections

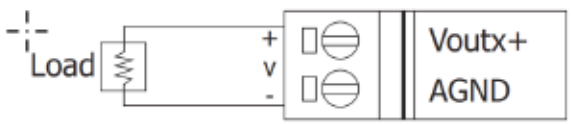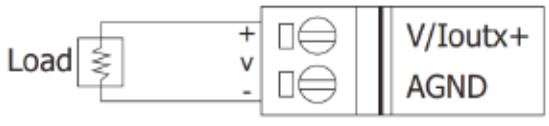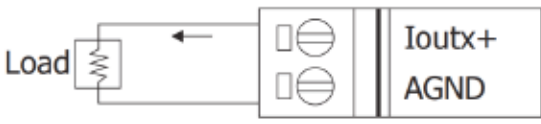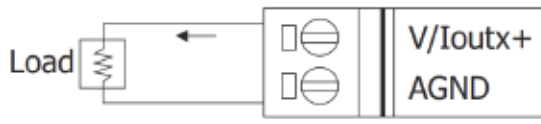Voltage Output		
Vout0 ~ Vout5		
Vout6 ~ Vout7		 Default
Current Output		
Iout0 ~ Iout5		
Iout6 ~ Iout7		 Current

#### Pin Assignments

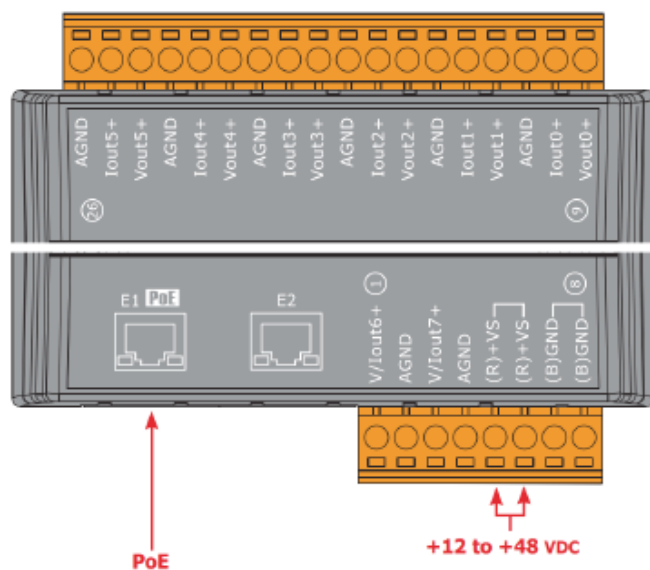





#### Jumper Location

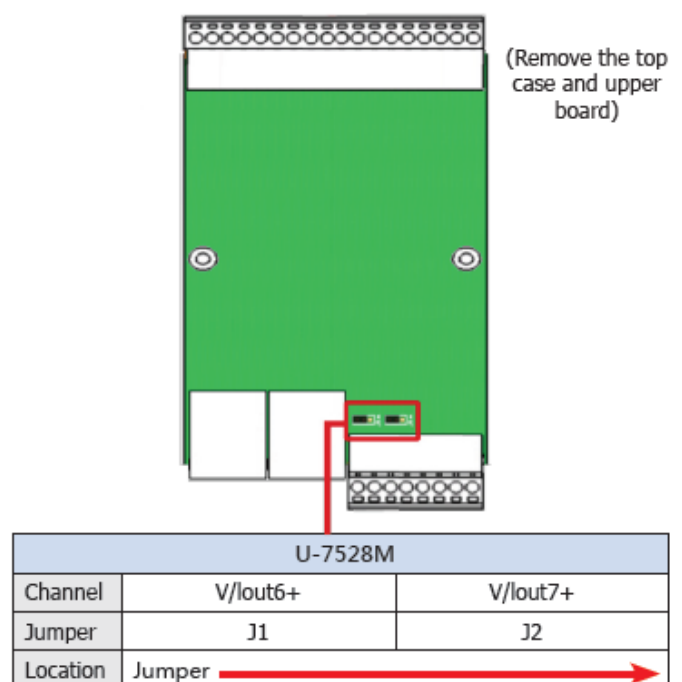




### 1.5.11 U-7542M Wire Connections/Pin Assignments

#### Wire Connections

Output Type	ON State Readback as 1	
Drive Relay		DO.PWR DOx DO.GND
Resistance Load		DO.PWR DOx DO.GND
Output Type	OFF State Readback as 0	
Drive Relay		DO.PWR DOx DO.GND
Resistance Load		DO.PWR DOx DO.GND

#### Pin Assignments

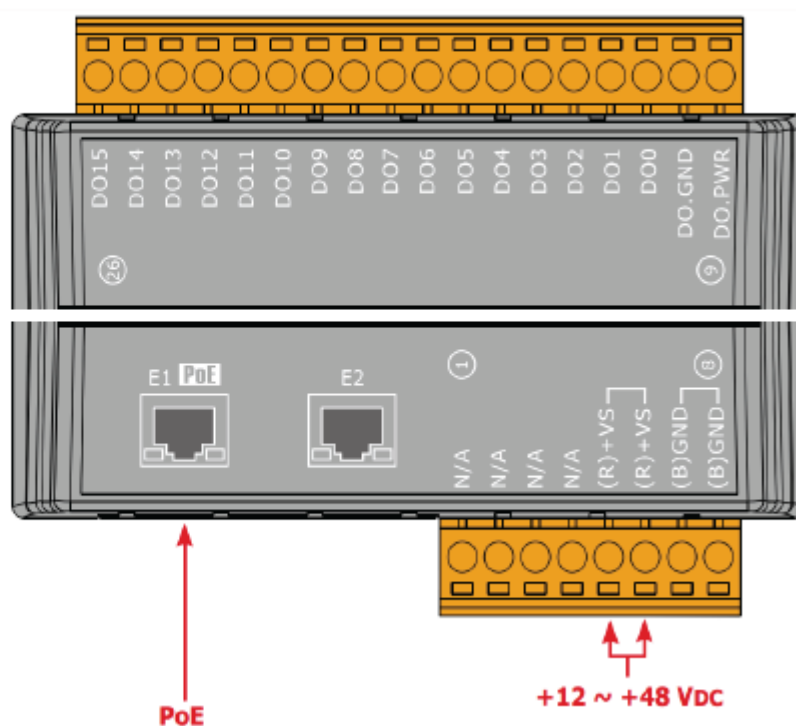


## 1.5.12 U-7544M Wire Connections/Pin Assignments

### Wire Connections

Digital Input/Counter	Readback as 1	Readback as 0
SINK	+10 ~ +50 VDC	OPEN or <4 VDC
Source	+10 ~ +50 VDC	OPEN or <4 VDC





Output Type	ON State Readback as 1	OFF State Readback as 0
Drive Relay		
Resistance Load		
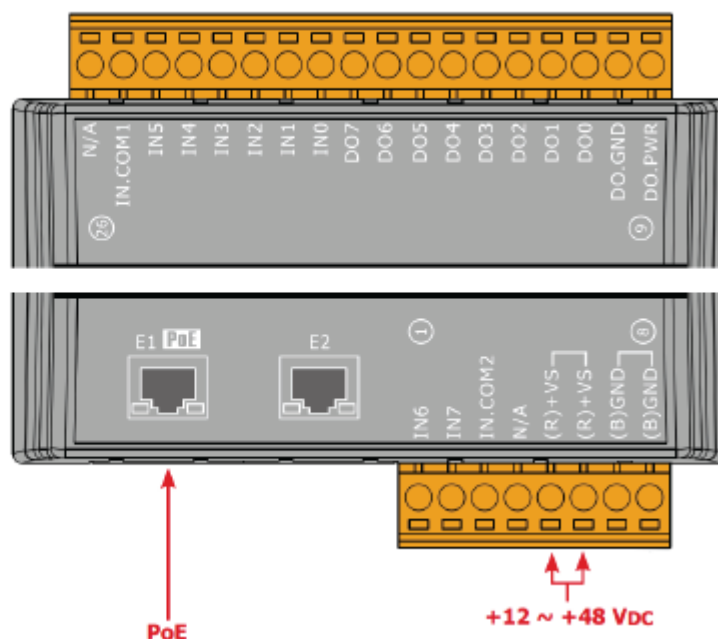
### Pin Assignments




### 1.5.13 U-7545M Wire Connections/Pin Assignments
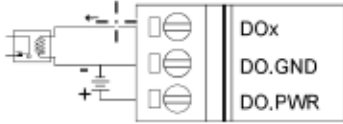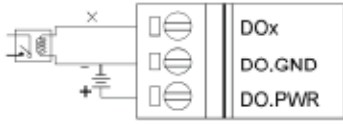
#### Wire Connections




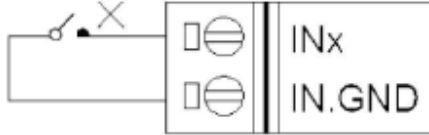
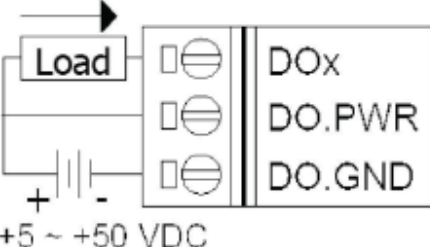
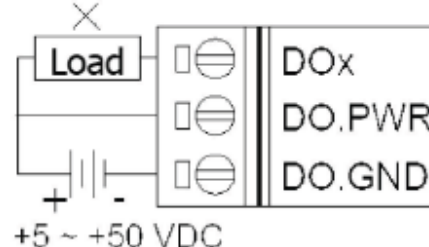
Output Type	ON State Readback as 1	Output Type	OFF State Readback as 0
Drive Relay		Drive Relay	
Resistance Load		Resistance Load	

#### Pin Assignments

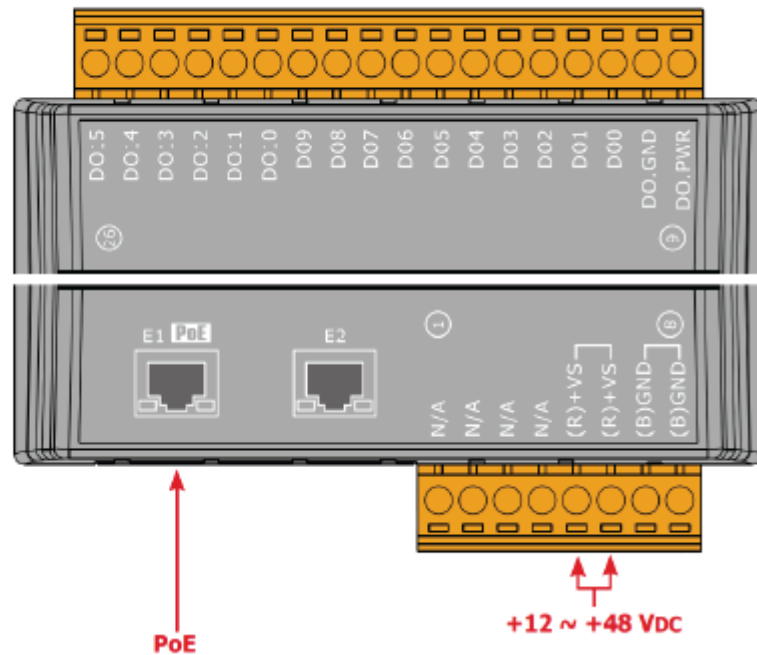


### 1.5.14 U-7550AM Wire Connections/Pin Assignments

#### Wire Connections

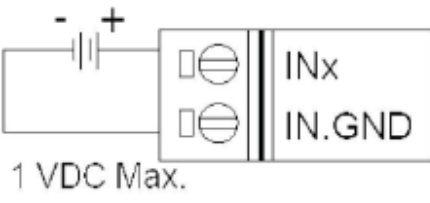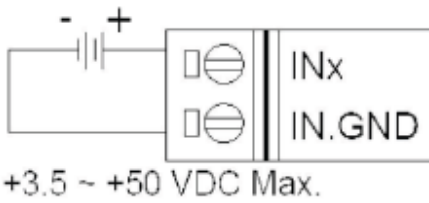Digital Input/ Counter	ON State Readback as 1	OFF State Readback as 0
Wet Contact (Sink)	 <p>1 VDC Max.</p>	 <p>+3.5 ~ +50 VDC Max.</p>
Dry Contact (Source)	 <p>Close to GND</p>	 <p>Open</p>
Digital Output	ON State Readback as 1	OFF State Readback as 0
Open Collector (Sink)	 <p>+5 ~ +50 VDC</p>	 <p>+5 ~ +50 VDC</p>

#### Pin Assignments

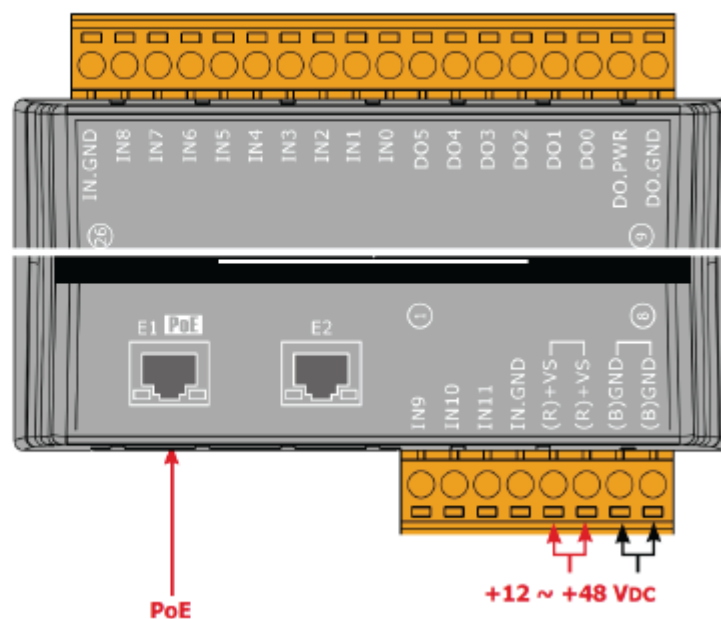


## 1.5.15 U-7551M Wire Connections/Pin Assignments

### Wire Connections

Digital Input/Counter	Readback as 1	Readback as 0
	+10 ~ +50 Vdc	OPEN or <4 Vdc
Sink		
Source		

### Pin Assignments

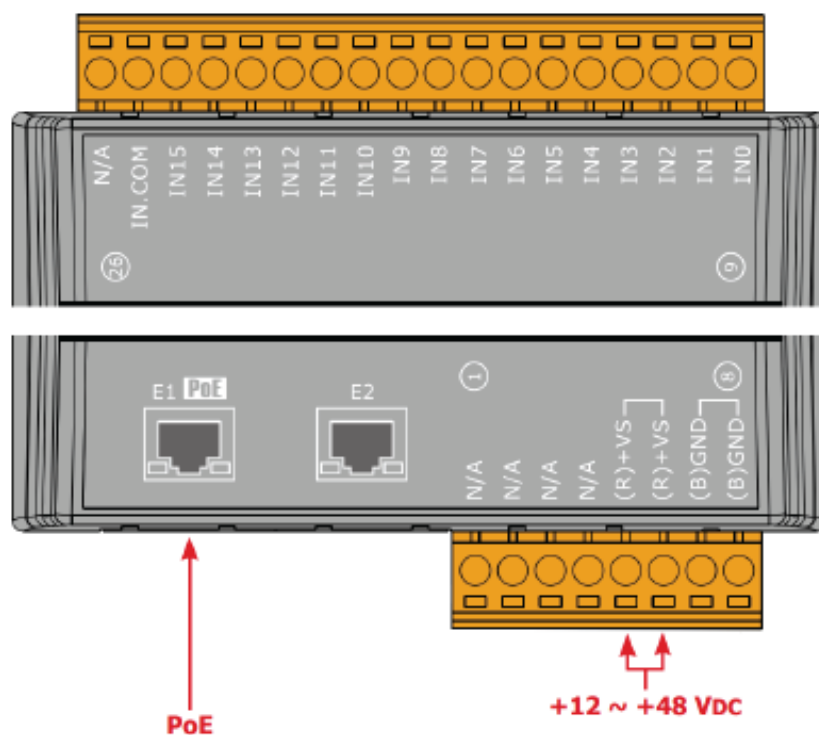


## 1.5.16 U-7552M Wire Connections/Pin Assignments

### Wire Connections



Digital Input/Counter	Readback as 1	Readback as 0
Sink	+10 ~ +50 Vdc 	OPEN or <4 Vdc 
Source	+10 ~ +50 Vdc 	OPEN or <4 Vdc 
Digital Output	ON State Readback as 1	OFF State Readback as 0
Source		

### Pin Assignments

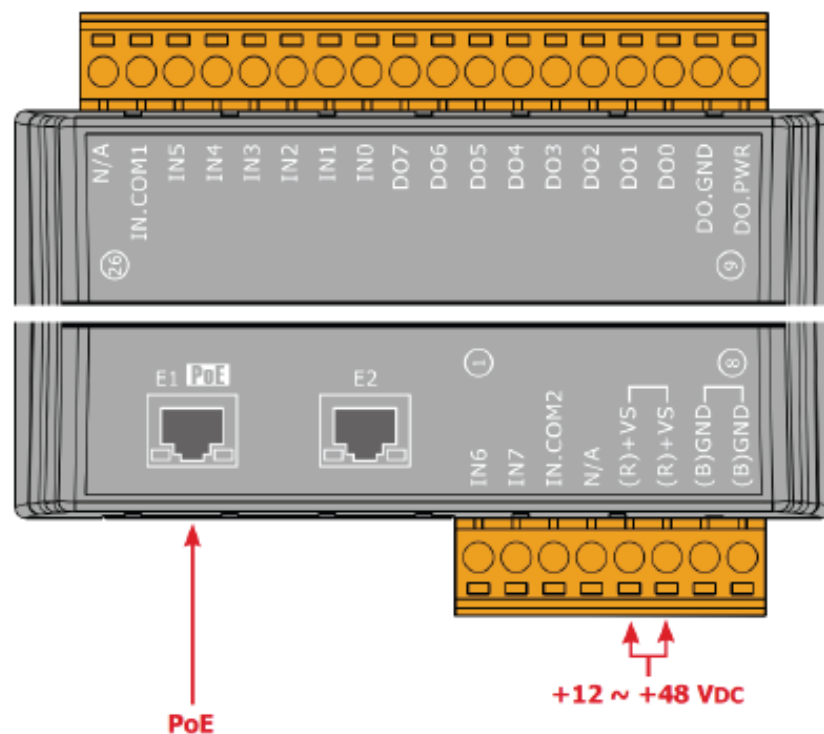


### 1.5.17 U-7553M Wire Connections/Pin Assignments

#### Wire Connections

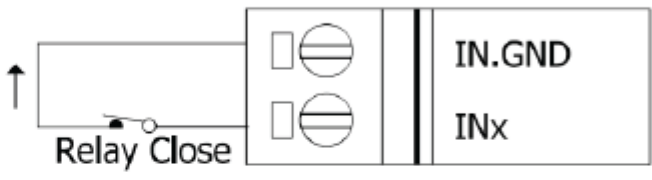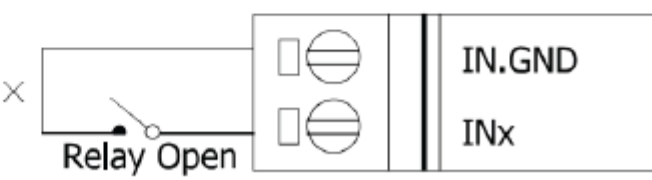Digital Input/Counter	ON State Readback as 1
Dry Contact	
	<b>OFF State Readback as 0</b>
	

#### Pin Assignments

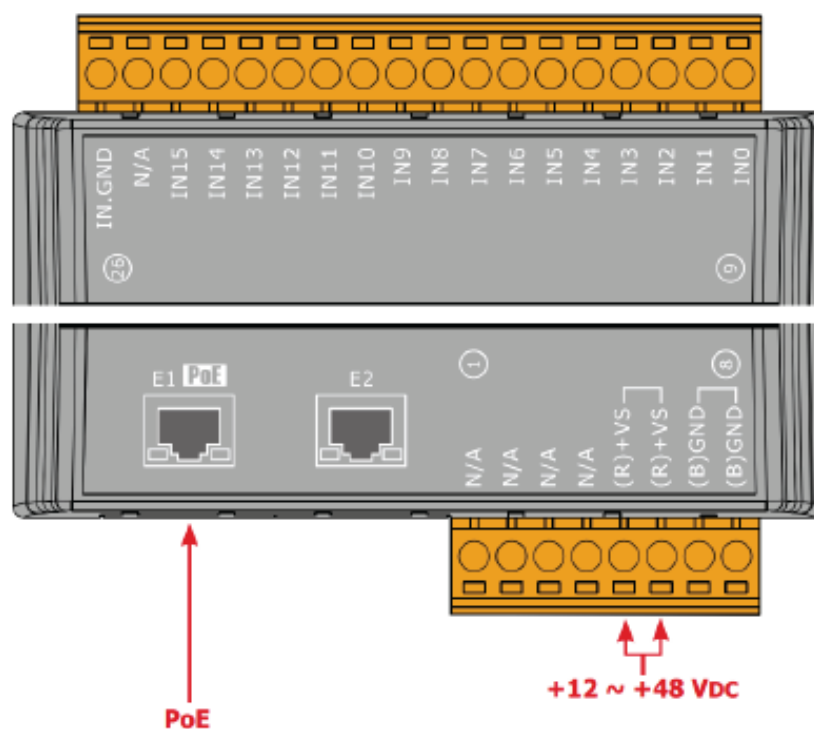

## 1.5.18 U-7555M Wire Connections / Pin Assignments


### Wire Connections

Digital Input/Counter	Readback as 1	Readback as 0
Wet Contact (Sink)	+10 ~ +50 Vdc 	OPEN or <4 Vdc 
Wet Contact (Source)	+10 ~ +50 Vdc 	OPEN or <4 Vdc 

Digital Input/Counter	ON State Readback as 1	OFF State Readback as 0
Dry Contact		

Digital Output	ON State Readback as 1	OFF State Readback as 0
Source		

### Pin Assignments

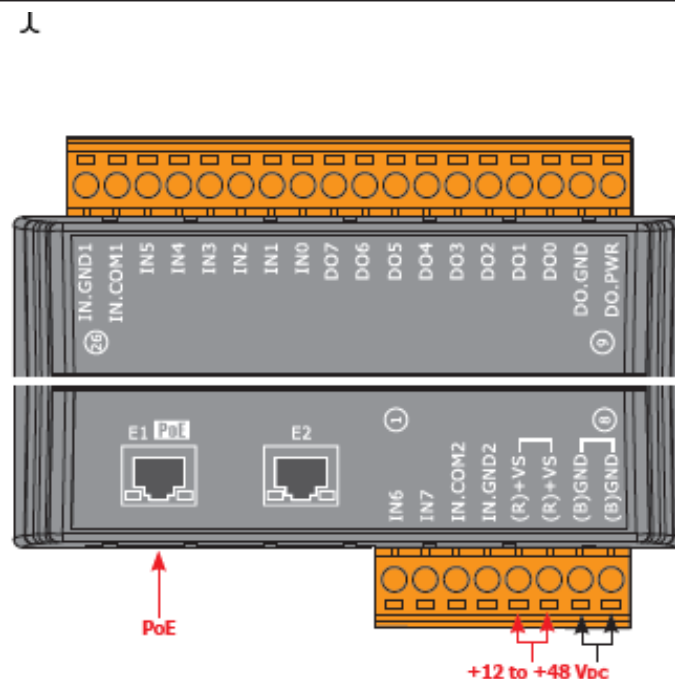




## 1.5.19 U-7558M Wire Connections/Pin Assignments

### Wire Connections





Digital Input/Counter	ON State Readback as 1	OFF State Readback as 0
AC Digital Input	80 ~ 250 VAC 	OPEN or < 30 VAC Max. 
DC Digital Input	90 ~ 250 Vdc 	OPEN or < 30 Vdc Max. 

### Pin Assignments

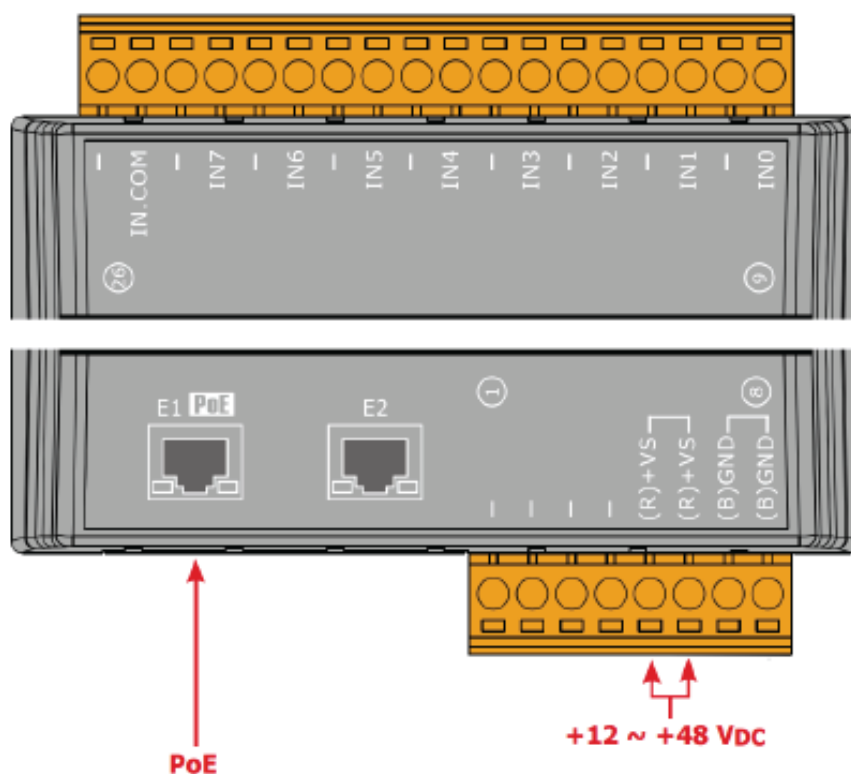


## 1.5.20 U-7559M Wire Connections/Pin Assignments

### Wire Connections

Digital Input/Counter	ON State Readback as 1 10 ~ 80 VAC	OFF State Readback as 0 OPEN or < 3 VAC Max.
AC Digital Input		
DC Digital Input		

### Pin Assignments

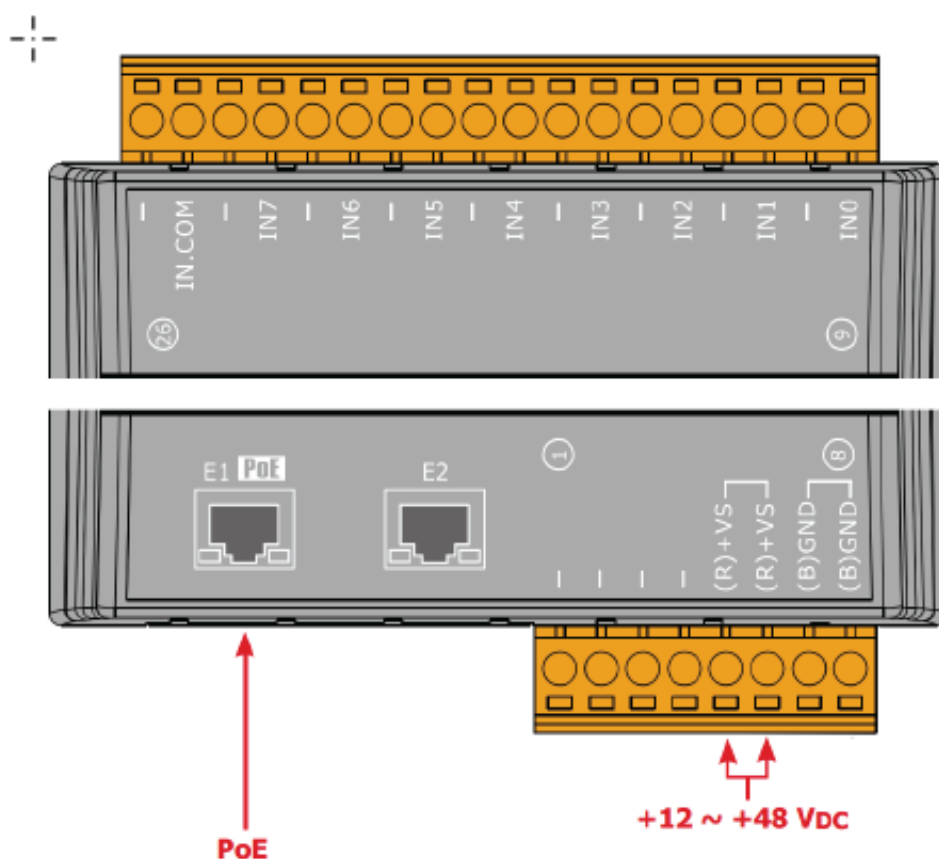


## 1.5.21 U-7560M Wire Connections / Pin Assignments

### Wire Connections

Digital Input/Counter	Readback as 1	Readback as 0
	+10 ~ +50 Vdc	OPEN or <4 Vdc
Sink		
	+10 ~ +50 Vdc	OPEN or <4 Vdc
Source		

Power Relay	ON State: Readback as 1
	OFF State: Readback as 0

### Pin Assignments

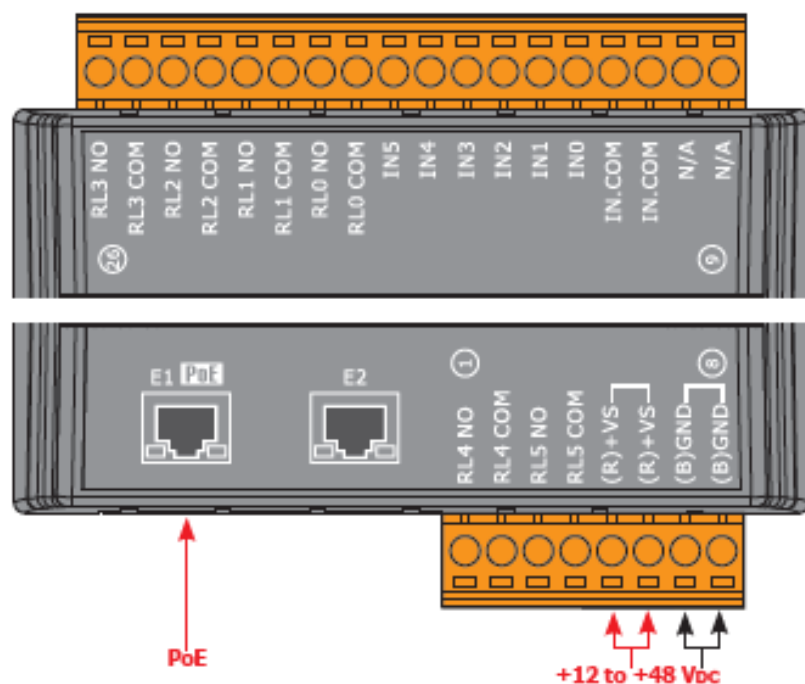


## 1.5.22 U-7561M Wire Connections/Pin Assignments

### Wire Connections




Power Relay	ON State Readback as 1
Relay Output	
	OFF State Readback as 0

### Pin Assignments

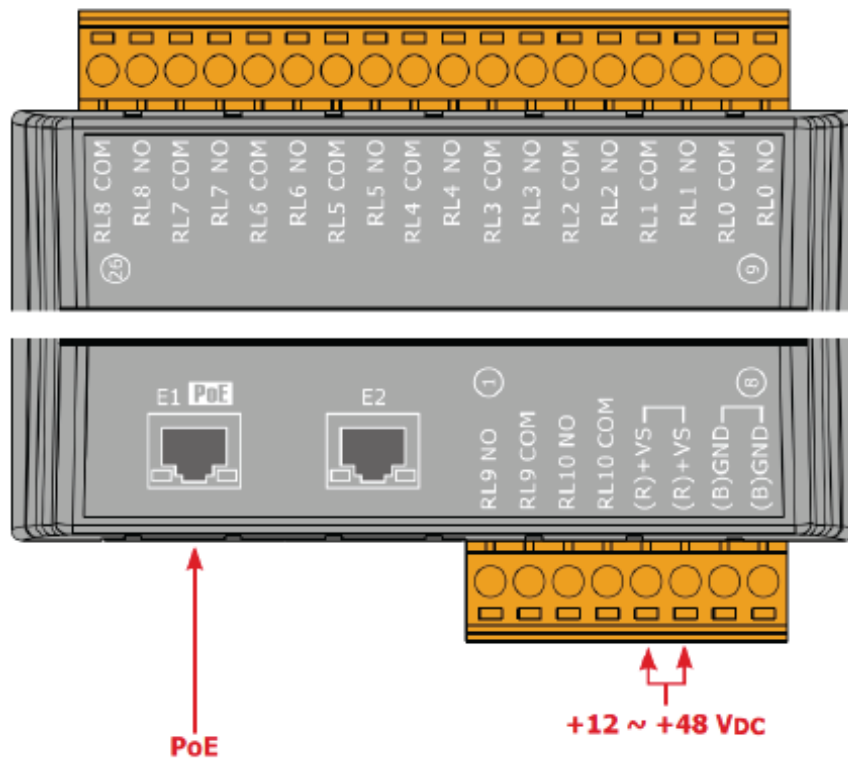


### 1.5.23 U-7567M Wire Connections/Pin Assignments

#### Wire Connections

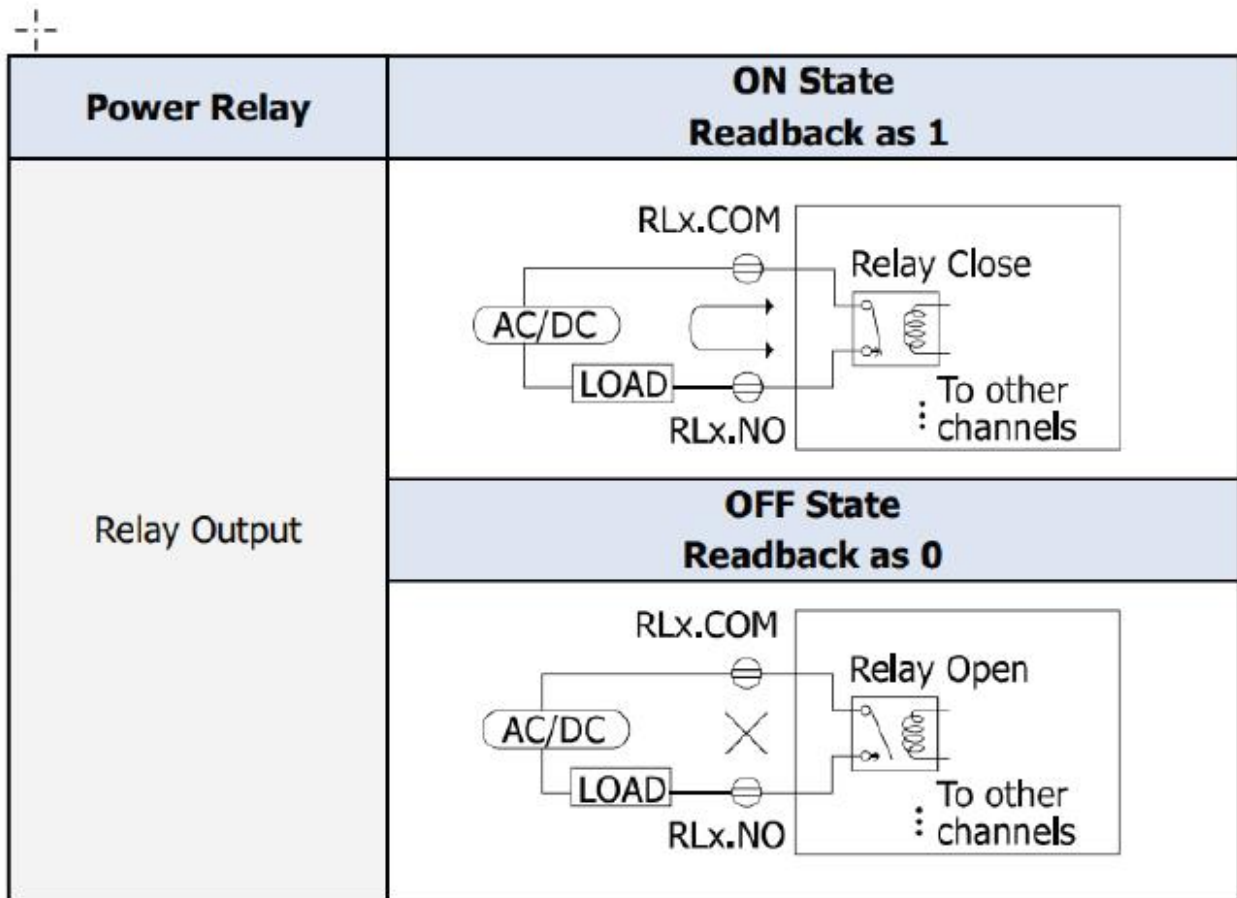


#### Pin Assignments

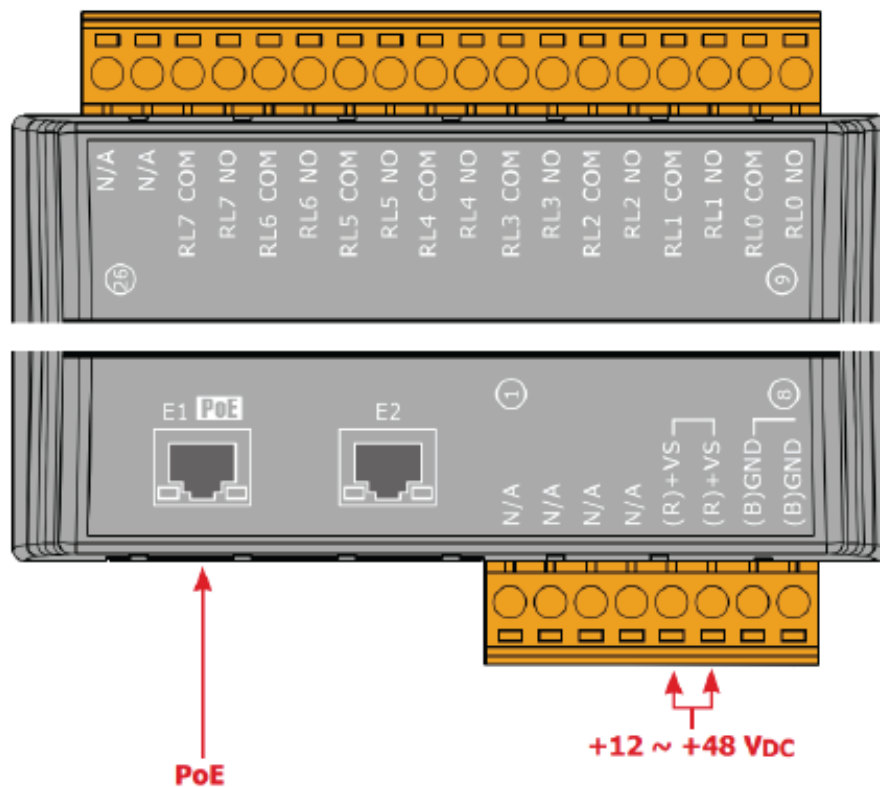

## 1.6 Dimensions


**U-7502M/U-7504M/U-7515M/U-7517M/U-7517M-10/U-7524M /U-7526M/U-7528M/U-7542M/U-7544M/U-7545M/U-7550AM /U-7551M/U-7552M/U-7553M/U-7555M/U-7558M/U-7559M /U-7560M/U-7561M/U-7567M Dimensions**

(Unit: mm)

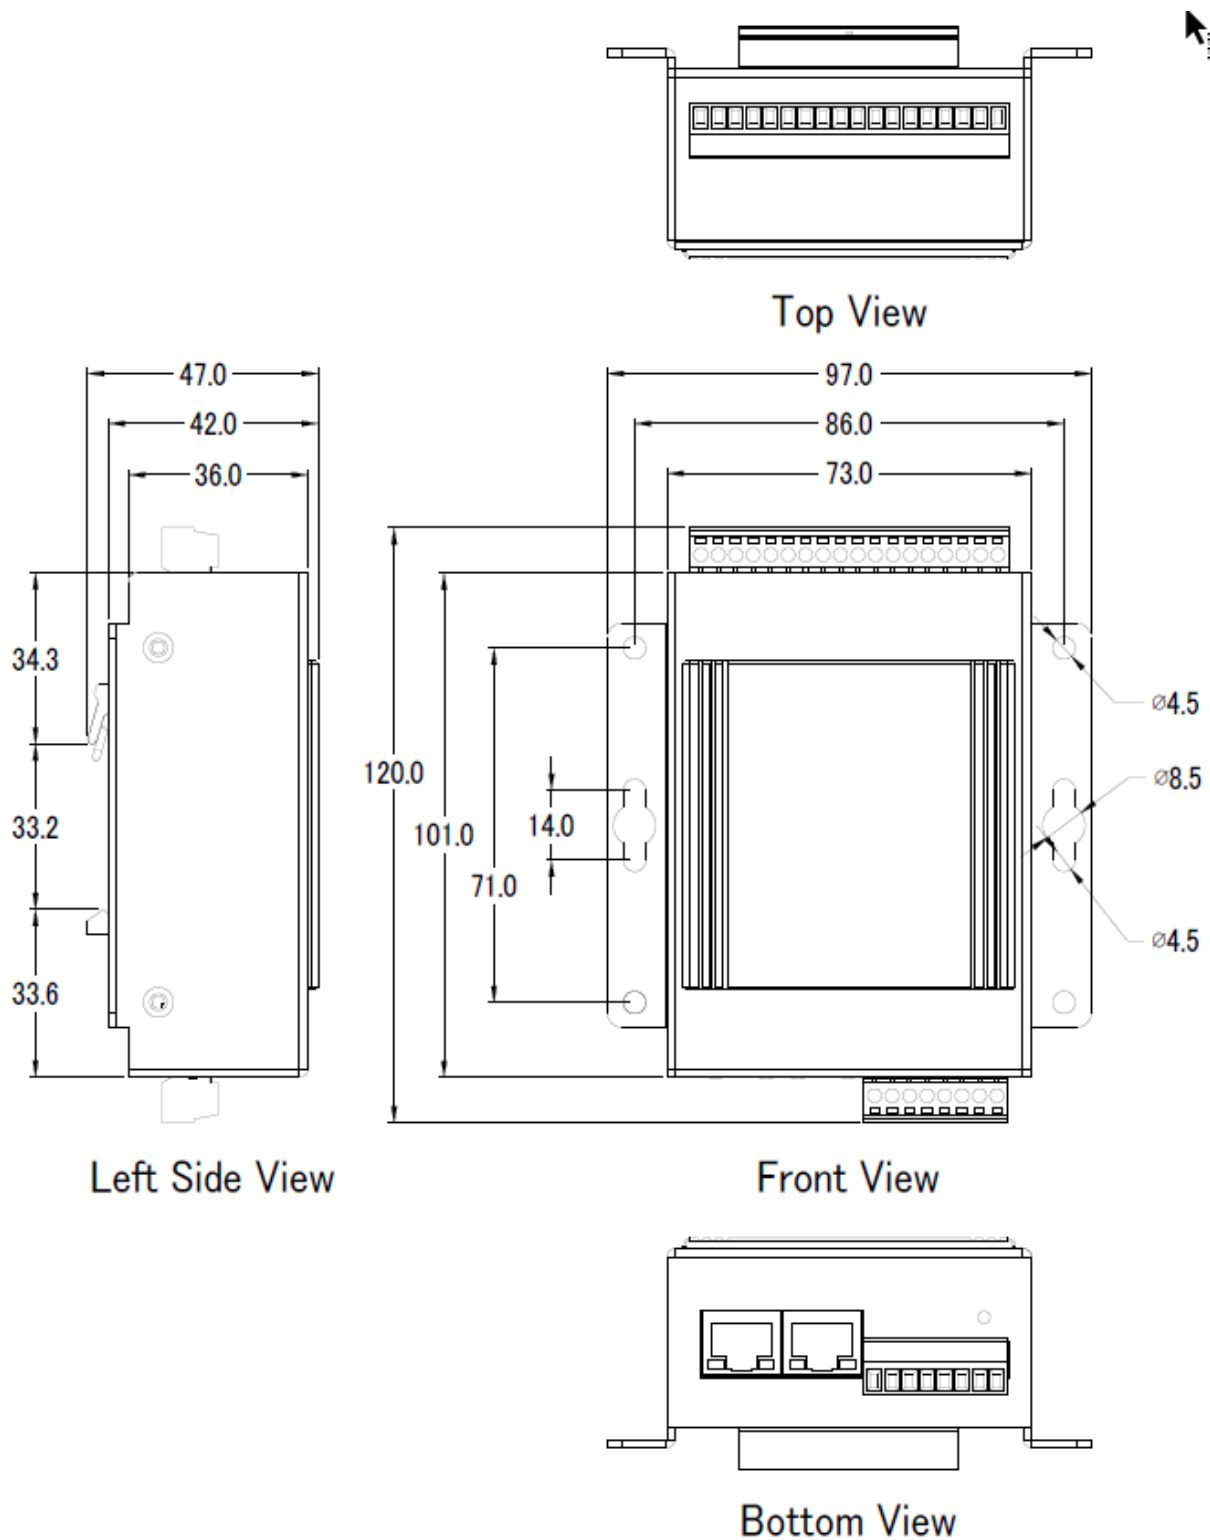


## U-7518ZM/U-7519ZM Dimensions


(Unit: mm)

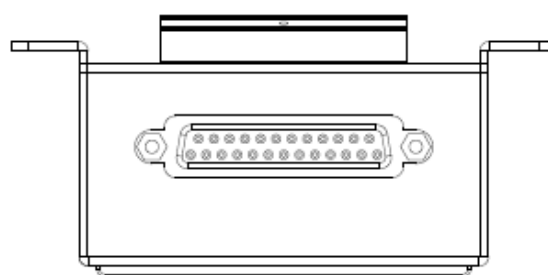


Top View

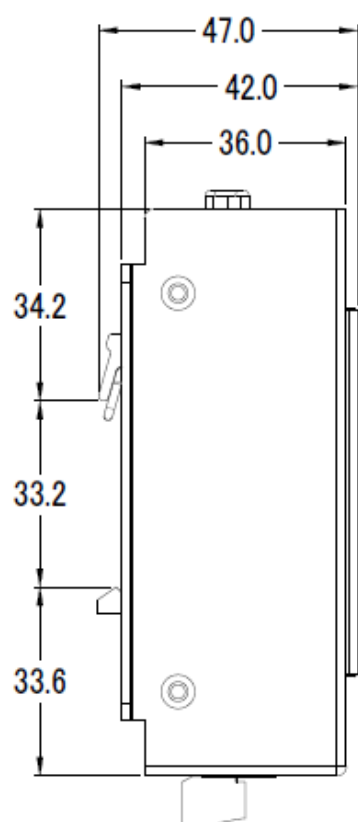

Left Side View

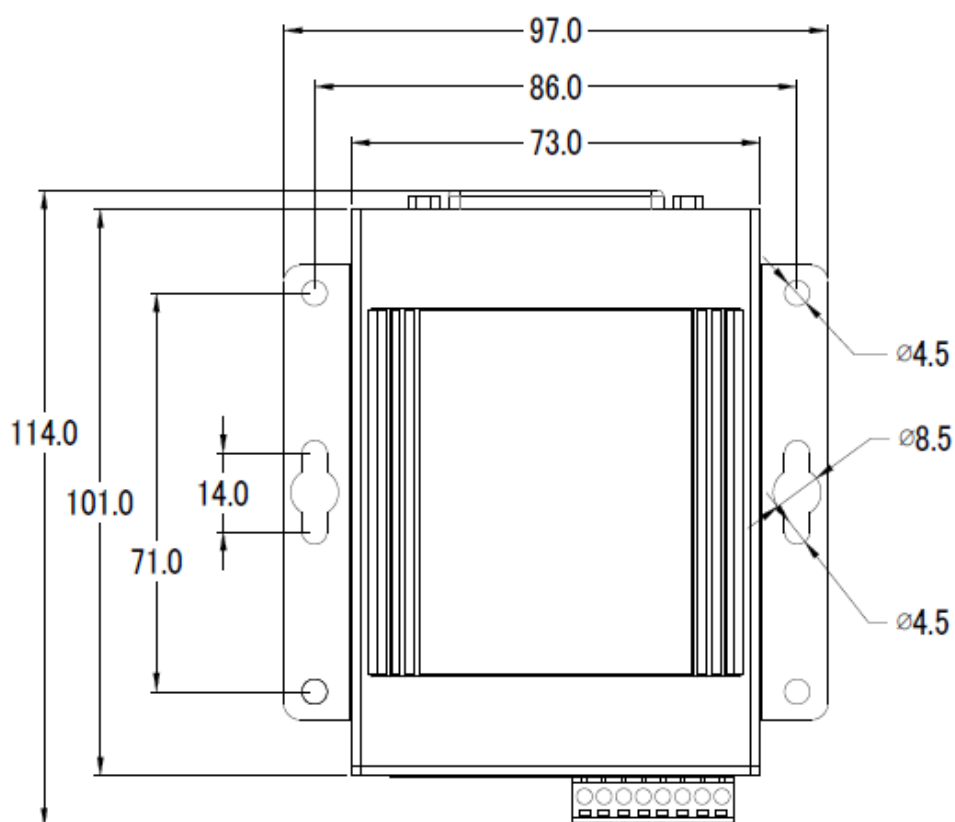

Front View

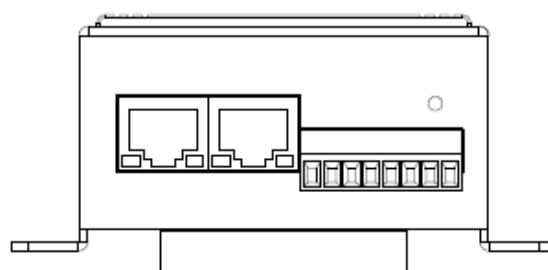

Bottom View

## 2. Quick Start: Hardware/Network Connection

This chapter describes the UA I/O module's hardware connection, network connection and quick setting. For how to set up a project via the Web UI on the browser, please refer to Chapter 3.

### 2.1. Hardware Connection

This section describes the hardware wiring and connection for the UA I/O module.

#### 2.1.1. Preparations for Devices

In addition to the UA I/O modules (Ex: U-7555M), please prepare the following:

1. **PC/NB:** Can connect to the network and set the network
2. **Ethernet Switch/Hub:** e.g. NS-205 or **PoE Switch** NSM-208SE
3. **Power Supply:** +12 ~ +48 VDC, e.g. MDR-60-24 (If using PoE Switch, user can save a power supply.)


#### 2.1.2. AI/AO Jumper Setting

This section is for setting the AI/AO jumpers, take U-7504M, U-7526M for example, if use DI/O module, please go to the next section.

##### Setting the Selection Jumpers for Analog channels:

1. **Disconnect the power, remove the top case and upper board** of the module if need to change the selection jumper, the selection jumpers are next to the connector.
2. Set up the **Jumper** corresponding to the type of **voltage/current and input/output** for each analog channel.

**Voltage/Current Input/output Selection Jumper: (Default as AI/AO: Voltage/Voltage)**

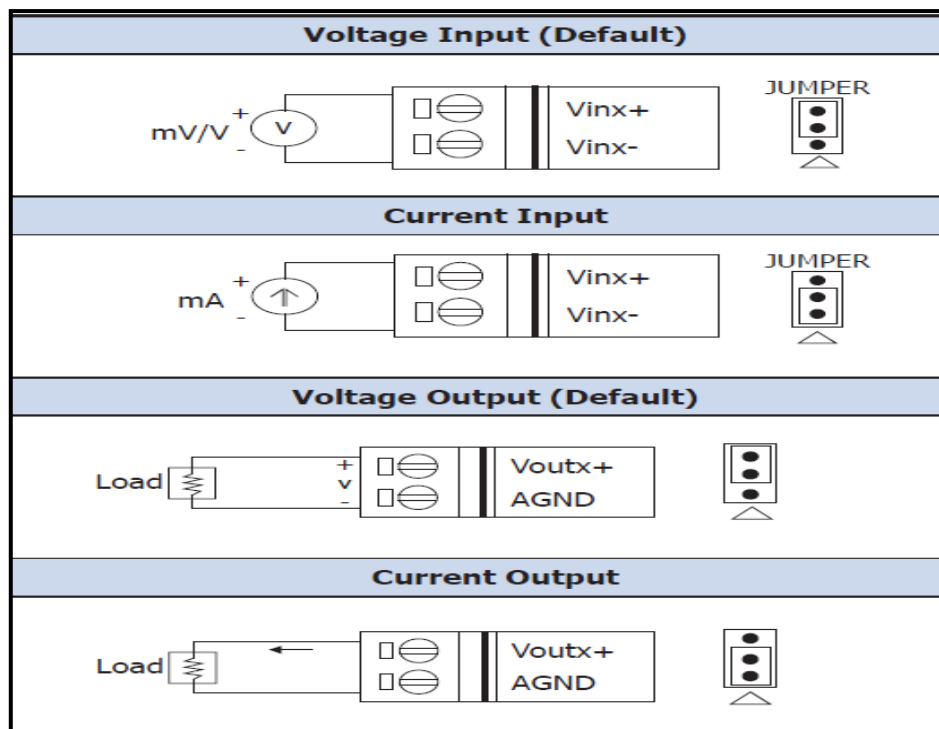



# **Jumper Location:**


U-7504M								
Channel	Vin3	Vin2	Vin1	Vin0	Vout3	Vout2	Vout1	Vout0
Jumper	J4	J3	J2	J1	J8	J7	J6	J5

U-7526M								
Channel	Vout1	Vout0	Vin5	Vin4	Vin3	Vin2	Vin1	Vin0
Jumper	J8	J7	J6	J5	J4	J3	J2	J1

Jumper Direction





**(Jumpers default as:**  
 Input: Voltage  
 Output: Voltage.  
  
 If you need to change the  
 jumpers, remove the top case  
 and upper board first.)

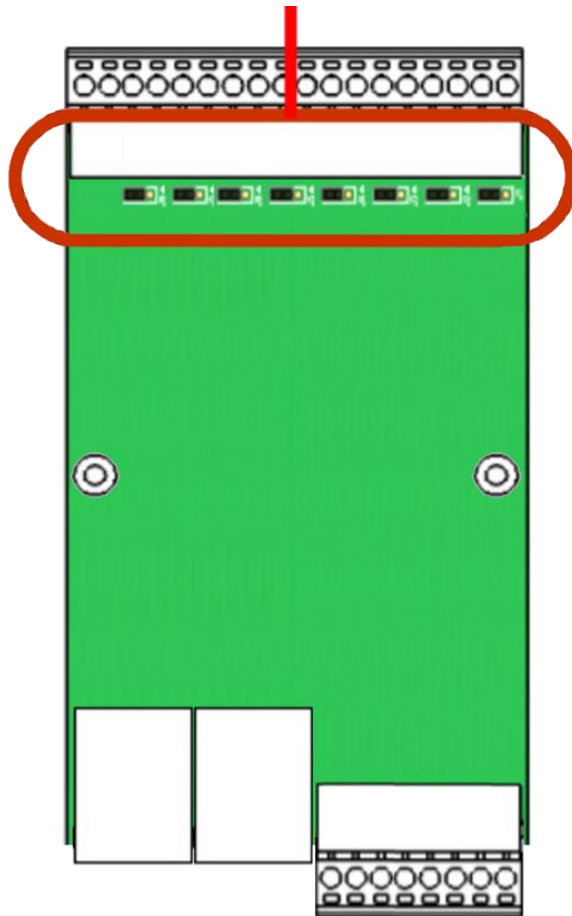

### 2.1.3. Hardware Wiring

Connect the U-7500 I/O Module with the RJ-45 Ethernet port to an Ethernet switch/hub and PC (**Fig.1**). Besides, U-7500 support PoE (Power over Ethernet). If using the PoE switch, do not need one more power supply (**Fig.2 for PoE Switch**). You can also directly link the U-7500 to the PC with an Ethernet cable.

After power is connected, please **【wait 1 minute】** for U-7500 start-up procedure. When the "RUN" light starts flashing, it represents the boot is complete.

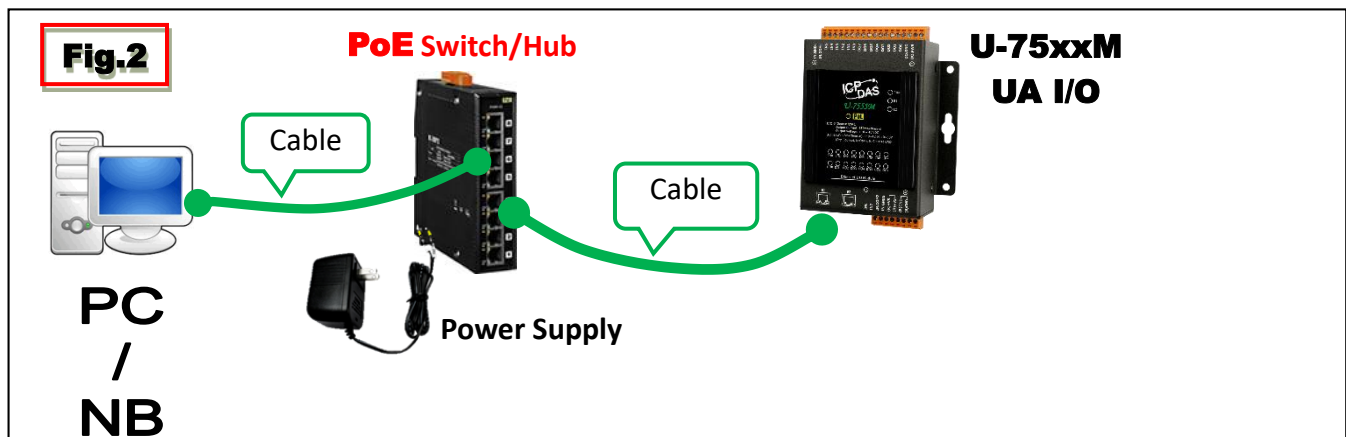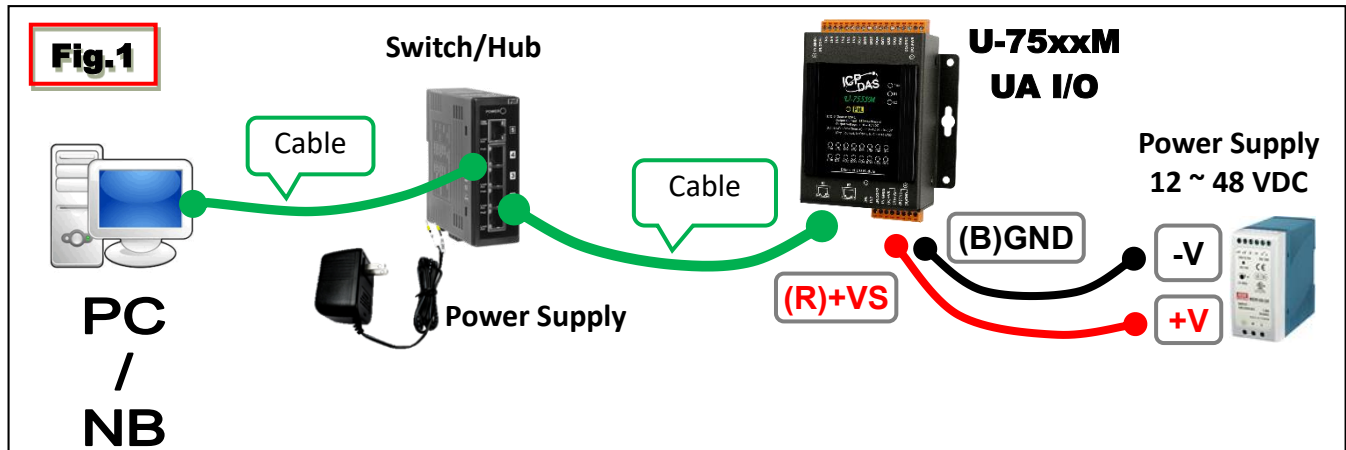

## 2.2. Network Connection

This section introduces 3 methods to connect to the **UA I/O Web UI** (User Interface).

Setting **new UA I/O module or the new user** please uses **method A** in **Chapter 2.2.1** (The same method as the “UA I/O Quick Start” document.). Other users, please see the following introductions to choose method B or C.

The methods to login the UA I/O Web UI:

### A. Using Factory Default Setting:


Suitable for setting a new UA I/O module and the PC network IP is not in the same domain with UA I/O. This method changes the PC network IP to be the same domain with the network IP of the UA I/O factory default values to login the Web UI. (Refer [Chapter 2.2.1](#))

### B. Using Software Utility:

Suitable for quick setting when many UA I/O are in the network but the IP are unknown. UA products provide a free software utility for auto searching UA products in the network and can quick jump to the login web page of UA. (Refer [Chapter 2.2.2](#))

### C. Using IP Address:

Suitable for the UA has a fixed IP and in the same domain with the PC. If the UA has a fixed IP and in the same domain with the PC, users can directly enter the IP in the address bar of a web browser and log in to the Web UI of the UA. After login the UA I/O Web UI, then can set up the UA project.

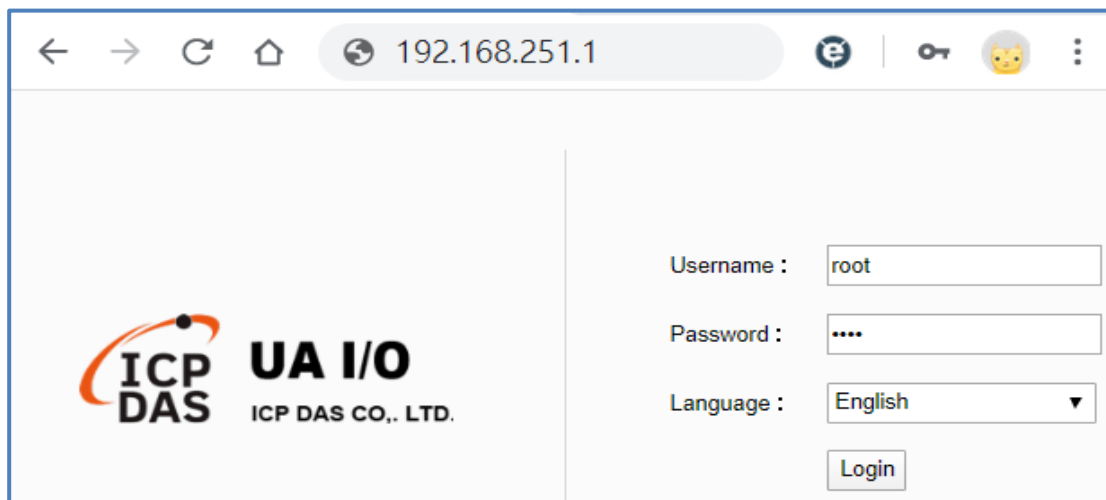

### 2.2.1. Connection by Factory Default Settings (For New UA)

The factory default settings of the UA I/O series are as the following table:


Factory Default Settings of UA I/O Modules			
Network	IP	192.168.255.1	Assign U-7500 a new IP setting according to your case.
	Mask	255.255.0.0	
	Gateway	192.168.1.1	
Web UI Account	Username	root	<b>After the first login, change the default username/password to use other functions.</b>
	Password	root	

1. Change the PC's IP setting as following. (**Write down the PC original network settings before modify.**)

IP	192.168.255.10
Subnet mask	255.255.0.0
Default gateway	192.168.1.1

2. Make sure the PC and UA I/O is connecting through Ethernet. Then open a PC side browser (Ex: Chrome, IE...).

Type `http://192.168.255.1` in the URL address. Use Web UI default username / password "root" / "root" to login the system.

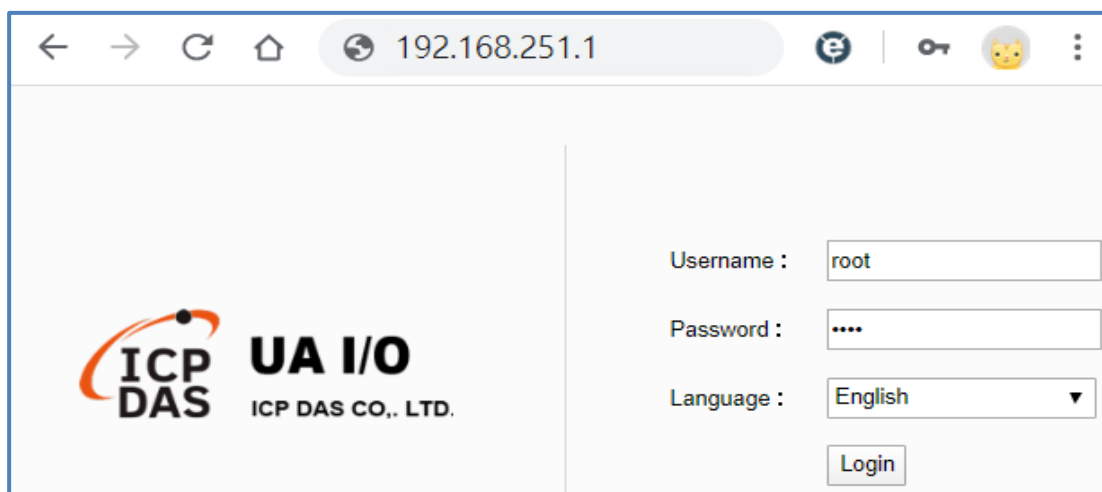

3. Click 【System Setting】 → 【Account Setting】 , change the Username/password first, or user cannot use any other function (New design for data security).

ICP DAS UA I/O ICP DAS CO., LTD.

System Setting Module Setting OPC UA Setting MQTT Setting Adva

Overview  
Network Setting  
Time Setting  
**Account Setting**  
Firmware Setting  
Web Server Setting

### Account Setting

Username	<input type="text" value="root"/>
Password	<input type="password" value="...."/>
Confirm Password	<input type="password" value="...."/>

Save

Password Setting rules:

### Account Setting

Username	<input type="text" value="root"/>
Password	<input type="password" value="..."/>
	<ol style="list-style-type: none"> <li>1. Must not be the same as the account.</li> <li>2. The length must be greater than 6 characters.</li> <li>3. With English uppercase.</li> <li>4. With English lowercase.</li> <li>5. With numbers.</li> </ol>
Confirm Password	<input type="password" value="....."/> <ol style="list-style-type: none"> <li>1. Must not be the same as the account.</li> <li>2. The length must be greater than 6 characters.</li> <li>3. With English uppercase.</li> <li>4. With English lowercase.</li> <li>5. With numbers.</li> </ol>

Save

4. Click **【System Setting】** → **【Network Setting】** → **【Network Setting(LAN1)】** to change the IP setting by user network.

The screenshot shows the 'System Setting' interface with the following details:

- System Setting** (Selected Tab)
- Network Setting (LAN)** (Selected Section)
- Connection Mode:**
  - ☒ Specify an IP address.
  - ☐ Obtain an IP address automatically.(DHCP)
- IP Address:** 192 · 168 · 255 · 102
- Mask:** 255 · 255 · 0 · 0
- Gateway:** 192 · 168 · 1 · 1
- MAC Address:** 00:00:00:00:81:52
- Save** (Button)

5. Save the IP setting, restore the PC original IP settings, and type the new IP in the browser as step-2 to login the Web UI of UA I/O. Then configure user's UA project.

The screenshot shows the web browser interface with the following details:

- Address Bar:** 192.168.255.102
- ICP DAS UA I/O ICP DAS CO., LTD.** (Logo and Text)
- Login Form:**
  - Username :** root
  - Password :** ....
  - Language :** English (Dropdown Menu)
  - Login** (Button)

## 2.2.2. Connection by Utility Searching

Setting new UA I/O or the new user please uses the method in the [Chapter 2.2.1](#). (A)



If the UA I/O has a fixed IP and in the same domain as the PC, users can directly enter the IP in the address bar of a web browser and log in to the Web UI of the UA.I/O (C)

This section introduces the 2nd method(B) that users use the UA I/O Utility to search the Network IP. This method is suitable for connecting multiple UA I/O series modules to the Internet, but the IP addresses of UA I/O are unknown or need to modify the UA I/O quickly.

The Utility is a free tool software to quickly search each UA/BRK/UA\_IO series on the network and connect to its Web UI for setting UA/BRK/UA\_IO series products and projects.

In the PC, download and install the Utility (EZ-UAQ Utility) suitable for your PC, and then run it to connect the device. Please download the utility program from the website:


<https://www.icpdas.com/en/download/show.php?num=8560&nation=US&kind1=&model=&kw=u-7>

EZ-UAQ Utility					
FILE NAME	VERSION	FILE DATE	SIZE	NOTE	
EZ-UAQ Utility-Framework3.5	v1.1.1	2023-03-29	1.68 MB		
EZ-UAQ Utility-Framework4.7	v1.1.1	2023-03-29	1.68 MB		

### 1. Install and execute the Utility

Download and unzip the Utility, double-click the executable file (EZ-UAQ Utility.msi) to install and execute the Utility software.

(If there is an old version of Utility on the PC, please uninstall it first.)

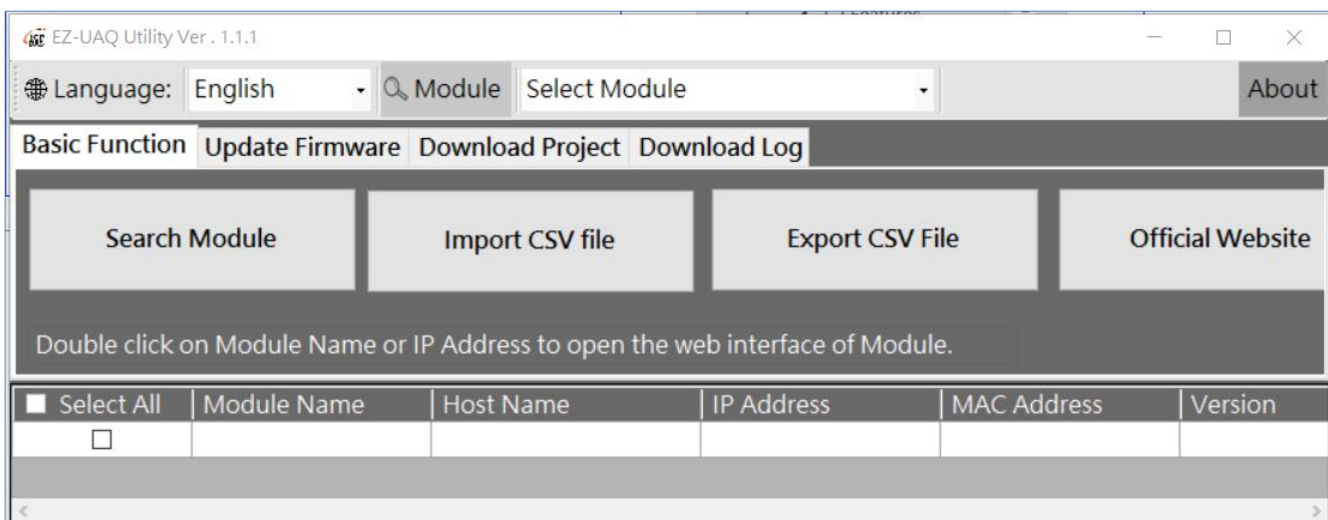

## 2. Search the UA/BRK/UA\_IO series modules

Click the **“Search Module”** button the utility will search and list all UA/BRK/UA\_IO modules in the network.

Language: English | Module: Select Module

Basic Function | Update Firmware | Download Project | Download Log

Search Module | Import CSV file | Export CSV File | Official Website

Double click on Module Name or IP Address to open the web interface of Module.

Select All	Module Name	Host Name	IP Address	MAC Address	Version
<input type="checkbox"/>	UA-5231	UA-Series-a81087a9...	192.168.1.89	a8:10:87:a9:19:62	1.4.2.0/ 7.0.0/1.1.8
<input type="checkbox"/>	UA-5231	UA-Series-f4e11e950...	192.168.85.18	f4:e1:1e:95:04:96	1.4.2.0/ 7.0.0/1.1.8
<input type="checkbox"/>	UA-5231	UA-5231	192.168.101.2		
<input type="checkbox"/>	BRK-2841M	icpdas	192.168.84.60	00:0d:e0:18:2b:01	1.0.0.0
<input type="checkbox"/>	U-7526M	000de018206f7000	192.168.81.250	00:0d:e0:18:20:6f	0.0.0.0 / 10.7
<input type="checkbox"/>	U-7526M	000de01820417000	192.168.102.1	00:0d:e0:18:20:11	8.1.0.0 / 10.7
<input type="checkbox"/>	U-7504M	000de0b0f0027000	192.168.81.61	00:0d:e0:18:21:07	8.1.1.0 / 9.7
<input type="checkbox"/>	U-7555M	000de01820017000	192.168.85.17	00:0d:e0:18:20:01	9.1.4.0 / 11.7
<input type="checkbox"/>	U-7555M	000de01820387000	192.168.1.90	00:0d:e0:18:20:38	9.1.4.0 / 9.7

## 3. Connect to the UA I/O Series

Double click the module list (from the Module Name to the IP address) you want to connect to, and it will directly link to the UA/BRK/UA\_IO webpage via the default Web browser (Chrome, Edge, IE...).

Language: English | Module: Select Module

Basic Function | Update Firmware | Download Project | Download Log

Search Module | Import CSV file | Export CSV File | Official Website

Double click on Module Name or IP Address to open the web interface of Module.


Select All	Module Name	Host Name	IP Address	MAC Address	Version
<input checked="" type="checkbox"/>	UA-5231	UA-Series-a81087a9...	192.168.1.89	a8:10:87:a9:19:62	1.4.2.0/ 7.0.0/1.1.8
<input type="checkbox"/>	UA-5231	UA-Series-f4e11e950...	192.168.85.18	f4:e1:1e:95:04:96	1.4.2.0/ 7.0.0/1.1.8
<input type="checkbox"/>	UA-5231	UA-5231	192.168.101.2		
<input type="checkbox"/>	BRK-2841M	icpdas	192.168.84.60	00:0d:e0:18:2b:01	1.0.0.0
<input type="checkbox"/>	U-7526M	000de018206f7000	192.168.81.250	00:0d:e0:18:20:6f	0.0.0.0 / 10.7
<input type="checkbox"/>	U-7526M	000de01820417000	192.168.102.1	00:0d:e0:18:20:11	8.1.0.0 / 10.7
<input type="checkbox"/>	U-7504M	000de0b0f0027000	192.168.81.61	00:0d:e0:18:21:07	8.1.1.0 / 9.7
<input type="checkbox"/>	U-7555M	000de01820017000	192.168.85.17	00:0d:e0:18:20:01	9.1.4.0 / 11.7
<input type="checkbox"/>	U-7555M	000de01820387000	192.168.1.90	00:0d:e0:18:20:38	9.1.4.0 / 9.7



#### 4. Connection to the UA I/O Web UI

The default web browser will be run and direct go to the UA login web site.  
Please enter the username and password to login the UA I/O series Web UI.


The factory default username: root. The factory default password: root. After login in, change the default Username/password first, or user cannot use any other function (New design for data security).

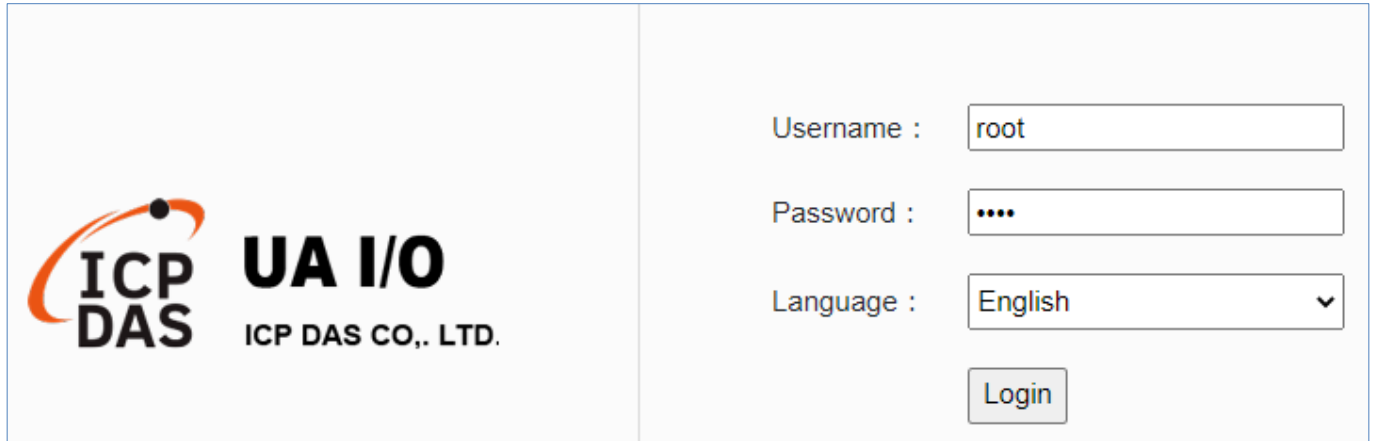

The login form features the ICP DAS UA I/O logo on the left. On the right, there are three input fields: 'Username' with the value 'root', 'Password' with masked characters '....', and 'Language' with a dropdown menu set to 'English'. A 'Login' button is positioned below the language dropdown.

#### 5. Login the Web UI of the UA I/O Series

When login into the web interface, the UA I/O default home page (the main configuration screen) will as below, and will automatically read setting of that UA I/O to the webpage.

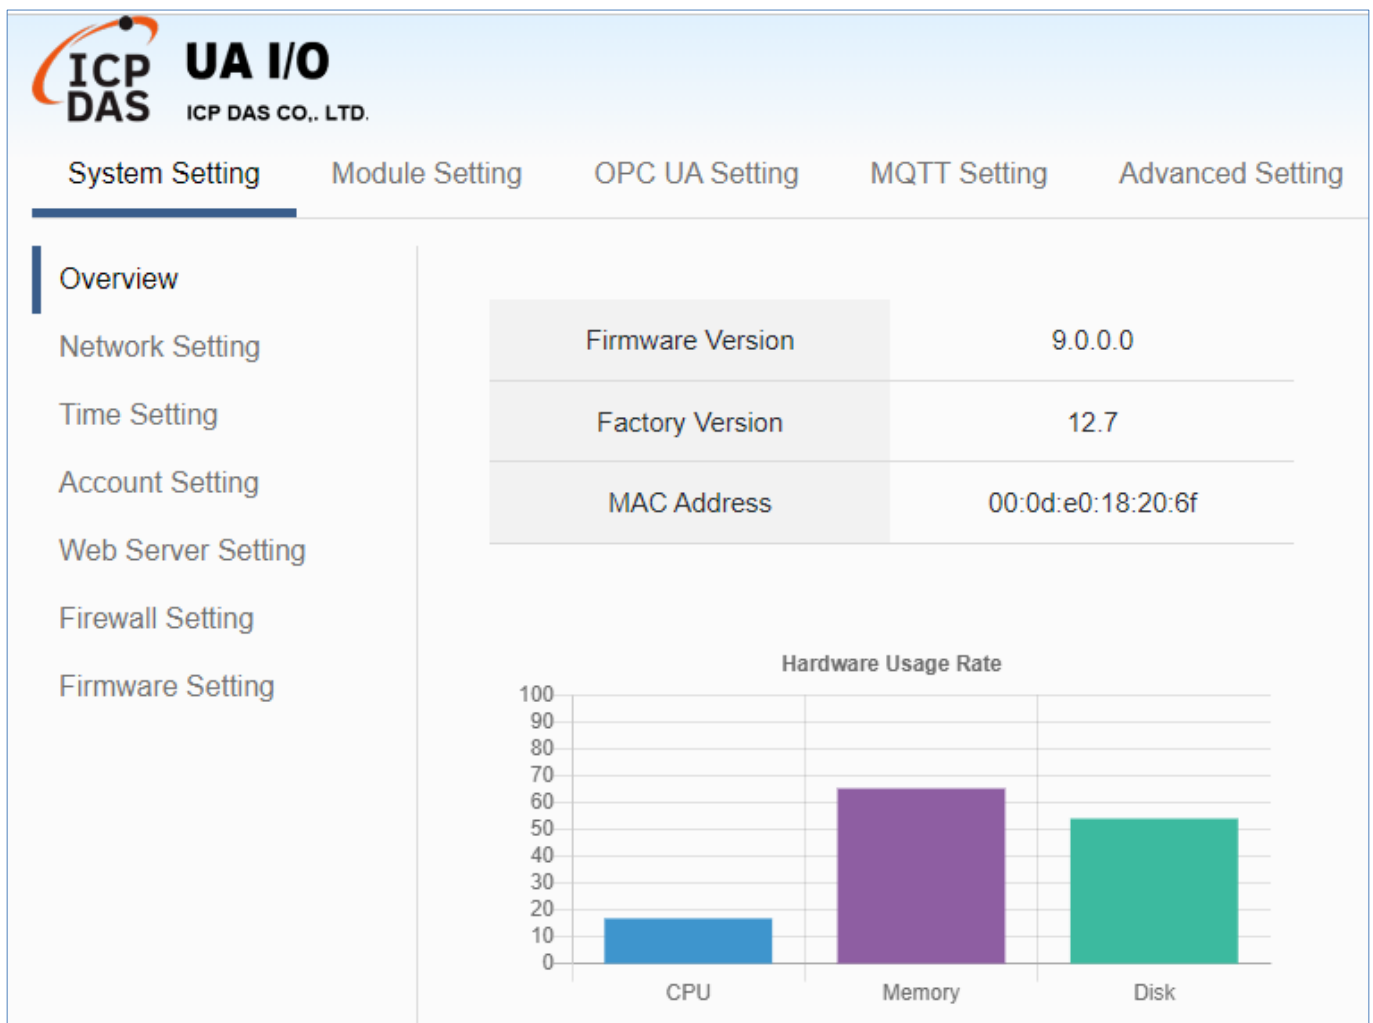

The main configuration screen displays the ICP DAS UA I/O logo and a navigation menu with tabs: System Setting, Module Setting, OPC UA Setting, MQTT Setting, and Advanced Setting. The 'System Setting' tab is active, showing a left sidebar with links to Overview, Network Setting, Time Setting, Account Setting, Web Server Setting, Firewall Setting, and Firmware Setting. The main content area shows system information in a table and a hardware usage rate bar chart.

Firmware Version	9.0.0.0
Factory Version	12.7
MAC Address	00:0d:e0:18:20:6f

**Hardware Usage Rate**

Component	Usage Rate (%)
CPU	18
Memory	65
Disk	55

### 3. Main Function Settings


This chapter introduces some of the most important and commonly used functions of UA I/O and their setting steps.

**OPC UA I/O modules** is a series of Ethernet I/O modules that built-in with the **OPC UA Server / Client, MQTT Client and RESTful API services**. The OPC UA I/O module, also called UA I/O or U-7500, supports the OPC UA Server, MQTT Client and RESTful API function in industrial networking communication. Users can choose the networking mode according to their needs and environment, to transmit the values of built-in I/O channels to the cloud IT system or field control system for reading and writing. So, the main functions are the OPC UA connection and the MQTT connection. This chapter will introduce them first. Each function can be divided into the settings for the Server/Broker and Client, and how to enable secure encrypted communication, and how to download/upload the secure certificates. In addition, the AI/AO, DI/DO function applications are also very important for the UA I/O, which will be added to this chapter soon.

#### OPC UA / MQTT Communication Advantages: (V.S. traditional Modbus Communication)


##### Support Identity Authentication

Identity Authentication			
ICP DAS UA Solution	OPC UA	ID/Password, Anonymous, Certificate	Yes ✓
	MQTT	ID/Password, Anonymous	
Traditional	Modbus	None	

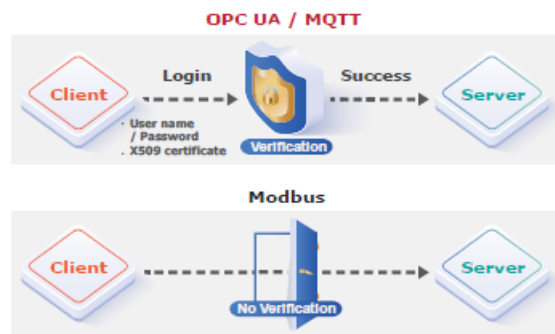


##### Support Data Encryption

Data Encryption			
ICP DAS UA Solution	OPC UA	SSL/TLS Encryption	Yes ✓
	MQTT	SSL/TLS Encryption	
Traditional	Modbus	None	

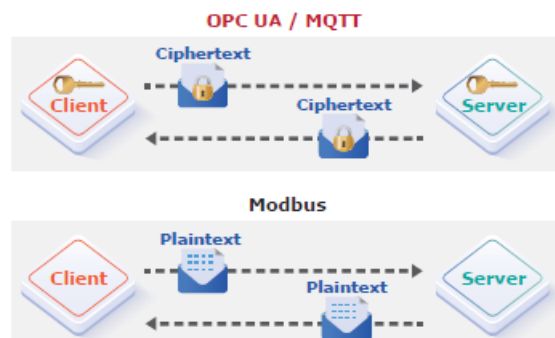

##### Active Data Transmission

Data Transmission			
ICP DAS UA Solution	OPC UA	Active (Server sends Data to the Client)	Active ✓
	MQTT	Active (Client publishes Data to Broker, and the Broker sends Data to other Clients)	
Traditional	Modbus	Passive (Request/Response (Wait for Master to poll the Data))	

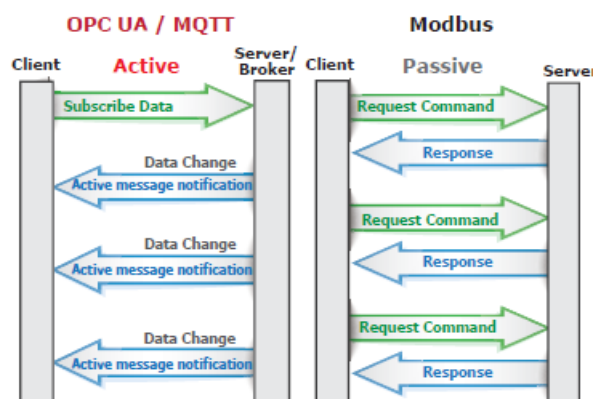

## 3.1 Settings for Using OPC UA Connection

This section introduces how to set up the OPC UA communication service of UA I/O, and recommends compatible ICP DAS products.

**UA I/O module built-in OPC UA Server Service** that compliance with IEC 62541 Standard. Provides functions of Active Transmission, Transmission Security Encryption (SSL/TLS), User Authentication (X.509 Certificates / Account password), Communication Error Detection and Recovery, etc. to connect SCADA or OPC UA Clients. Recommend to keep the maximum number of sessions within 3 connections.

**OPC UA connection includes the following settings that will be introduced in 3 sub-sections.**

1. OPC UA Server Connection Settings (UA I/O)
2. OPC UA Client I/O Settings (Recommend to use the AVEVA Edge/ InduSoft product of ICP DAS.)
3. How to enable secure encrypted function, and download/upload the encrypted certificates

### OPC UA Architecture and Advantages of the UA I/O:

#### OPC UA Architecture



### Comparison: ICP DAS UA I/O Module v.s. Traditional I/O Module

Item	ICP DAS UA I/O Module		Traditional I/O Module
Protocol	OPC UA Server	MQTT Client	Modbus TCP Slave
Identity Authentication	Account ID/Password, Anonymous, Certificate Verification	Account ID/Password, Anonymous, Certificate Verification	None
Encryption	SSL/TLS, Anonymous	SSL/TLS, Anonymous	None
Data Transmission	Active (Actively sends Data to the Client)	Active (Actively publishes Data to Broker, and the Broker sends Data to other Clients)	Passive (Wait for Master to poll the Data: Query/Response)
Project Building	Via browse the Server Content	Via subscribe Topic from Broker	Manually assign an ID and define the Data address and type.

### 3.1.1 OPC UA Server Connection Settings (UA I/O)

UA I/O module built-in OPC UA Server function and itself is the Server side of the connection. So, when setting up the Server, you only need to set the connection port number and choose the login method (via anonymous, username, or certificate). Usually, the user will enable the username login method, so the user can set the username/password of the account besides.



#### 1. Connection Setting

Click Main Menu 【OPC UA Setting】 → 【Server Setting】 → 【Connection Setting】.

The screenshot shows the 'Connection Setting' window. It has a 'Port' field with the value '48010'. Below it are three login methods: 'Anonymous Login', 'Username Password Login', and 'Certificate Login', each with a checked checkbox and the word 'Enable'. At the bottom is a 'Save' button. Three red callout boxes with arrows point to these elements:

- Box 1: Points to the 'Port' field. Text: '1. Enter the port number'.
- Box 2: Points to the login methods section. Text: '2. Enable the login method. For better security, please enable Username Password Login or Certificate Login (refer to 3.1.3).'.
- Box 3: Points to the 'Save' button. Text: '3. Click Save after the above settings.'

#### 2. When enabling username password login, please set the account in the following menu path.

Menu Path: 【System Setting】 → 【Account Setting】  →  (Appendix A).

The screenshot shows the 'Account Setting' window. It has three fields: 'Username' with the value 'root', 'Password' with masked characters '....', and 'Confirm Password' with masked characters '....'. At the bottom is a 'Save' button. Two red callout boxes with arrows point to these elements:

- Box 1: Points to the Username, Password, and Confirm Password fields. Text: '1. Set up username  
2. Set up Password and retype Password'.
- Box 2: Points to the 'Save' button. Text: '3. Click Save after the settings.'


If users enable the secure and encrypted OPC UA **Certificate Login** and need to upload/download certificates, please refer to [Sec.3.1.3](#).

After completing the Server connection settings, then set the **Client connection** (refer to [Sec.3.1.2](#)), and then can communicate with each other.

### 3.1.2 OPC UA Client Side: AVEVA Edge Simple Application

After setting the OPC UA Server-side (UA I/O), you only need to configure the OPC UA Client for connection. Now, go to the Client device that connects with UA I/O, and set the corresponding data point. We recommend using ICP DAS InduSoft products as the Client device. It is easier to set up relatively and can connect to UA I/O faster. For detailed settings, please refer to UA I/O FAQ-Dev-001.



The setting screen is as follows:

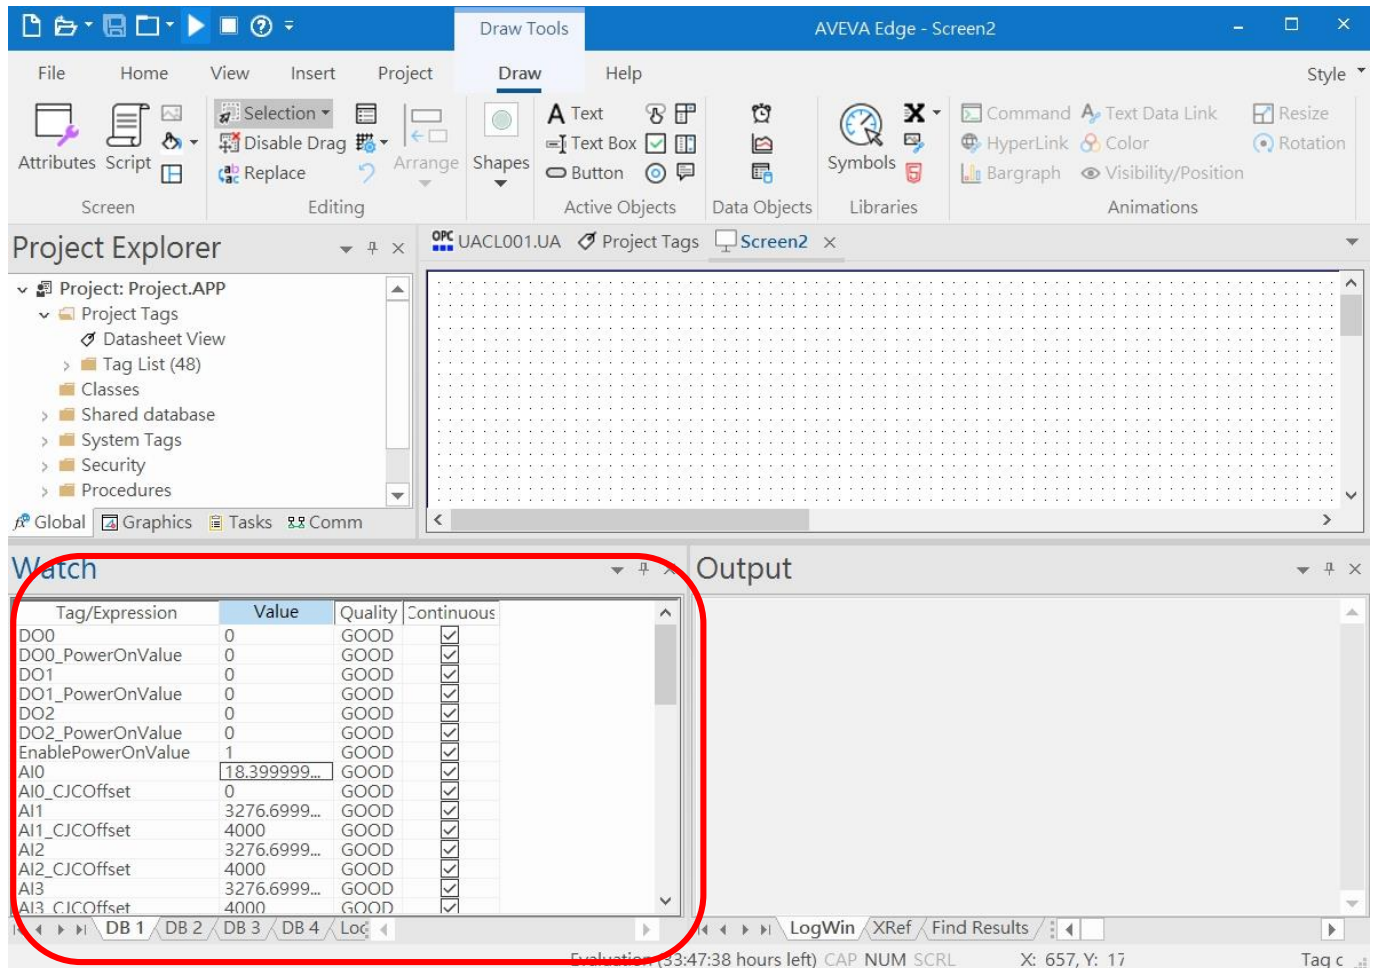

### 3.1.3 Secure Encrypted Connection: OPC UA Certificate

When using the OPC UA connection, in addition to the account login for security, users can also enable the certificate login to double the protection by the secure encryption. This section describes how to download/upload the certificates. If you do not want to enable the certificate login, please skip.


When enabling the OPC UA certificate login, the Server/Client both sides of the connection need to add certificates to each other's trust zones. This section will show how to do the steps.


**Menu Path:** 【OPC UA Setting】 → 【Certificate】 •  →  (Appendix A).

- A. **Provide the OPC UA Server Certificate of the UA I/O** to the Client device. That is, download the Server certificate file of the UA I/O, and then upload and import it into the software (or APP) of the OPC UA Client device.

Click the "Download" button to get the Certificate file generated by the Server.  
File Name: icpdasuaserver.der

Download the file from device

Server Certificate 




Import this file into OPC UA Client APP.


- B. **Get the Trusted Certificate file of the connected OPC UA Client**, save it in the PC, and upload it into the UA I/O module.

- 1) Click the "Upload" button to open the "open" window.

Upload the file to the device

Client Trusted Certificate 

- 2) Select the Trusted Certificate file.

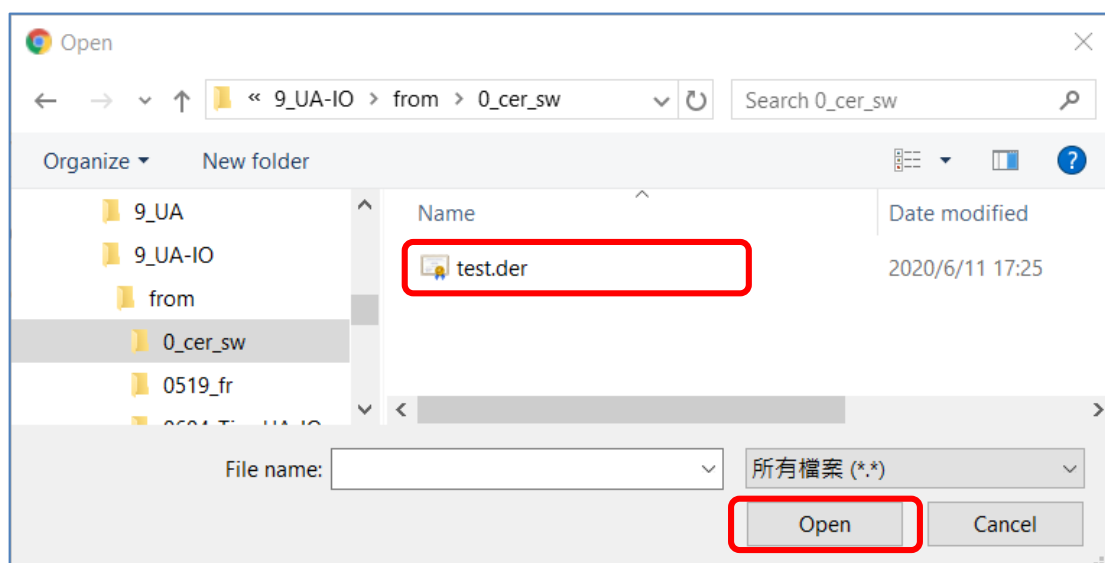



## 3.2 Settings for Using MQTT Connection

This section introduces how to set up the MQTT Client communication of UA I/O, and recommends the compatible ICP DAS products.

**UA I/O module built-in MQTT Client Service** (Compliance with MQTT V.3.1.1 protocol). Provides functions of IoT Active M2M Transmission, QoS (Quality of Service), Retains Mechanism, Identity Authentication, Encryption, Last Will, etc.

**MQTT connection includes the following settings that will be introduced in 3 sub-sections.**

1. MQTT Broker Connection Settings (Recommend the UA-2xxx/52xx & BRK series of ICP DAS)
2. MQTT Client side I/O Settings (UA I/O)
3. How to enable secure encrypted function, and download/upload the encrypted certificates

### MQTT Architecture and Advantages of the UA I/O:

#### MQTT Architecture





### Comparison: ICP DAS UA I/O Module v.s. Traditional I/O Module


Item	ICP DAS UA I/O Module		Traditional I/O Module
Protocol	OPC UA Server	MQTT Client	Modbus TCP Slave
Identity Authentication	Account ID/Password, Anonymous, Certificate Verification	Account ID/Password, Anonymous, Certificate Verification	None
Encryption	SSL/TLS, Anonymous	SSL/TLS, Anonymous	None
Data Transmission	Active (Actively sends Data to the Client)	Active (Actively publishes Data to Broker, and the Broker sends Data to other Clients)	Passive (Wait for Master to poll the Data: Query/Response)
Project Building	Via browse the Server Content	Via subscribe Topic from Broker	Manually assign an ID and define the Data address and type.

### 3.2.1 Connecting to MQTT Broker

UA I/O module built-in MQTT Client function and itself is the Client side of the connection. So, when setting up the MQTT Broker, it is to set the data of the remote device (Broker) that the UA I/O module wants to connect. The data includes Broker's IP address, port number, anonymous login, account password login, etc.

MQTT Broker Device: recommend to use ICP DAS IIoT communication server **UA-2200/5200/2600 series** or MQTT Broker **BRK-2600M/5200M series**.

Main Menu: 【MQTT Setting】 → 【Connection Setting】  →   
(Appendix A).

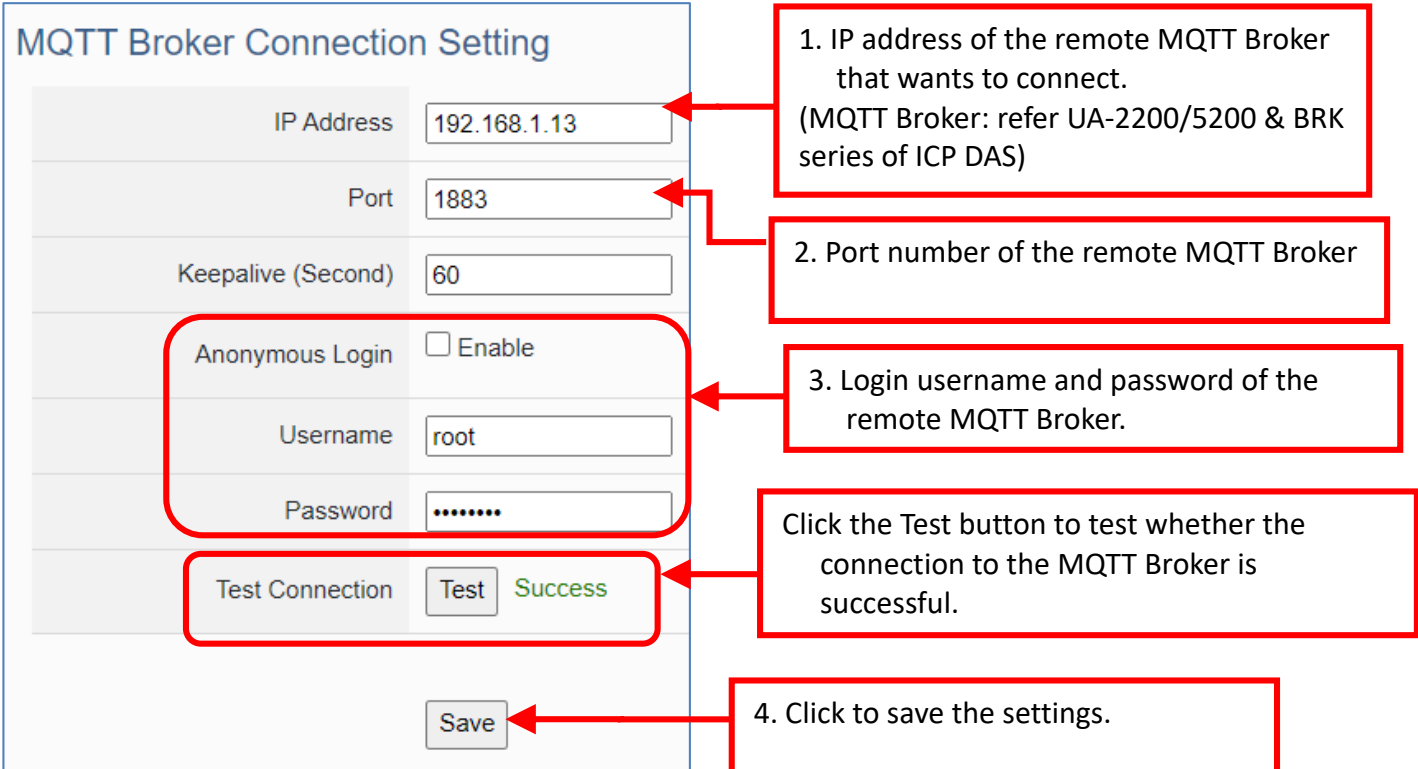

The screenshot shows the 'MQTT Broker Connection Setting' window. It contains several input fields and buttons. Red boxes and arrows highlight specific elements, numbered 1 through 4:

- 1.** IP address of the remote MQTT Broker that wants to connect. (MQTT Broker: refer UA-2200/5200 & BRK series of ICP DAS)
- 2.** Port number of the remote MQTT Broker
- 3.** Login username and password of the remote MQTT Broker.
- 4.** Click to save the settings.

Additional details from the interface:

- The 'IP Address' field contains '192.168.1.13'.
- The 'Port' field contains '1883'.
- The 'Keepalive (Second)' field contains '60'.
- The 'Anonymous Login' checkbox is unchecked.
- The 'Username' field contains 'root'.
- The 'Password' field contains masked characters '.....'.
- The 'Test Connection' section shows a 'Test' button and a 'Success' status.
- The 'Save' button is at the bottom.

If users enable the secure and encrypted MQTT **Certificate Login**, need to upload/download certificates, please refer to [Sec.3.2.3](#).

After completing the MQTT Broker connection settings, then set the **Client connection** (refer to [Sec.3.2.2](#)), and then can communicate with each other.




### 3.2.2 MQTT Client Setting of the UA I/O

UA I/O built-in MQTT Client function and itself is the MQTT Client side of the connect. When setting, please set the connecting remote MQTT Broker device first, and then set the UA I/O module of the MQTT client.

#### Reference for MQTT related basic knowledge:

**MQTT** (MQ Telemetry Transport) is a lightweight **publish/subscribe** messaging protocol. An MQTT-based application will include two or **more clients**, which are applications exchanging messages, and **a broker**, which is a server that accepts incoming messages and routes them to the appropriate destination client. As with most *publish-subscribe* systems, message sends involve **publishing** on a specified **topic**. The **broker** then forwards the message to all **subscribers** of that topic. These primitives can be used to build different interaction patterns. (as the picture below)

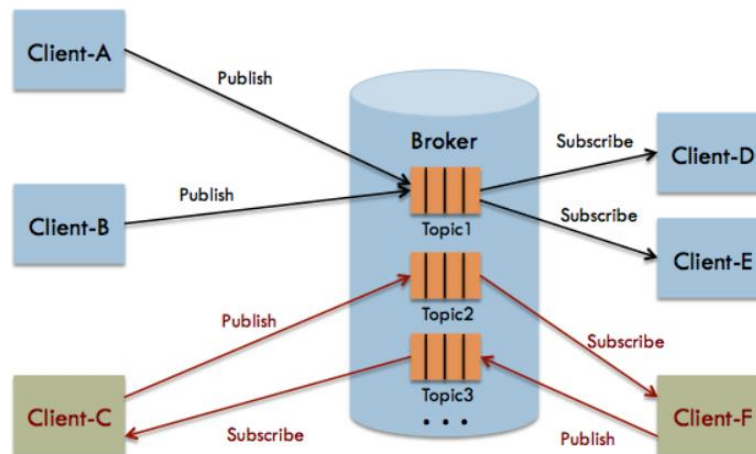

MQTT gives you flexibility by specifying a *Quality of Service* (QoS) with each message. QoS is a parameter available on each publish call. It is one of three levels:

- QoS 0: At most once
- QoS 1: At least once
- QoS 2: Exactly once

Provides a Quality-of-Service data delivery: QoS can be selected based on the needs of the application.

MQTT Retained messages: The last published message (with retained flag set to true) is stored at the broker so that new subscribers can immediately obtain last known good value rather than wait for the next update from publisher.

REFERENCES: (The above information is from the following websites.)

<https://micropython-iot-hackathon.readthedocs.io/en/latest/mqtt.html>

<https://devopedia.org/mqtt>

## MQTT Client Setting of the UA I/O:

Manu Path: 【MQTT Setting】 → 【Client Setting】 MQTT Setting → Client Setting (Appendix A).

### Content Setting

Scan Rate(ms)	<input type="text" value="1000"/>
Dead Band	<input type="text" value="0"/>
Will Topic	<input type="text"/>
Will	<input type="text"/>
JSON Format	<input checked="" type="checkbox"/> Enable

1. Set an update frequency for the task data.  
Default: 1000 (Unit: ms)
2. The default value is 0, which means that any data changes will be published.
3. Enter a title of the disconnect notice.
4. Enter a disconnect notice.
5. Check "Enable", the message is sent in groups.  
Uncheck "Enable", the message is sent in singly.

### Enable of JSON Format: Descriptions for the **Enable (check "Enable")** / **Disable (uncheck "Enable")**

- **Enable:** Enter the Group setting screen, the Publish & Subscribe message is sent in a group.  
**Group setting (JSON Format)** the Publish & Subscribe: Suitable for obtaining all I/O values at one time, it can reduce network resources. It will pack all I/O point values into a JSON string, and then send the JSON string as a message or subscribe JSON string to get all I/O values back at one time. (Refer to [Appendix B](#) for the detailed JSON format)
- **Disable:** Enter the Singly setting screen, the Publish & Subscribe message is sent in singly (P to P).  
**Singly setting (Point-to-point)** the Publish & Subscribe: Suitable for I/O points that require high real-time performance, or devices that do not support generating or parsing JSON format.

### Content Setting

Scan Rate(ms)	<input type="text" value="1000"/>
Dead Band	<input type="text" value="0"/>
Will Topic	<input type="text"/>
Will	<input type="text"/>
JSON Format	<input checked="" type="checkbox"/> Enable

JSON Format ☐ Enable

#### Publish & Subscribe

Details ☒ Unfold

Channel	Publish Topic	Publish QoS	Subscribe Topic	Subscribe QoS	Retain
DO0	/U-7526M/DO0/Publish	2	/U-7526M/DO0/Subscribe	2	<input type="checkbox"/>
DO1	/U-7526M/DO1/Publish	2	/U-7526M/DO1/Subscribe	2	<input type="checkbox"/>
DI0	/U-7526M/DI0/Publish	2		2	<input type="checkbox"/>
DI1	/U-7526M/DI1/Publish	2		2	<input type="checkbox"/>
Vout0	/U-7526M/Vout0/Publish	2	/U-7526M/Vout0/Subscribe	2	<input type="checkbox"/>
Vout1	/U-7526M/Vout1/Publish	2	/U-7526M/Vout1/Subscribe	2	<input type="checkbox"/>
Vin0	/U-7526M/Vin0/Publish	2		2	<input type="checkbox"/>
Vin1	/U-7526M/Vin1/Publish	2		2	<input type="checkbox"/>
Vin2	/U-7526M/Vin2/Publish	2		2	<input type="checkbox"/>
Vin3	/U-7526M/Vin3/Publish	2		2	<input type="checkbox"/>
Vin4	/U-7526M/Vin4/Publish	2		2	<input type="checkbox"/>
Vin5	/U-7526M/Vin5/Publish	2		2	<input type="checkbox"/>

### Publish & Subscribe

Publish Topic	<input type="text" value="/Name/Publish"/>
Publish QoS	<input type="text" value="2"/>
Subscribe Topic	<input type="text" value="/Name/Subscribe"/>
Subscribe QoS	<input type="text" value="2"/>
Retain	<input type="text" value="False"/>

Disable (Uncheck)

Enable (Check)

The setting parameters for Both enable or disable the JSON Format:

MQTT Setting > Client Setting - Publish & Subscribe	
Publish Topic	The topic of sending data / publishing message.
Publish QoS	The publish Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Subscribe Topic	The topic of receiving data / subscribing message. It can copy the Publish Topic of linked device.
Subscribe QoS	The subscribe Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Retain	Set up if the Broker retains the message.
Save	Click to save the setting of this page.

When **Enable JSON format**, it will pack all I/O point values into a JSON string, and then send the JSON string as a message or subscribe JSON string to get all I/O values back at one time. (Refer to [Appendix B](#))

**Publish & Subscribe**

1. Topic for sending JSON string
2. QoS for sending JSON string
3. Topic for reading JSON string
4. QoS for reading JSON string
5. If Broker retains the message

When **Disable JSON format**, it will publish or subscribe the message in singly (Point-to-point). User needs to set each I/O point.

**JSON Format** ☐ Enable

**Publish & Subscribe**

Details ☒ Unfold

Channel	Publish Topic	Publish QoS	Subscribe Topic	Subscribe QoS	Retain
DO0	/U-7526M/DO0/Publish	2	/U-7526M/DO0/Subscribe	2	<input type="checkbox"/>
DO1	/U-7526M/DO1/Publish	2	/U-7526M/DO1/Subscribe	2	<input type="checkbox"/>
DI0				2	<input type="checkbox"/>
DI1	/U-7526M/DI1/Publish	2		2	<input type="checkbox"/>
Vout0	/U-7526M/Vout0/Publish	2		2	<input type="checkbox"/>
Vout1	/U-7526M/Vout1/Publish	2	/U-7526M/Vout1/Subscribe	2	<input type="checkbox"/>

1. Topic for sending DO0 value
3. Topic for reading DO0 value

● Group Setting example: Check "Enable" of "JSON Format"

Here is an example of the lighting control in a factory. Use the I/O points of the U-7555M module to connect the light switches of Room 1 to 7 in the factory Building-A to monitor/control the on/off of the room lights. We want to use the **Group Setting**, so **check "Enable"** of the **"JSON Format"**. The following is a parameter example for the settings of **[MQTT Setting] > [Client Setting]**.

Content Setting	
Scan Rate(ms)	1000
Dead Band	0
Will Topic	/A/1F/U-7555M
Will	Disconnection
JSON Format	<input checked="" type="checkbox"/> Enable

1. Set the update frequency for the task data (1000 ms)

2. Do not set the Dead Band, so keep 0.

3. Set disconnect Topic for 1F of Building-A (U-7555M)

4. Set Will message: Disconnection

5. **Check** to Enable JSON format to enter the Pub/Sub screen page for Group setting.

The Pub & Sub setting page when enable the JSON Format: Sending/Reading the JSON string

Publish & Subscribe	
Publish Topic	/A/1F/U-7555M/Publish
Publish QoS	2
Subscribe Topic	/A/1F/U-7555M/Subscribe
Subscribe QoS	2
Retain	True
Save	

1. Topic of the publish JSON string:  
/Build-A/1F/U-7555M/all I/O sending data

2. Set QoS to level 2 for publish. 2: exactly once

3. Topic of the subscribe JSON string:  
/Build-A/1F/U-7555M/all I/O reading data

4. Set QoS to level 2 for subscribe. 2: exactly once

5. Check to set the Broker retain the message

6. Save all settings of this page.

**Note:**

When setting the Pub/Sub of MQTT Client, please also set the Nickname of I/O channel, which includes MQTT Nickname and OPC UA Description.

MQTT Client setting should cooperate with MQTT Nickname of the I/O channels for the accuracy/readability of MQTT communication settings.

Menu: **【Module Setting】 > 【I/O Setting】**  
As shown on the right.

Digital Output			
Channel	MQTT Alias	OPC UA Description	Power-on Value
DO0	A-1F-Entrance-door	A-1F-Entrance-door_AA	<input type="checkbox"/>
DO1	A-1F-1R-light-1	A-1F-1R-light-1_Aa12	<input type="checkbox"/>
DO2	A-1F-2R-light-2	A-1F-2R-light-2_Aa12	<input type="checkbox"/>
DO3	A-1F-3R-light-3	A-1F-3R-light-3_Aa12	<input type="checkbox"/>
DO4	A-1F-4R-light-4	A-1F-4R-light-4_Aa12	<input type="checkbox"/>
DO5	A-1F-5R-light-5	A-1F-5R-light-5_Aa12	<input type="checkbox"/>
DO6	A-1F-6R-light-6	A-1F-6R-light-6_Aa12	<input type="checkbox"/>
DO7	A-1F-7R-light-7	A-1F-7R-light-7_Aa12	<input type="checkbox"/>
Save			

● Singly Setting example: Uncheck "Enable" of "JSON Format"

Here is an example of the lighting control in a factory. Use the I/O points of the U-7555M module to connect the light switches of Room 1 to 7 in the factory Building-A to monitor/control the on/off of the room lights. We want to use the **Point-to-Point Setting**, so **uncheck** "Enable" of the "JSON Format". The following is a parameter example for the settings of [MQTT Setting] > [Client Setting].

**Content Setting**

Scan Rate(ms)	1000	1. Set the update frequency for the task data (1000 ms)
Dead Band	0	2. Do not set the Dead Band, so keep 0.
Will Topic	/A/1F/U-7555M	3. Set disconnect Topic for 1F of Building-A (U-7555M)
Will	Disconnection	4. Set Will message: Disconnection
JSON Format	<input type="checkbox"/> Enable	5. <b>Uncheck</b> to Enable JSON format to enter the Pub/Sub screen page for Group setting.

**Publish & Subscribe**

Details ☒ Unfold

IO# Ch.	Channel	1 Publish Topic	2 Publish QoS	3 Subscribe Topic	4 Subscribe QoS	5 Retain
DO0		/A/1F/Entrance-door/Pub	2	/A/1F/Entrance-door/Sub	2	<input checked="" type="checkbox"/>
DO1		/A/1F/light-1/Publish	2	/A/1F/light-1/Subscribe	2	<input checked="" type="checkbox"/>
DO2		/A/1F/light-2/Publish	2	/A/1F/light-2/Subscribe	2	<input checked="" type="checkbox"/>
DO3		/A/1F/light-3/Publish	2	/A/1F/light-3/Subscribe	2	<input checked="" type="checkbox"/>
DO4		/A/1F/light-4/Publish	2	/A/1F/light-4/Subscribe	2	<input checked="" type="checkbox"/>
DO5		/A/1F/light-5/Publish	2	/A/1F/light-5/Subscribe	2	<input checked="" type="checkbox"/>
DO6		/A/1F/light-6/Publish	2	/A/1F/light-6/Subscribe	2	<input checked="" type="checkbox"/>
DO7		/A/1F/light-7/Publish	2	/A/1F/light-7/Subscribe	2	<input checked="" type="checkbox"/>
IN0		/U-7555M/IN0/Publish	2		2	<input checked="" type="checkbox"/>
IN1		/U-7555M/IN1/Publish	2		2	<input checked="" type="checkbox"/>
IN2		/U-7555M/IN2/Publish	2		2	<input checked="" type="checkbox"/>
IN3		/U-7555M/IN3/Publish	2		2	<input checked="" type="checkbox"/>
IN4		/U-7555M/IN4/Publish	2		2	<input checked="" type="checkbox"/>
IN5		/U-7555M/IN5/Publish	2		2	<input checked="" type="checkbox"/>
IN6		/U-7555M/IN6/Publish	2		2	<input checked="" type="checkbox"/>
IN7		/U-7555M/IN7/Publish	2		2	<input checked="" type="checkbox"/>

Save

6. Save all settings.

**Uncheck the JSON Format to do the Point-to-Point singly setting (as the left figure): User needs to set up each Topic/QoS of Publish/Subscribe for each I/O channel.**

1. Set the Publish Topic of DO0 and set each IO#. Topic means: /Building-A/1F/light# of U-7555M/Topic
2. The level of sending Topic for each IO#. level 2: Exactly once
3. Set the Subscribe Topic of DO0 and set each IO#. Topic means: /Building-A/1F/light# of U-7555M/Topic
4. The level of reading Topic for each IO#. level 2: Exactly once
5. Check to set the Broker retain the message

### 3.2.3 Secure Encrypted Connection: MQTT Certificate

When using the MQTT connection, in addition to the account login for security, users can also enable the SSL/TLS login to use the MQTT Certificate protection of the secure encryption. This section describes how to download/upload the certificates. If you do not want to enable the certificate login, please skip.

The settings of MQTT certificate connection need to enable the SSL/TLS secure encryption. And the UA I/O needs to get the certificate of the connecting device first. And then upload the certificates to UA I/O. There are three types of certificates: Trusted Certificate, Certificate, and Private Key.

Please upload the files to the UA I/O module according to the type of certificates:

**To perform the One-way authentication, you need to upload the Trusted Certificate.**

**To perform the Two-way authentication, you need to upload the Trusted Certificate first, and then upload the Certificate and Private Key.**

**Note:**

1. One-way authentication: The Client verifies the validity of Broker credentials; need to upload the Trusted Certificate.
2. Two-way authentication: The Client and Broker verify the validity of the certificate with each other; need to upload the Trusted Certificate first, and then upload the Certificate and Private Key.
3. Trusted Certificate: File format must be PEM. Extension name must be "pem", "cer", or "crt".
4. Certificate: File format must be PEM. Extension name must be "pem", "cer", or "crt".
5. Private Key: File format must be PEM. Extension name must be "key".

**Manu Path:** 【MQTT Setting】 → 【Client Setting】 MQTT Setting → Client Setting ([Appendix A](#)).

**Content Setting**

SSL/TLS ☒ Enable

Save

**Upload the file to the device**

Authentication Two-way Authentication

Trusted Certificate	Upload
Certificate	Upload
Private Key	Upload

### 3.3 RESTful API: Read and Write I/O and Virtual Point

This section describes RESTful API functions and usage. UA I/O supports RESTful API functions. Users can remotely read and write the I/O points (include the virtual point) of UA I/O modules through HTTP.

#### What is Restful API?


**REST** (Representational state transfer) is a software architectural style that was created to guide the design and development of the architecture for the World Wide Web. REST is a widely accepted set of guidelines for creating stateless, reliable web APIs. A web API that obeys the REST constraints is informally described as **RESTful**. **RESTful** web APIs are typically loosely based on HTTP methods to access resources via URL-encoded parameters and transmit data.

#### Use RESTful with UA I/O


Reading and writing the virtual points are the same as that of physical I/O points. Examples:

#### [ Example 1. ]

**IP/AllVariableName** : Define 10 virtual points (all types are AO), and the names all start with VirtualTag (red box in the figure below).

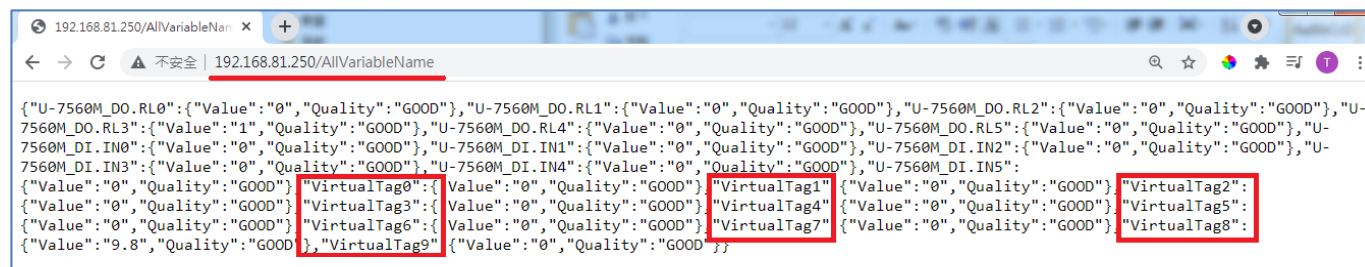


Or as following:

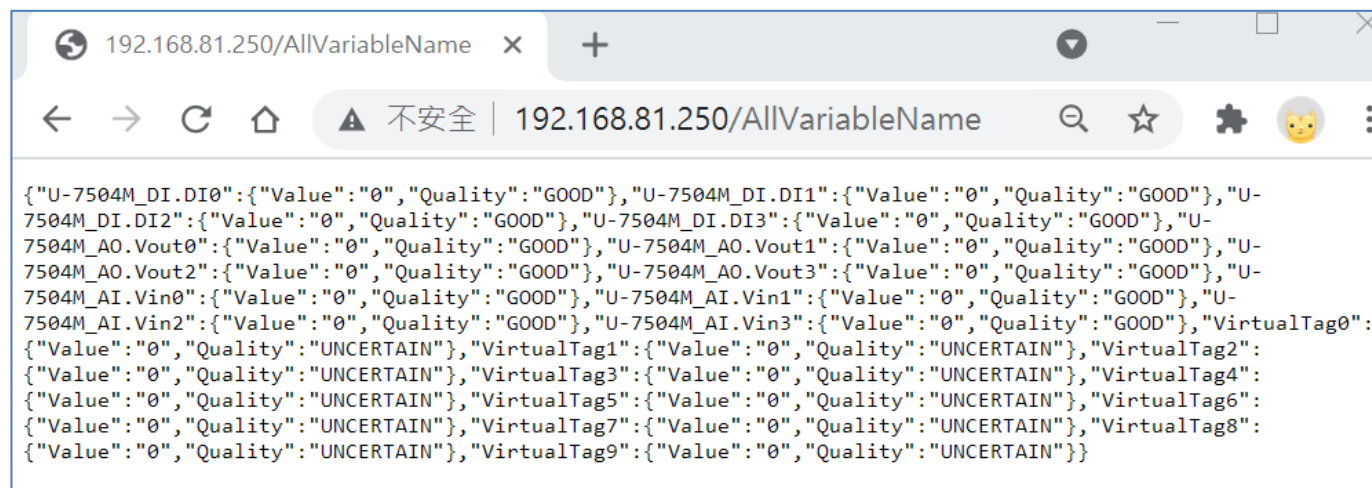




**[ Example 2. ]**

**IP/VariableInformation?VirtualTag0** : RESTful **Read** the value of VirtualTag0

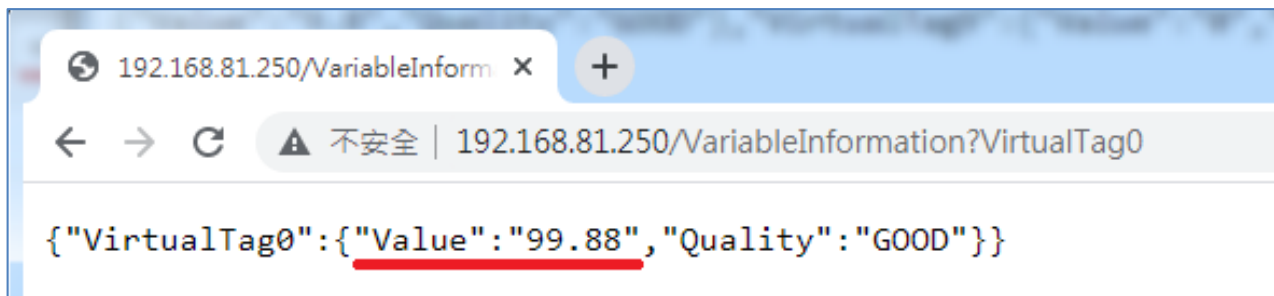


Or as following:

**IP/VariableInformation?U-7504M\_DI.DI0** : RESTful **Read** the DI.DI0 value of U-7504M.

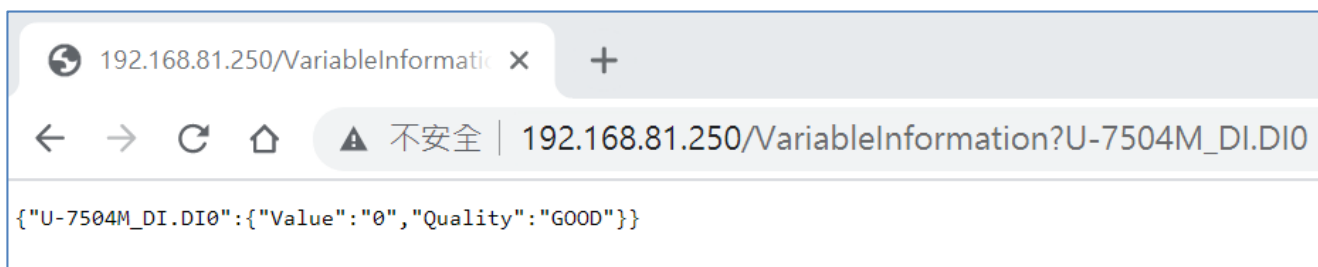**[ Example 3. ]**

**IP/VariableInformation** : RESTful **write** the value of VirtualTag0

This example uses the Firefox as the RESTful client.

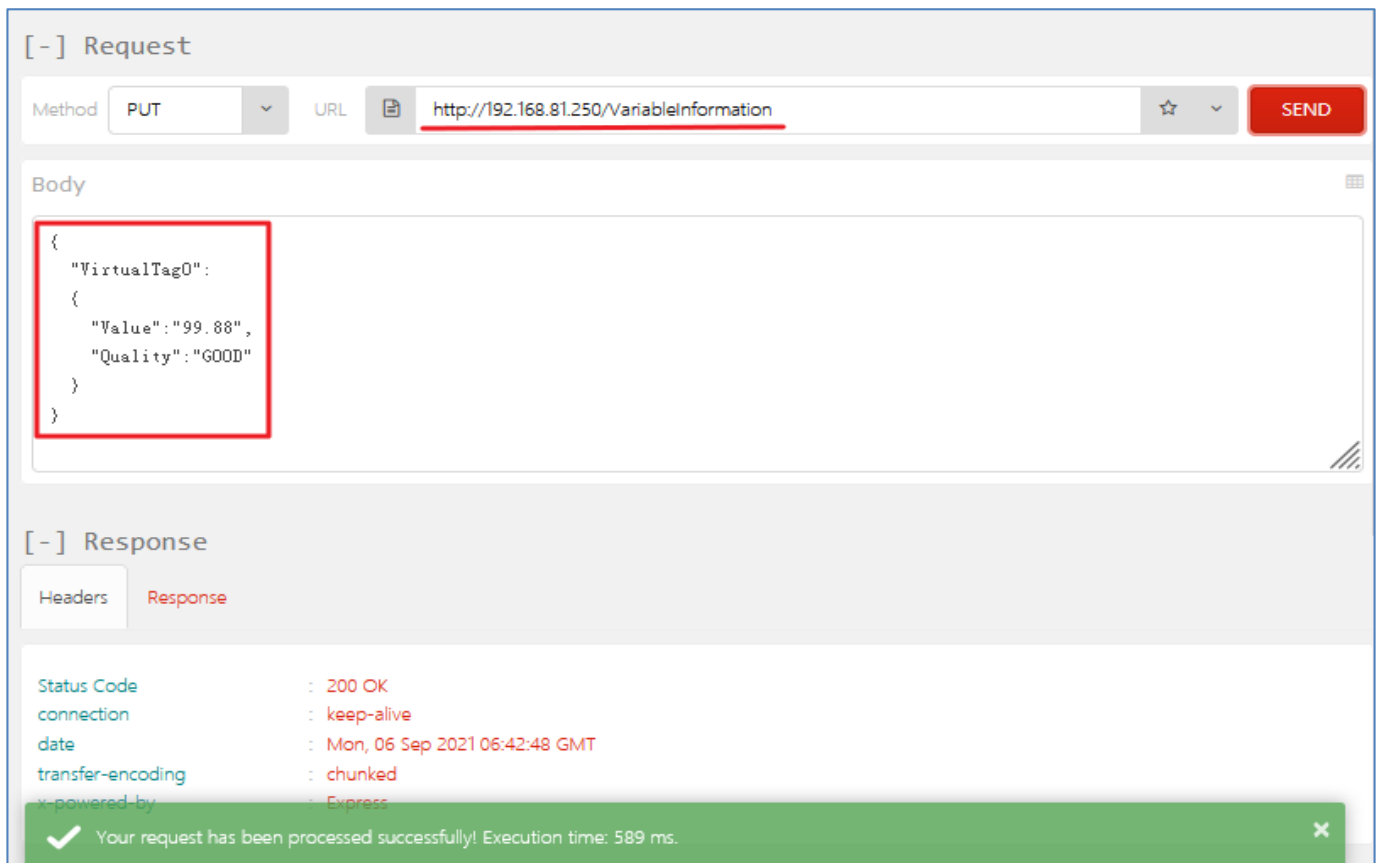



**RESTful Description****[Resource Definition]**

HTTP Method	Path	Description	Remarks
GET	/AllVariableName	Read all variable data.	<a href="#">Link to Example G1.1</a>
	/VariableInformation?var0,var1, var2...	Read the data of var0, var1, var2... in all variables, data are separated by commas.	<a href="#">Link to Example G1.2</a>
PUT	/VariableInformation	writes the variable data being used.	<a href="#">Link to Example P1.1</a>

**[JSON Description]**

JSON Content	Item	Description
<pre>{   "Var1": {     "Quality": "Good",     "Value": "24.5"   },   "Var2": {     "Quality": "Good",     "Value": "24.5"   } }</pre>	Quality	<p>The communication quality of the variable.</p> <p>Return Item: Good, Uncertain, Bad.</p>
	Value	Return the value of the variable.

## [GET Examples]

Resource Definition	Actual Application Corresponding to the Resource Definition
GET /AllVariableName	GET /AllVariableName
Description <a href="#">Back to G1.1</a>	
<p>GET : Read</p> <p>/AllVariableName : All variables</p> <p>For Example :</p> <p>GET /AllVariableName : Read all variable data, and the return value is in JSON format.</p>	
Resource Definition	Actual Application Corresponding to the Resource Definition
GET /VariableInformation?var0, var1, var2...	GET /VariableInformation?U-7560M_DO.RL0,U-7560M_DO.RL1
Description <a href="#">Back to G1.2</a>	
<p>GET : Read</p> <p>/VariableInformation : Variable Information.</p> <p>? : Used to separate the API and the parameters.</p> <p>U-7560M_DO.RL0 : The variable name of the module.</p> <p>U-7560M_DO.RL1 : The variable name of the module.</p> <p>Use "commas" to separate variables.</p> <p>For Example :</p> <p>GET /VariableInformation?U-7560M_DO.RL0, U-7560M_DO.RL1</p> <p>The data of variables such as U-7560M_DO.RL0, U-7560M_DO.RL1. The return value is in JSON format.</p>	

## [PUT Example]



Resource Definition	Actual Application Corresponding to the Resource Definition
PUT /VariableInformation	PUT /var/use  [RAW Body] <pre>{   "Var1": {     "Quality": "Good",     "Value": "24.5"   },   "Var2": {     "Quality": "Good",     "Value": "24.5"   } }</pre>
Description	<a href="#">Back to P1.1</a>
<p>PUT : Write</p> <p>/VariableInformation : Variable Information.</p> <p>[RAW Body] : The JSON format to be written.</p> <p>PUT /VariableInformation : Compare from [RAW Body], check whether the variable name exists on the server side, modify it if it exists, and skip it if it doesn't. The return value is a string.</p>	


## Use RESTful API HTTPS with UA I/O

Before using RESTful API HTTPS, users need to check whether "Https Web Server" has imported the certificate.

If the certificate has not been imported, please open the web interface and switch to the following menu location to upload the certificate.

**Manu Path:**

【System Setting】 → 【Web Server Setting】  →  (Appendix A).

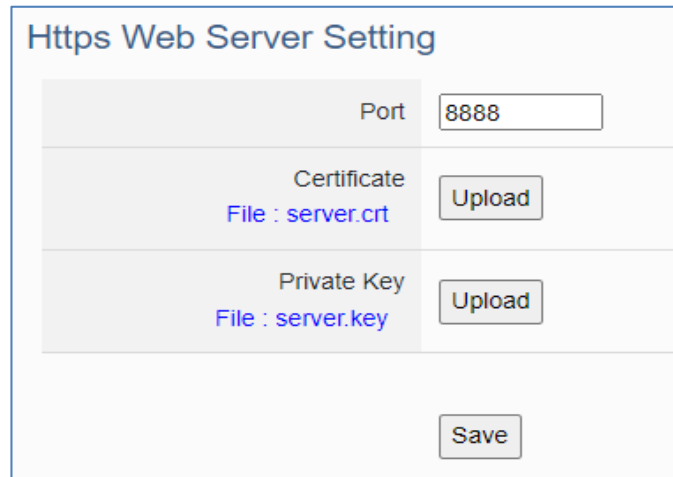

After uploading the certificate, users can read and write I/O according to the RESTful API example in the previous section.

Apply on the Website Address Bar:

**https://IP:Port/Resource Definition**

IP : Device IP.

Port : Https Web Server Port; Default is 8888 for UA I/O.

**[ Example ] : <https://192.168.81.250:8888/AllVariableName>**



### 3.4 Common settings table for easy integration

This section explains how UA I/O can obtain the necessary settings for software integration, allowing users to integrate the site more quickly. UA-I/O provides a common settings table that includes the settings of OPC UA, MQTT, and HTTP (HTTPS) protocols. These settings are compiled into a file so that users can find the required settings quickly and easily.

The following is the UA-I/O with ICP DAS product AVEVA Edge as an example of how to use the common setup table.

#### Setting Steps:

##### [Step 1]

#### Menu Path:

【Module Setting】 → 【Overview】 Module Setting → I/O Setting ([Appendix A](#)).

Set the Nickname: Enter a name that is easily identifiable.

#### Analog Input


Channel	Nickname	OPC UA Description	Input Type
Vin0	二樓_A房_電熱水器		-10 ~ 10 V ▼
Vin1	2階_B室_電氣溫水器		-10 ~ 10 V ▼
Vin2	2층_C룸_전기온수기		-10 ~ 10 V ▼
Vin3	Электрический водонагрев		-10 ~ 10 V ▼
Vin4	ชั้น 2 ห้อง E เครื่องทำน้ำอุ่น		-10 ~ 10 V ▼
Vin5	Salle F_Chauffage-eau électrique		-10 ~ 10 V ▼

[Step 2]

Menu Path:

【Module Setting】 → 【Overview】 Module Setting → Overview (Appendix A).

Click the Download button and get CommonSettings.csv

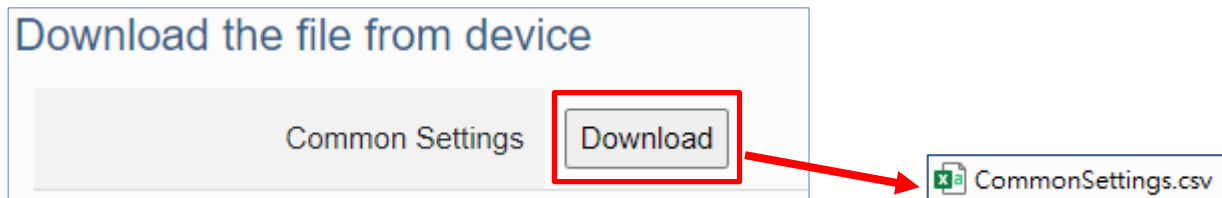


[Step 3]

Find the settings for the software by "Nickname" and copy and paste them into the software settings to complete the communication integration.

Below is an example of AVEVA Edge.

20	EnablePowerOnValue		ns=2;s=U-7526M.EnablePowerOnValue
21	Vin0	二樓_A房_電熱水器	ns=2;s=U-7526M.Vin0
22	Vin1	2階_B室_電氣溫水器	ns=2;s=U-7526M.Vin1
23	Vin2	2층_C룸_전기온수기	ns=2;s=U-7526M.Vin2
24	Vin3	Электрический водонагреватель	ns=2;s=U-7526M.Vin3
25	Vin4	ชั้น 2 ห้อง E เครื่องทำน้ำอุ่น	ns=2;s=U-7526M.Vin4
26	Vin5	Salle F_Chauffe-eau électrique	ns=2;s=U-7526M.Vin5
27	Vin0_Type		ns=2;s=U-7526M.Vin0_Type
28	Vin1_Type		ns=2;s=U-7526M.Vin1_Type
29	Vin2_Type		ns=2;s=U-7526M.Vin2_Type
30	Vin3_Type		ns=2;s=U-7526M.Vin3_Type

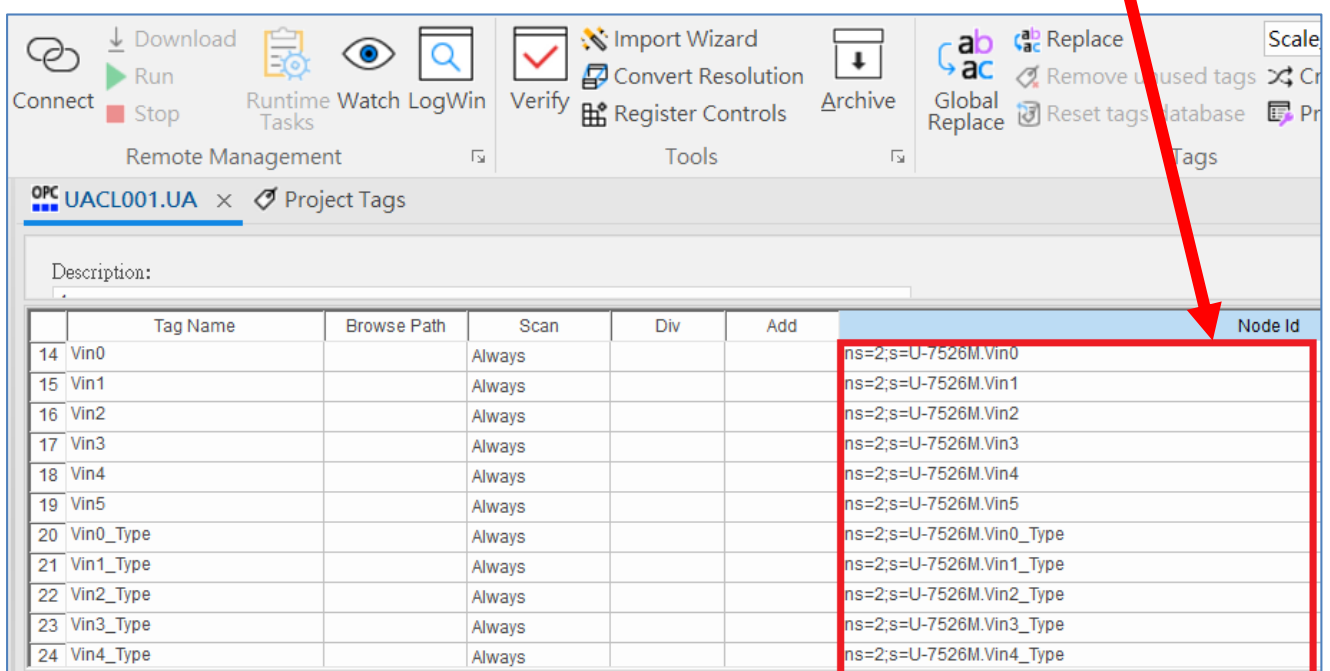

## 3.5 Rule Setting

This section introduces how to set the "Rule Setting" of the logic control function of UA I/O. It provides simple logic condition rule setting, let UA I/O do automatic condition judgment and action control, to achieve simple intelligentization.

### Manu Path:

【Advanced Setting】 → 【Scaling】 Advanced Setting → Rule Setting ([Appendix A](#)).

### Setting Steps:

First, click [Advanced Setting] > [Rule Setting], switch to the rule setting screen, to add the condition.

Delete	Rule Name	IF	THEN	ELSE
<input type="checkbox"/>	<input type="text"/>	<div style="border: 1px solid black; padding: 2px;">Add a new Condition</div> <div>AND ▼</div>	<div style="border: 1px dashed black; padding: 5px;">Add a new Action</div>	<div style="border: 1px dashed black; padding: 5px;">Add a new Action</div>

Select an I/O point, to add a condition rule.

IF	THEN	ELSE
<div style="border: 1px dashed black; padding: 5px;">Add a new Condition</div> <div>DI ▼</div> <div style="border: 2px solid red; padding: 2px; background-color: black; color: white;">DO</div> <div>AI</div> <div>AO</div> <div>Virtual Point</div>	<div style="border: 1px dashed black; padding: 5px;">Add a new Action</div>	<div style="border: 1px dashed black; padding: 5px;">Add a new Action</div>

### DO Condition Setting

Channel(Alias)	DO0
Status	ON

OK Cancel

Select an I/O point, to add a condition rule.

IF	THEN	ELSE
<div>Add a new Condition</div> <div> <div>DI</div> <div>DO</div> <div>AI</div> <div>AO</div> <div>Virtual Point</div> </div>	<div>Add a new Action</div>	<div>Add a new Action</div>
Save		

### Virtual Point Condition Setting

Alias	Operator	Value
VirtualTag0	>=	36

OK Cancel

Delete	Rule Name	IF	THEN	ELSE
<input type="checkbox"/>	<input type="button" value="+"/>	<div>Add a new Condition</div> <div> <div>AND</div> <div>DO0 = ON</div> <div>VirtualTag0 &gt;= 36</div> </div>	<div>Add a new Action</div>	<div>Add a new Action</div>
		Save		



If set a wrong condition, click the “Delete” icon indicated by the green arrow to delete the rule condition.

Delete	Rule Name	IF	THEN	ELSE
<input type="checkbox"/>		<div>Add a new Condition</div> <div>AND</div> <div>DO0 = ON</div> <div>VirtualTag0 &gt;= 36</div>	<div>Add a new Action</div>	<div>Add a new Action</div>
<div>Save</div>				

Set up the “IF, THEN, ELSE” conditions/actions to add the rule according to the above steps.

Then, click the “ ” icon on the left to add the rule to the table.

Delete	Rule Name	IF	THEN	ELSE
<input type="checkbox"/>		<div>Add a new Condition</div> <div>AND</div> <div>DO0 = ON</div> <div>VirtualTag0 &gt;= 36</div>	<div>Add a new Action</div> <div>DO1 = ON</div> <div>VirtualTag8 = 11</div>	<div>Add a new Action</div> <div>DO1 = OFF</div> <div>VirtualTag8 = 98</div>
<div>Save</div>				

## 3.6 IoTstar Connection Example

This section introduces the IoTstar connection settings. Please go to the IoTstar setting menu.

**Manu Path:** 【Advanced Setting】 → 【IoTstar Setting】

Advanced Setting


 → 

IoTstar Setting

([Appendix A](#))

Please go to the following link to apply for a free trial account

<https://www.icpdas.com/en/product/guide+IIoT+Software+IoTstar#1080>

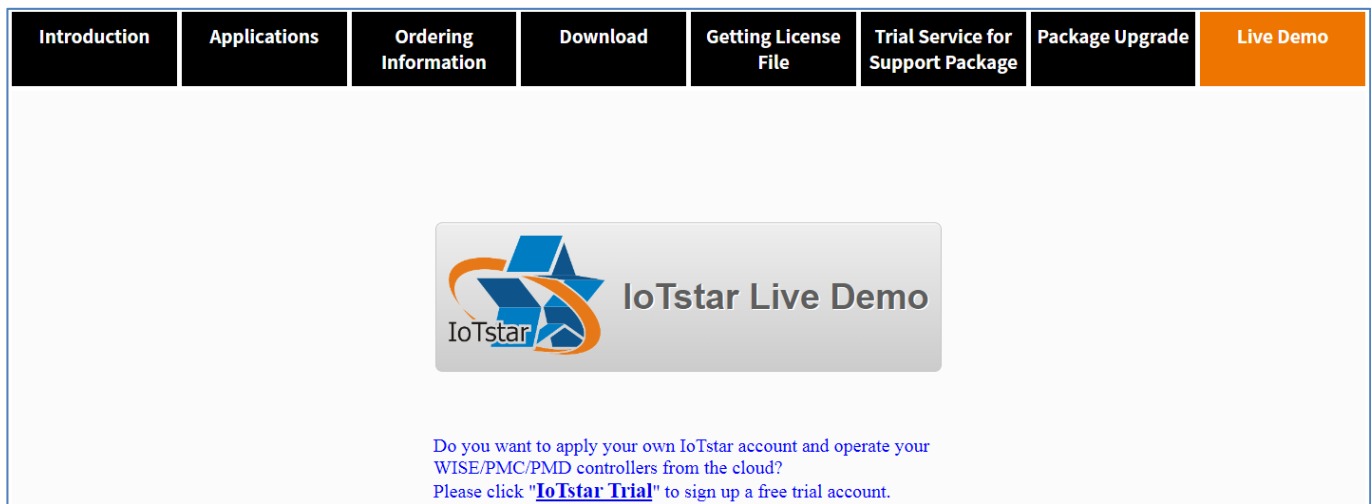

Enter the following information:

Server IP: `iotstardemo.icpdas.com`

Username: **The account name of the free trial account**

Password: **Password for a free trial account**

The other items are default values and click Save. The screen is as follows.

## Connection Setting

Server IP	<input type="text" value="iotstardemo.icpdas.com"/>
Server Port	<input type="text" value="1234"/>
Username	<input type="text" value="iotstar_rd9"/>
Password	<input type="password" value="....."/>
Nickname	<input type="text" value="U-7500M"/>
FTP Port	<input type="text" value="1231"/>
History Data Intervals (Seconds)	<input type="text" value="60"/>
KEY (8 characters)	<input type="password" value="....."/>
IV (8 characters)	<input type="password" value="....."/>
Real-Time I/O Data	<input type="checkbox"/> Enable
Historical I/O Data	<input type="checkbox"/> Enable

Success

After saving successfully, the connection will be completed.

## 4. Main Menu: Parameter Descriptions

This chapter introduces the menu functions of the UA I/O web UI and more focused on the function parameters of the menu. Each section introduces one main menu and its sub-menu functions. The function location is showing in a brief text and diagram of 【Menu Path】 , for Menu Path introductions please refer to [Appendix A](#).

### 4.1 Main Menu - System Setting


**System Setting** is the first item of the Main Menu. This item is about the settings related to the hardware and operating system.

#### 4.1.1 Overview

**Function:** Display the current information of the hardware and operating system.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【System Setting】 → 【Overview】 System Setting → Overview (Refer to [Appendix A](#)).

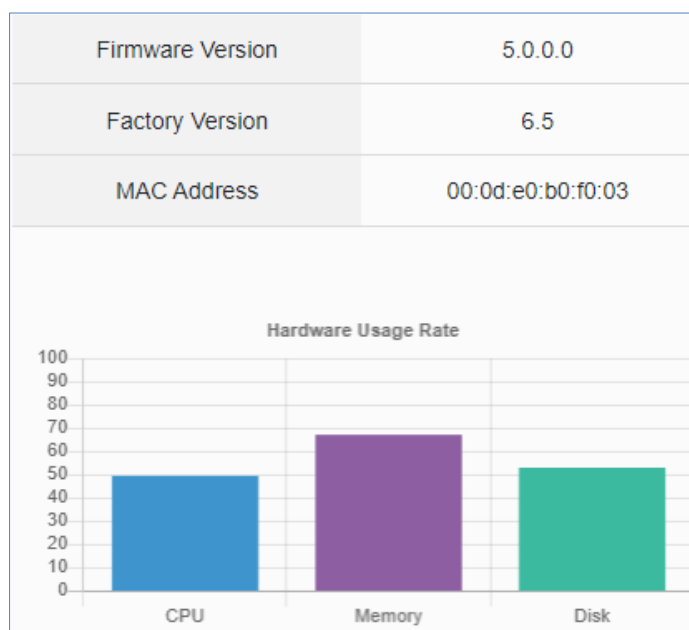

System Setting > Overview	
Firmware Version	Display the firmware version of the UA I/O module.
Factory Version	Display the factory version (OS & UI) of the UA I/O module.
MAC Address	The LAN MAC address of this UA I/O.
CPU	Display the current CPU usage of the module. Do not use to achieve 95% or more.
Memory	Display the current memory usage of the module. Do not use to achieve 95% or more.
Disk	Display the current disk usage of the module. Do not use to achieve 95% or more.

## 4.1.2 Network Setting

**Function:** Display and set up the network settings of the UA I/O.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【System Setting】 → 【Network Setting】 System Setting → Network Setting ([Appendix A](#)).

### Network Setting (LAN)

#### Network Setting (LAN)

Connection Mode	<input checked="" type="radio"/> Specify an IP address. <input type="radio"/> Obtain an IP address automatically.(DHCP)
IP Address	<div style="display: flex; justify-content: space-between; width: 100%;"> <div style="border: 1px solid black; width: 25%; text-align: center;">192</div> <div style="border: 1px solid black; width: 25%; text-align: center;">168</div> <div style="border: 1px solid black; width: 25%; text-align: center;">81</div> <div style="border: 1px solid black; width: 25%; text-align: center;">252</div> </div>
Mask	<div style="display: flex; justify-content: space-between; width: 100%;"> <div style="border: 1px solid black; width: 25%; text-align: center;">255</div> <div style="border: 1px solid black; width: 25%; text-align: center;">255</div> <div style="border: 1px solid black; width: 25%; text-align: center;">0</div> <div style="border: 1px solid black; width: 25%; text-align: center;">0</div> </div>
Gateway	<div style="display: flex; justify-content: space-between; width: 100%;"> <div style="border: 1px solid black; width: 25%; text-align: center;">192</div> <div style="border: 1px solid black; width: 25%; text-align: center;">168</div> <div style="border: 1px solid black; width: 25%; text-align: center;">1</div> <div style="border: 1px solid black; width: 25%; text-align: center;">1</div> </div>
MAC Address	00:00:00:00:81:52

Save

System Setting > Network Setting - Network Setting (LAN)	
Connection Mode	<b>Specify an IP address:</b> Users input the values in the fields of IP, Mask and Gateway according to customer's network. Detail information for the factory default value of UA controller network refers to the. <a href="#">Sec. 4.1.7</a> <b>Obtain an IP address automatically (DHCP):</b> It's the Dynamic Host Configuration Protocol mode. The system assigns the IP, Mask and Gateway automatically.
IP Address	The LAN IP address of this UA I/O. Factory Default: 192.168.255.1
Mask	The LAN mask address of this UA I/O. Factory Default: 255.255.0.0
Gateway	The LAN gateway address of this UA I/O. Factory Default: 192.168.1.1
MAC Address	The LAN MAC address of this UA I/O.
Save	Click to save the settings of LAN item.

## Hostname Setting

Hostname Setting

Hostname

U7560M000de0b0f003

Save

System Setting > Network Setting - Hostname Setting	
Hostname	The host name of this UA I/O. Default: system value. User can give a new name, but cannot be null, Chinese characters, or special symbols.
Save	Click to save the settings of this item.

### 4.1.3 Time Setting

**Function:** Display and set up the date and time of the UA I/O.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【System Setting】 → 【Time Setting】 System Setting → Time Setting ([Appendix A](#)).

#### Date and Time Display

### Date And Time Display

	Date	2020 / 6 / 8
	Time	14 : 45 : 3

System Setting > Time Setting - Date And Time Display	
Date	Display the date of the UA I/O module, including year, month and day.
Time	Display the current time of the UA I/O module, including hour, minute and second.

When the device time is one day different from the local computer time, a warning message "[Please check the time](#)" will be displayed, as shown in the below.

System Setting
Module Setting
OPC UA Setting
MQTT Setting
Advanced Setting

Overview

Network Setting

Time Setting

Please check the time

Account Setting

Web Server Setting

Firewall Setting

Firmware Setting

### Date And Time Display

	Date	2021 / 9 / 1
	Time	15 : 8 : 19

NTP time calibration

Set the time manually

Functional Status
☒ NTP Server ☐ Custom Time Server

NTP Server

time1.google.com ▼

Time Zone

Taipei ▼

Save

Success

## NTP time calibration

NTP time calibration		Set the time manually	
Functional Status	<input checked="" type="radio"/> NTP Server <input type="radio"/> Custom Time Server		
NTP Server	<input type="text" value="time1.google.com"/>		
Time Zone	<input type="text" value="Taipei"/>		
		<input type="button" value="Save"/> <span>Success</span>	

NTP time calibration		Set the time manually	
Functional Status	<input type="radio"/> NTP Server <input checked="" type="radio"/> Custom Time Server		
Custom Time Server	<input type="text" value="127.0.0.1"/>		
Time Zone	<input type="text" value="Taipei"/>		
		<input type="button" value="Save"/> <span>Success</span>	

### System Setting > Time Setting - NTP time calibration

Functional Status	NTP Server: Click to display the setting columns for NTP Server. Custom Time Server: Click to display the setting columns for Custom Time Server.
NTP Server	Select the common time server provided by the system.
Custom Time Server	Enter the IP address of the time server by custom.
Time Zone	Select the time zone of your location.
Save	Click to save the settings of this item and update the data of “Time Setting” to the “Date And Time Display” on the top of this page.

## Set the time manually

NTP time calibration		Set the time manually																																											
Date	<div> <div>September 2021</div> <table border="1"> <tr> <th>Mo</th><th>Tu</th><th>We</th><th>Th</th><th>Fr</th><th>Sa</th><th>Su</th></tr> <tr> <td></td><td></td><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td></tr> <tr> <td>6</td><td>7</td><td>8</td><td>9</td><td>10</td><td>11</td><td>12</td></tr> <tr> <td>13</td><td>14</td><td>15</td><td>16</td><td>17</td><td>18</td><td>19</td></tr> <tr> <td>20</td><td>21</td><td>22</td><td>23</td><td>24</td><td>25</td><td>26</td></tr> <tr> <td>27</td><td>28</td><td>29</td><td>30</td><td></td><td></td><td></td></tr> </table> </div>			Mo	Tu	We	Th	Fr	Sa	Su			1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30			
Mo	Tu	We	Th	Fr	Sa	Su																																							
		1	2	3	4	5																																							
6	7	8	9	10	11	12																																							
13	14	15	16	17	18	19																																							
20	21	22	23	24	25	26																																							
27	28	29	30																																										
Time	<input type="text" value="14"/> : <input type="text" value="49"/> : <input type="text" value="2"/>																																												
Read The Local Computer Time	<input type="button" value="Read"/>																																												
Time Zone	<input type="text" value="Taipei"/>																																												
		<input type="button" value="Save"/> <span>Success</span>																																											

### System Setting > Time Setting - Set The Time Manually

Date	Set the system date of the UA I/O by manually. Directly enter the new year/month/day, and then click “Save”.
Time	Set the system time of the UA I/O by manually. Directly enter the new hour : minute : second, and then click “Save”.
Read The Local Computer Time	Click [Read] can copy the current time of the using computer to the “Time Setting” of this item.
Time Zone	Select the time zone of your location.
Save	Click to save the settings of this item and update the data of “Time Setting” to the “Date And Time Display” on the top of this page.



## 4.1.4 Account Setting

**Function:** Display and set up the login username and password of the UA I/O Web UI.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【System Setting】 → 【Account Setting】 System Setting → Account Setting ([Appendix A](#)).

There are two modes of account setting: **Administrator Setting** and **User Setting**, only one administrator or user can log in at any one time. The administrator login provides customers with the most complete device information and setting items.

The user login only provides customers to read device I/O point information and control items.

### Administrator Setting

**Account Setting:**

System Setting > Account Setting	
Username	The login username for the UA Web UI. Factory default: root. Cannot be null. <b>After the first login in using the factory default settings, change the default username/password first, or user cannot use any other function (design for data security) except the [Overview] and [Account Setting] (Mouse showing hand shape).</b>
Password	The login password for the UA Web UI. Factory default: root. Cannot be null. <b>After the first login in using the factory default settings, change the default username/password first, or user cannot use any other function (design for data security) except the [Overview] and [Account Setting] (Mouse showing hand shape).</b> <b>Password setting rules:</b> <div> <div>Password</div> <ol style="list-style-type: none"> <li>1. Must not be the same as the account.</li> <li>2. The length must be greater than 6 characters.</li> <li>3. With English uppercase.</li> <li>4. With English lowercase.</li> <li>5. With numbers.</li> </ol> </div>
Confirm Password	Retype the password for the operation conform when setting the new account information.
Save	Click to save the settings of this page.

## Login Error Notification:

### Login Error Notification

Number Of Login Errors	<input type="text" value="3"/>
Server Name	<input type="text" value=""/>
Server Port	<input type="text" value="587"/>
Mailbox	<input type="text" value=""/>
Mailbox Password	<input type="password" value=""/>
Incoming Mailbox	<input type="text" value=""/>
Subject	<input type="text" value="ICPDAS U-7500M Notification"/>
Content	<input type="text" value="This device has an abnormal web login."/>
Sending Test	<input type="button" value="Test"/>

System Setting > Account Setting - Login Error Notification	
Number Of Login Errors	Default: 3 The number of times the wrong account or password is allowed. Example: Set the value 3. If the input is wrong 3 times, the system will send a notification.
Server Name	Mail server URLs provided by MIS, or URLs of major well-known mail servers.
Server Port	Default: 587 The mail server Port provided by MIS, or the ports of major famous mail servers.
Mailbox	Set up an available mailbox for sending emails to notify customers.
Mailbox Password	Enter the password for the mailbox.
Incoming Mailbox	The mailbox to receive messages.
Subject	Default: ICP DAS U-7500M Notification. The subject of the sanding letter.
Content	Default: This device has an abnormal web login. The content of the sanding letter.
Sending Test	Click the test button. After success, the settings are available. At the same time, the set value is also stored in the device.

## User Setting

### Account Setting:



Administrator Setting	User Setting
Account Setting	
Username	<input type="text" value="user"/>
Password	<input type="password" value="....."/>
Confirm Password	<input type="password" value="....."/>
<input type="button" value="Save"/> <span>Success</span>	

System Setting > Account Setting			
Username	<p>The login username for the UA Web UI. Factory default: root. Cannot be null.</p> <p><b>After the first login in using the factory default settings, change the default username/password first, or user cannot use any other function (design for data security) except the [Overview] and [Account Setting] (Mouse showing hand shape).</b></p>		
Password	<p>The login password for the UA Web UI. Factory default: root. Cannot be null.</p> <p><b>After the first login in using the factory default settings, change the default username/password first, or user cannot use any other function (design for data security) except the [Overview] and [Account Setting] (Mouse showing hand shape).</b></p> <p><b>Password setting rules:</b></p> <table border="1"> <tr> <td>Password</td><td>           1. Must not be the same as the account.            2. The length must be greater than 6 characters.            3. With English uppercase.            4. With English lowercase.            5. With numbers.         </td></tr> </table>	Password	1. Must not be the same as the account. 2. The length must be greater than 6 characters. 3. With English uppercase. 4. With English lowercase. 5. With numbers.
Password	1. Must not be the same as the account. 2. The length must be greater than 6 characters. 3. With English uppercase. 4. With English lowercase. 5. With numbers.		
Confirm Password	Retype the password for the operation conform when setting the new account information.		
Save	Click to save the settings of this page.		


## 4.1.5 Web Server Setting

**Function:** Provide Web Server settings, such as display and set the Web Server port.

**Support Module:** All UA I/O modules support this function, both Http and Https can be enabled.

**Manu Path:** 【System Setting】 → 【Web Server Setting】  →   
([Appendix A](#)).

### Web Server Setting

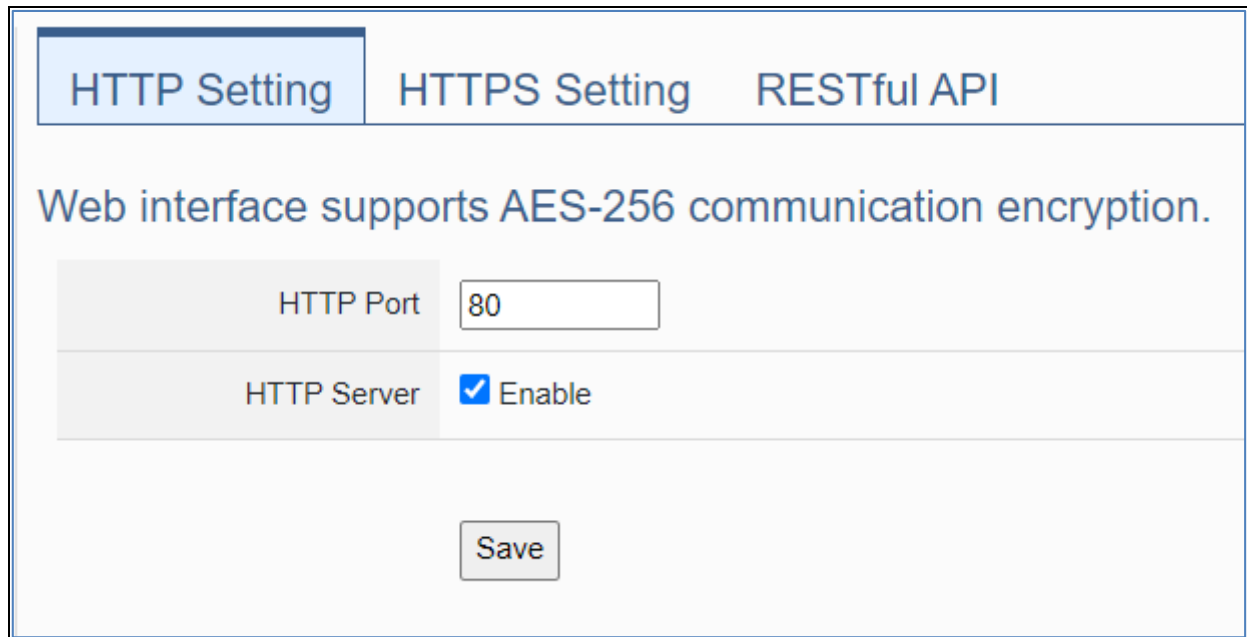

The screenshot shows the 'Web Server Setting' window. At the top, there are three tabs: 'HTTP Setting' (selected), 'HTTPS Setting', and 'RESTful API'. Below the tabs, a message states 'Web interface supports AES-256 communication encryption.' The main area contains two settings: 'HTTP Port' with a text box containing '80', and 'HTTP Server' with a checked checkbox and the label 'Enable'. At the bottom center is a 'Save' button.

System Setting > Web Server Setting	
HTTP Port	Web Server port of the UA I/O device. Factory default port: 80.
HTTP Server	When Enable is checked, HTTP Server is enabled.
Save	Click to save the settings.

**NOTE:** After clicking the “save” icon, the system will restart the Web Server. It takes time to start, please wait patiently.

## Https Web Server Setting

The screenshot shows the 'Https Web Server Setting' window. It has three tabs: 'HTTP Setting', 'HTTPS Setting' (which is active), and 'RESTful API'. The 'Basic Setting' section contains:
 

- 'HTTPS Port' with a text box containing '8888'.
- 'Certificate' with a 'Download' button.
- 'HTTPS Server' with an 'Enable' checkbox.
- A 'Save and regenerate certificates' button at the bottom.

 The 'Advanced Setting' section contains:
 

- 'Custom Certificate' with an 'Upload' button and a blue link 'File : server.crt'.
- 'Custom Private Key' with an 'Upload' button and a blue link 'File : server.key'.
- A 'Save' button at the bottom.

System Setting > Web Server Setting - Basic Setting	
HTTPS Port	HTTPS Web Server port of the UA I/O device. Factory default port: 8888.
Certificate	Click the Download button to download the .crt file from the module to the local computer.
HTTPS Server	When Enable is checked, HTTPS Server is enabled.

System Setting > Web Server Setting - Advanced Setting	
Custom Certificate	Customize the server certificate. Filename rules: [A-Z, a-z, 0-9].crt, only .crt files consisting of letters and numbers are accepted.
Custom Private Key	Customize the Private Key. Filename rules: [A-Z, a-z, 0-9].key, only .key files consisting of letters and numbers are accepted.

**NOTE:** After clicking the “save” icon, the system will restart the Web Server. It takes time to start, please wait patiently.

## RESTful API

HTTP Setting
HTTPS Setting
**RESTful API**

Request Method GET /Design
[Example](#)

Custom Format

Select a channel
▼
Insert

Edit
Preview

Save

[Test](#)

System Setting > Web Server Setting – Request Method Get / Design	
Custom Format	<p>Please click on the "<a href="#">Examples</a>" button on the top right corner of the page for detailed instructions.</p> <p>Step 1: Select the channel and click the Insert button. Insert the identifier into the edit box.</p> <p>Step 2: Click the Edit button to customize the content.</p> <p>Step 3: Click the Preview button to check if the customized content is correct.</p> <p>Step 4: Click the Save button to save the setting.</p> <p>Step 5: Click the Test button to test if the format is correct.</p>

Request Method PUT /Design

Example

Custom Format

Select a channel

▼

Insert

Edit

Preview

Save

Test Setting

Enter Test Data

Test Data

Send

System Setting > Web Server Setting – Request Method PUT / Design	
Custom Format	<p>Please click on the " <a href="#">Examples</a> " button on the top right corner of the page for detailed instructions.</p> <p>Step 1: Select the channel and click the Insert button. Insert the identifier into the edit box.</p> <p>Step 2: Click the Edit button to customize the content.</p> <p>Step 3: Click the Preview button to check if the customized content is correct.</p> <p>Step 4: Click the Save button to save the setting.</p>

System Setting > Web Server Setting - Test Setting	
Enter Test Data	<p>Step 1: Copy the customized content and enter it into the edit box.</p> <p>Step 2: Change the identifier of the customized content to a value.</p>
Test Data	<p>Step 1: Click the Send button</p> <p>Step 2: Check if the I/O channel value has changed.</p>

## 4.1.6 Firewall Setting

**Function:** Provide firewall settings, allowing specific IP to have permission to connect to the module.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【System Setting】 → 【Firewall Setting】 System Setting → Firewall Setting ([Appendix A](#)).

### Allow Remote Device Connection

Allow All IP	<input type="checkbox"/> Enable
Allow IP	<input style="width: 150px;" type="text"/>
Allow IP	<input style="width: 150px;" type="text"/>
Allow IP	<input style="width: 150px;" type="text"/>
Allow IP Range	<div style="display: flex; justify-content: space-between; width: 100%;"> <div style="border: 1px solid #ccc; padding: 5px; width: 45%;">Start Address</div> <div style="border: 1px solid #ccc; padding: 5px; width: 45%;">End Address</div> </div>

System Setting > Firewall Setting	
Allow all IP	Check box to allow all IPs to connect to UA-I/O. Factory default value: Enabled.
Allow IP	Enter the IP to allow specific IP to connect to UA-I/O. Limit the number of IP connections: Up to 3 sets of client computer or device IP.
Allow IP zones	Allow UA-I/O connection for specific IP zones



### 4.1.7 Firmware Setting


**Function:** Provide firmware settings, such as restore factory setting and update firmware.

**Support Module:** All UA I/O modules support this function.


**Manu Path:** 【System Setting】 → 【Firmware Setting】 System Setting → Firmware Setting ([Appendix A](#)).

#### Restore Factory Setting


1. Check the “Enable” box to enable the “Restore” button, and then click on the “Restore” button to start the restore operation.

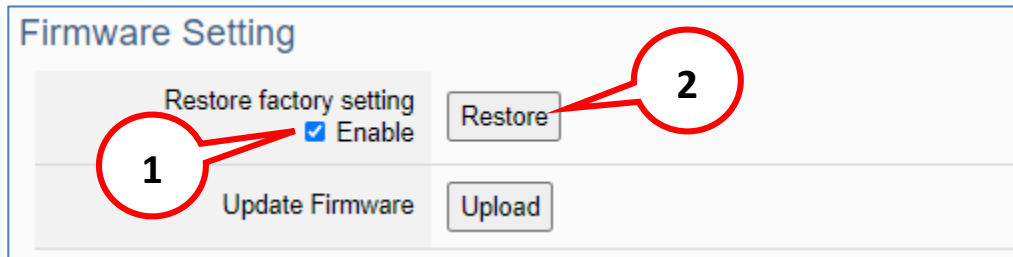

2. A message will prompt appear, showing the installation process of the restore program, please wait approximately 2 minutes.

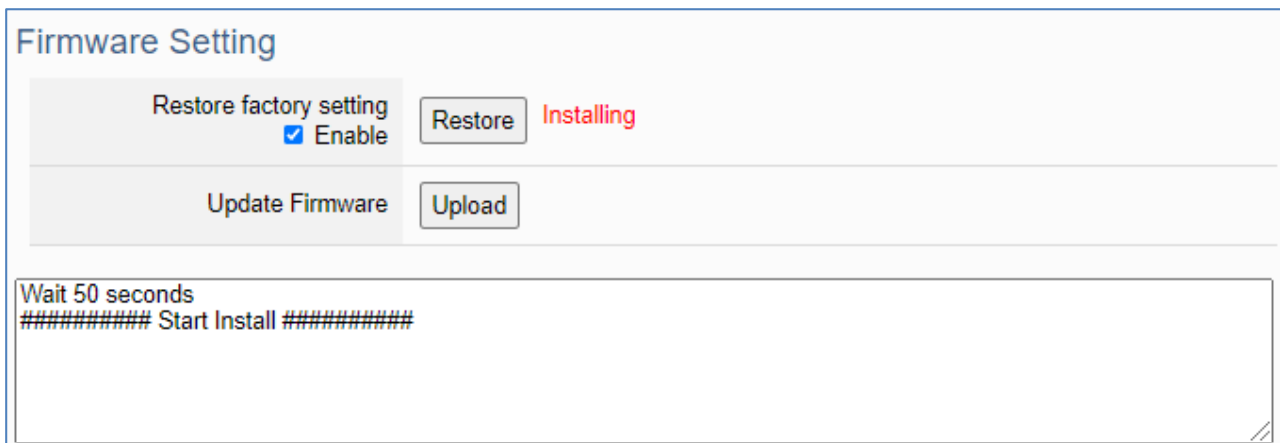

3. After the process finished, it appears a box message "During device restart, after waiting for 60 seconds, press OK", indicating that **this restoration succeeds**. If the box does not pop up, **this restoration fails**.

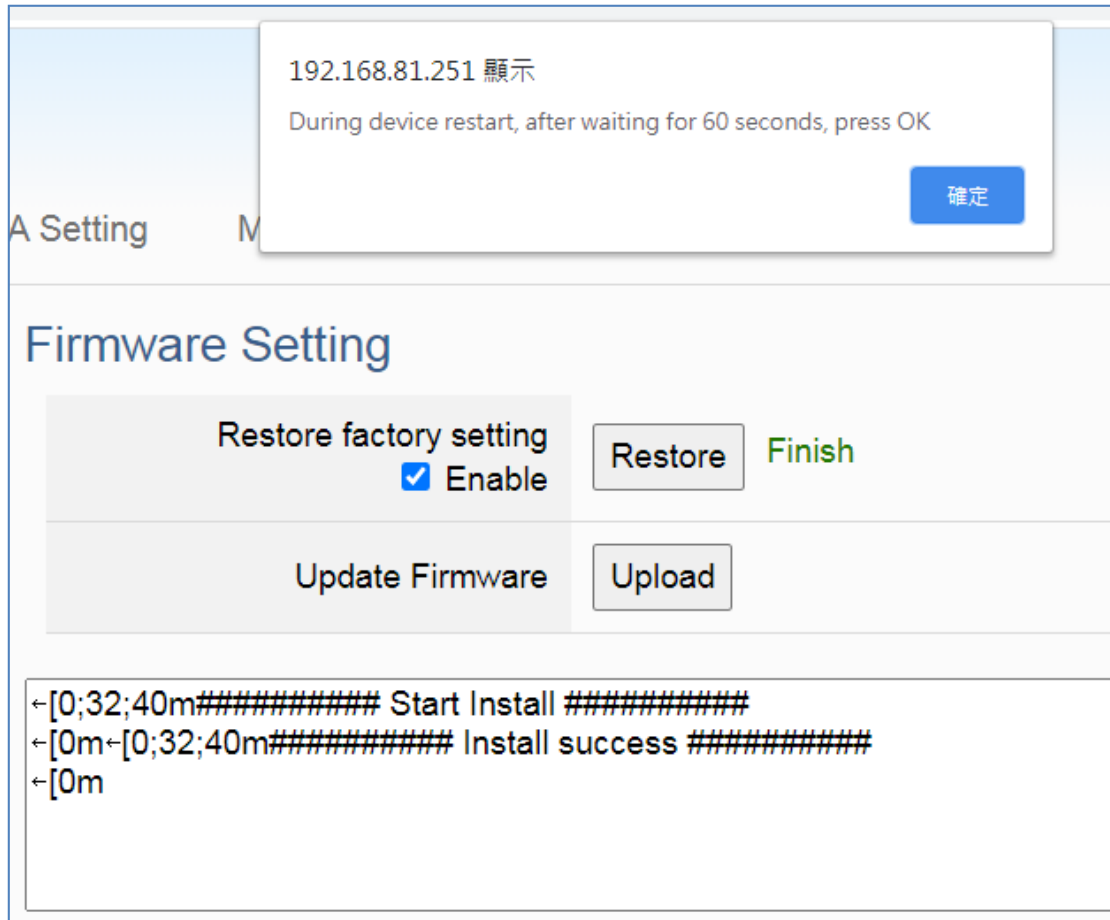

4. After restarting, the module will restore the factory default settings as follows: (Web IP address automatically changes to 192.168.255.1)

Factory Default Settings of UA I/O Modules			
Network	IP (LAN)	192.168.255.1	Assign UA I/O a new IP setting according to your case.
	Netmask	255.255.0.0	
	Gateway	192.168.1.1	
Web UI Account	Username	root	After login, change the default username/password to use other functions.
	Password	root	


## Update Firmware

When UA I/O has new functions, users can go to the UA series download center on the ICP DAS website to download the latest version of Firmware software, and then update the firmware of your UA I/O module according to the steps in this section.


### UA series download center on the ICP DAS website:

<https://www.icpdas.com/en/download/index.php?nation=US&kind1=&model=&kw=ua->


1. Click on the “Upload” button

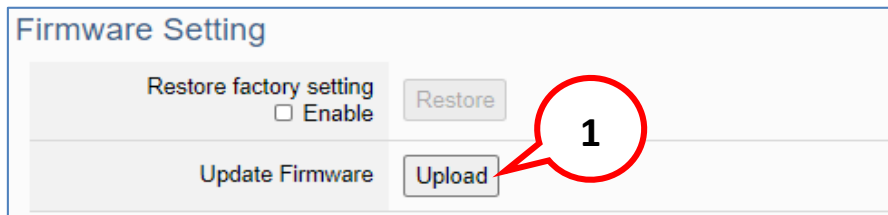


2. Select the firmware file

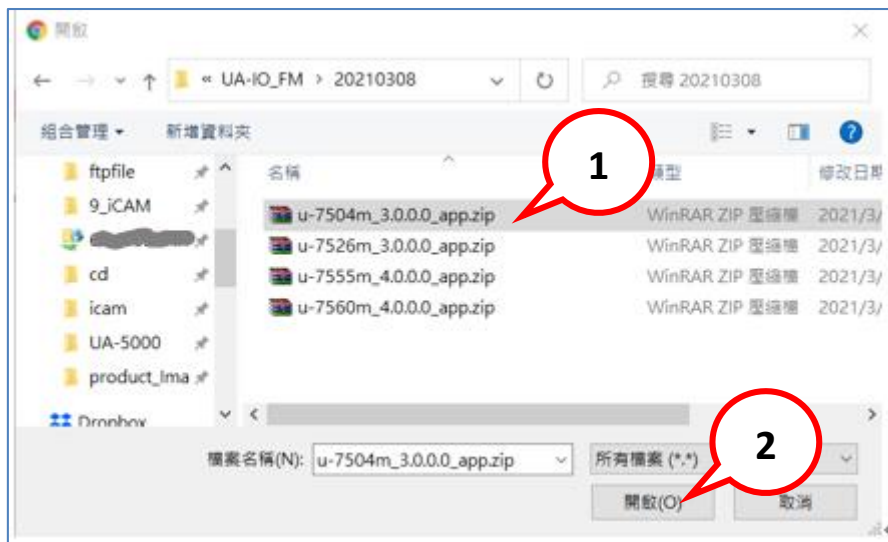


3. Begin to upload the Firmware file, and the lower message box will show the progress.

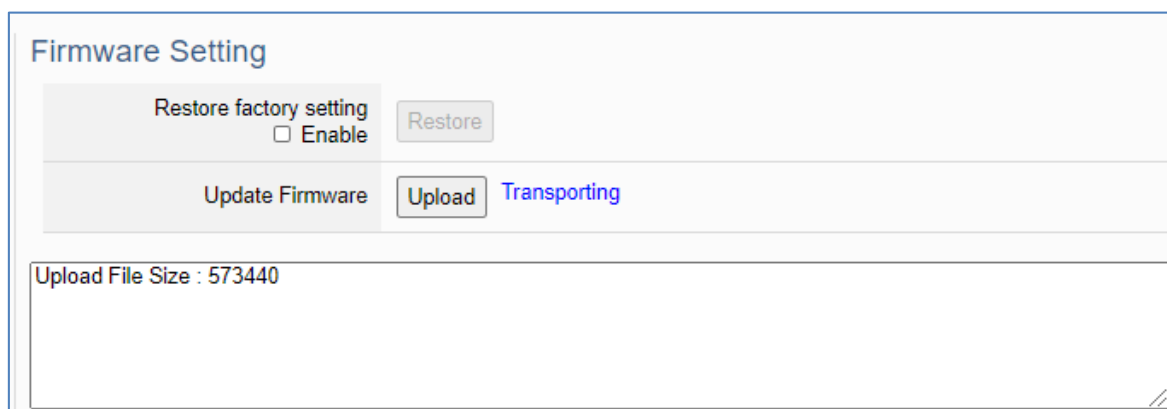

4. After upload the file, it begins to install the firmware.

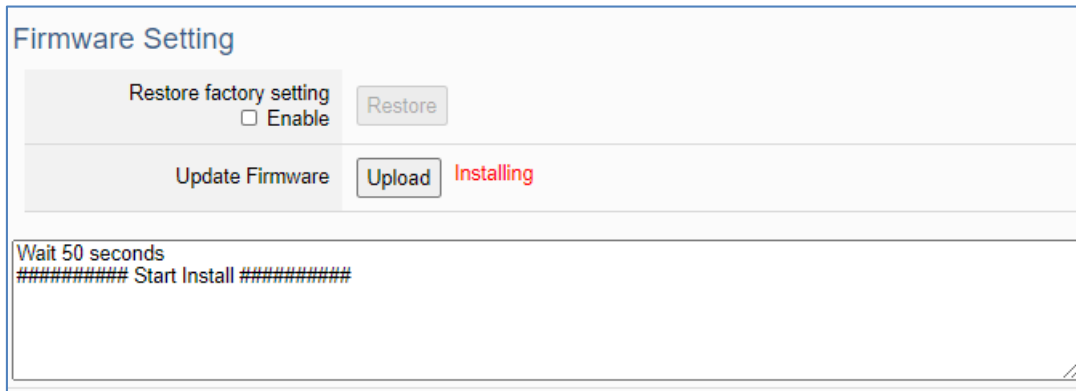

5. After the process finished, it appears a box message "During device restart, after waiting for 60 seconds, press OK", indicating that **this update succeeds**. If the box does not pop up, **this update fails**.

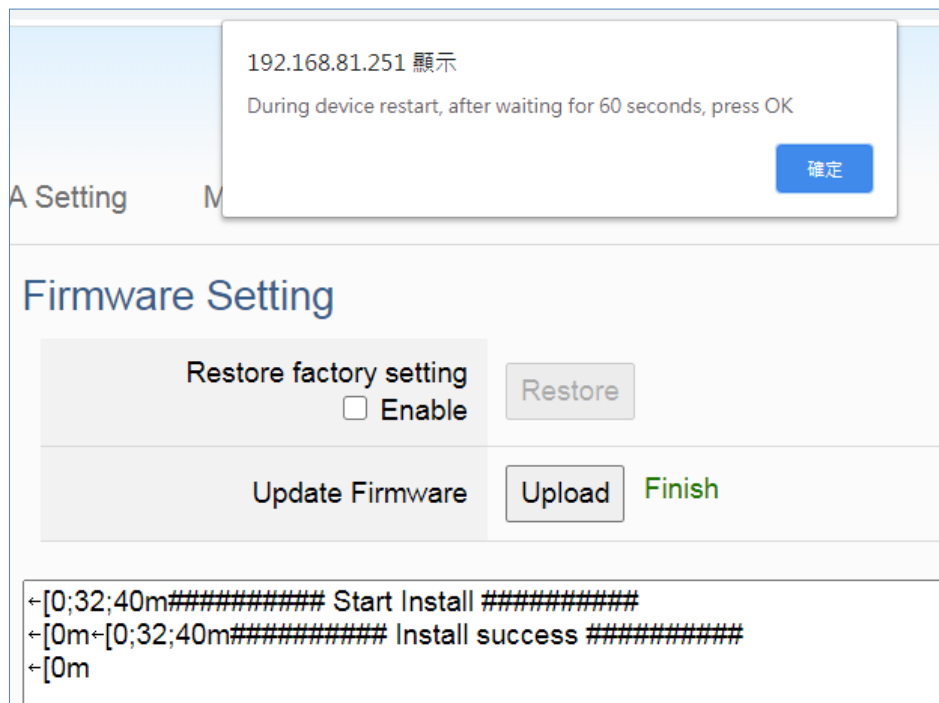


6. After restarting, the module will recover the UA I/O settings as follows:

Update Firmware of UA I/O Modules			
Network	IP (LAN)	Keep the original setting	Assign UA I/O a new IP setting according to your case.
	Netmask	Keep the original setting	
	Gateway	Keep the original setting	
Web UI Account	Username	root	After login, change the default username/password to use other functions.
	Password	root	

## Maintenance

This function is only provided to ICP DAS R&D personnel for maintenance using. It is reserved and not open for use.

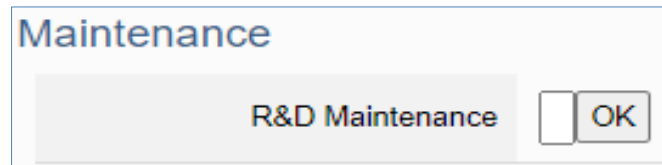



## 4.2 Main Menu - Module Setting

This main menu aggregates all module and project in the module related function settings. This chapter focuses on parameter descriptions. About the detailed steps and notices for using OPC UA connection/certificate, please refer to [3.1 Settings for Using OPC UA Connection](#) of [Chapter 3 Main Function Settings](#).

### 4.2.1 Overview

**Function:** Provides the status of the I/O functions, and a common settings table for download.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Module Setting】 → 【Overview】  →  (Refer to [Appendix A](#))

#### Function Overview

Function Overview


OPC UA Server	<input checked="" type="checkbox"/> Enable
OPC UA Client	<input type="checkbox"/> Enable
MQTT Client	<input checked="" type="checkbox"/> Enable
RESTful API Server	<input checked="" type="checkbox"/> Enable
IoTstar Setting	<input type="checkbox"/> Enable
Event Log	<input type="checkbox"/> Enable

Download the file from device

Common Settings
Download

Module Setting > Overview> Function Overview	
OPC UA Server	Display the OPC UA Server enable status.
OPC UA Client	Display the OPC UA Client enable status.
MQTT Client	Display the MQTT Client enable status.
RESTful API Server	Display the RESTful API Server enable status.
IoTstar Setting	Display the IoTstar Client enable status.
Event Log	Display the Event Log enable status.

## Download the file from device

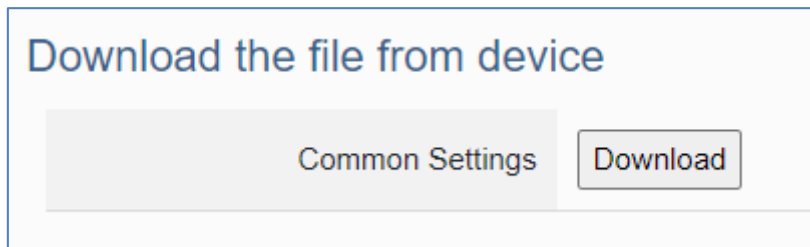

### Module Setting > Overview> Download the file from device

Common Settings

Press the Download button to get the common settings table.  
Example reference: For a simple setup example, please refer to [Section 3.4](#).

## 4.2.2 I/O Setting

**Function:** Display and change the I/O settings of the UA I/O module.

**Support Module:** All UA I/O modules support this function, Http, and Https, both can be enabled.

**Manu Path:** 【Module Setting】 → 【I/O Setting】 Module Setting → I/O Setting ([Appendix A](#)).

### Digital Input

#### Digital Input

Channel	Nickname	OPC UA Description	Counter Clear	Counter Preset
DI0	<input style="width: 150px;" type="text" value="一樓警報指示燈"/>	<input style="width: 150px;" type="text"/>	<input type="checkbox"/>	<input style="width: 50px;" type="text" value="0"/>
DI1	<input style="width: 150px;" type="text" value="二樓警報指示燈"/>	<input style="width: 150px;" type="text"/>	<input type="checkbox"/>	<input style="width: 50px;" type="text" value="0"/>

Module Setting > I/O Setting - Digital Input	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The identification name of the channel for easy identification
OPC UA Description	The messages got from the description column of OPC Client, when using OPC UA connection.
Counter Clear	Counter reset to zero
Counter Preset	The count starts from this set value after power on, and the count will return to zero after the module is powered off.



## Digital Output

### Digital Output

Channel	Nickname	OPC UA Description	Power on Value
DO0	<input style="width: 150px;" type="text" value="A棟大門"/>	<input style="width: 150px;" type="text"/>	<input type="checkbox"/>
DO1	<input style="width: 150px;" type="text" value="B棟大門"/>	<input style="width: 150px;" type="text"/>	<input type="checkbox"/>

Module Setting > I/O Setting - Digital Output	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The identification name of the channel for easy identification
OPC UA Description	The messages got from the description column of OPC Client, when using OPC UA connection.
Power-on Value	After the power is turned off and restarted, the startup value of I/O, if checked, the boot output will output True, otherwise it will output False.

## Analog Input

### Analog Input

Channel	Nickname	OPC UA Description	Input Type
Vin0	二樓_A房_電熱水器		-10 ~ 10 V ▼
Vin1	2階_B室_電気温水器		-10 ~ 10 V ▼
Vin2	2층_C룸_전기온수기		-10 ~ 10 V ▼
Vin3	Электрический водонагрев		-10 ~ 10 V ▼
Vin4	ชั้น 2_ห้อง E_เครื่องทำน้ำอุ่น		-10 ~ 10 V ▼
Vin5	Salle F_Chauffage-eau électriq		-10 ~ 10 V ▼

#### Module Setting > I/O Setting – Analog Input

Channel	The channel name (number) of the UA I/O hardware.
Nickname	The identification name of the channel for easy identification
OPC UA Description	The messages got from the description column of OPC Client, when using OPC UA connection.
Input Type	Select the Input type by user's need.

## Analog Output

Channel	Nickname	OPC UA Description	Power-on Value	Output Type
Vout0	<input type="text" value="Vout0"/>	<input type="text" value="AO_0"/>	<input type="text" value="0"/>	<input type="text" value="-5 ~ 5 V"/> ▼
Vout1	<input type="text" value="Vout1"/>	<input type="text"/>	<input type="text" value="0"/>	<input type="text" value="0 ~ 10 V"/> ▼

Module Setting > I/O Setting – Analog Output	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The identification name of the channel for easy identification
OPC UA Description	The messages got from the description column of OPC Client, when using OPC UA connection.
Power-on Value	The initial value of the I/O channel after the power off and restart to on.
Output Type	Select the Output type by user's need.

### 4.2.3 Scaling

**Function:** The Setting of scaling convert the analog signal to a more readable value. This function is only available for modules with AI/AO.

**Support Module:** All UA AI/AO modules support this function.

**Manu Path:** 【Module Setting】 → 【Scaling】 Module Setting → Scaling ([Appendix A](#)).

When the variable value needs to be scaled or converted before output. Fill in the Min/Max items of the Source/Output Variable, and add a description, the Scaling conversion function will be activated.

System Setting
**Module Setting**
OPC UA Setting
MQTT Setting
Advanced Setting

Overview

I/O Setting

**Scaling**

I/O Status

Project File

### Content Setting

Source variable		Output variable	
Vin0		Scale_Vin0	
Nickname	二樓_A房_電熱水器	Max	50
Max	10	Min	20
Min	-10	Offset	0
Vin1		Scale_Vin1	
Nickname	2階_B室_電氣溫水器	Max	50
Max	10	Min	20
Min	-10	Offset	0

Module Setting > Scaling – Content Setting	
Nickname(Source variable)	The Nickname name in the function of [Module Setting] → [I/O Setting]
Min (Source variable)	The source variable that to be converted; Fill in its minimum value.
Max (Source variable)	The source variable that to be converted; Fill in its maximum value.
Min (Output variable)	The output variable that to be converted; Fill in its minimum value.
Max (Output variable)	The output variable that to be converted; Fill in its maximum value.
Offset (output variable)	Output variable + Offset = Actual Value

## 4.2.4 I/O Status

**Function:** Display and change the I/O status of the UA I/O module.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Module Setting】 → 【I/O Status】 Module Setting → I/O Status ([Appendix A](#)).

### Digital Input (& Counter)

Digital Input			
Channel	Nickname	Value	Status
DI0	<span style="border: 1px solid black; padding: 2px;">一樓警報指示燈</span>	<input type="checkbox"/>	GOOD
DI1	<span style="border: 1px solid black; padding: 2px;">二樓警報指示燈</span>	<input type="checkbox"/>	GOOD
DI0_Counter	<span style="border: 1px solid black; padding: 2px;">一樓警報指示燈_Counter</span>	<span style="border: 1px solid black; padding: 2px;">0</span>	GOOD
DI1_Counter	<span style="border: 1px solid black; padding: 2px;">二樓警報指示燈_Counter</span>	<span style="border: 1px solid black; padding: 2px;">0</span>	GOOD

Module Setting > I/O Status - Digital Input	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The Nickname name in the function of [Module Setting] → [I/O Setting]
Value	Current channel status value. When the value changes, the signal LED will change.
Status	GOOD, BAD, or UNCERTAIN.

## Digital Output

Digital Output			
Channel	Nickname	Value	Status
DO0	<input type="text" value="A棟大門"/>	<input checked="" type="checkbox"/>	GOOD
DO1	<input type="text" value="B棟大門"/>	<input type="checkbox"/>	GOOD

Module Setting > I/O Status - Digital Output	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The Nickname name in the function of [Module Setting] ➔ [I/O Setting]
Value	Current channel status value. When the value changes, the signal LED will change.
Status	GOOD, BAD, or UNCERTAIN.

**Analog Input**

Channel	Nickname	Value	Status	Input Type
Vin0	<input type="text" value="Vin0"/>	<input type="text" value="0"/>	GOOD	<input type="text" value="-10 ~ 10 V"/> ▼
Vin1	<input type="text" value="Vin1"/>	<input type="text" value="0"/>	GOOD	<input type="text" value="-10 ~ 10 V"/> ▼
Vin2	<input type="text" value="Vin2"/>	<input type="text" value="0"/>	GOOD	<input type="text" value="-10 ~ 10 V"/> ▼
Vin3	<input type="text" value="Vin3"/>	<input type="text" value="0"/>	GOOD	<input type="text" value="-10 ~ 10 V"/> ▼

**Module Setting > I/O Status – Analog Input**

Channel	The channel name (number) of the UA I/O hardware.
Nickname	The Nickname name in the function of [Module Setting] → [I/O Setting]
Value	Current channel status value. When the input type is 4-20mA, if an abnormal state occurs, the value will display as -32.768.
Status	GOOD, BAD, or UNCERTAIN.

Input type	Display Value	Anomalous narrative
4~20mA	-32.768	Signal source disconnected

## Analog Output

Analog Output				
Channel	Nickname	Value	Status	Output Type
Vout0	<input type="text" value="Vout0"/>	<input type="text" value="0"/>	GOOD	-5 ~ 5 V ▾
Vout1	<input type="text" value="Vout1"/>	<input type="text" value="0"/>	GOOD	0 ~ 10 V ▾

Module Setting > I/O Status - Analog Output	
Channel	The channel name (number) of the UA I/O hardware.
Nickname	The Nickname name in the function of [Module Setting] ➔ [I/O Setting]
Value	Current channel status value.
Status	GOOD, BAD, or UNCERTAIN.





## 4.2.5 Projec File

功能：專案檔的下載、上傳功能。

### 4.2.3 Project File

**Function:** download and upload the project file of the UA I/O module.


**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Module Setting】 → 【Project File】  →  ([Appendix A](#)).

### Download the file from device

Download the project file, for back up the project settings.


Click [Download] button, the project file in the UA I/O can be download to the operating PC.

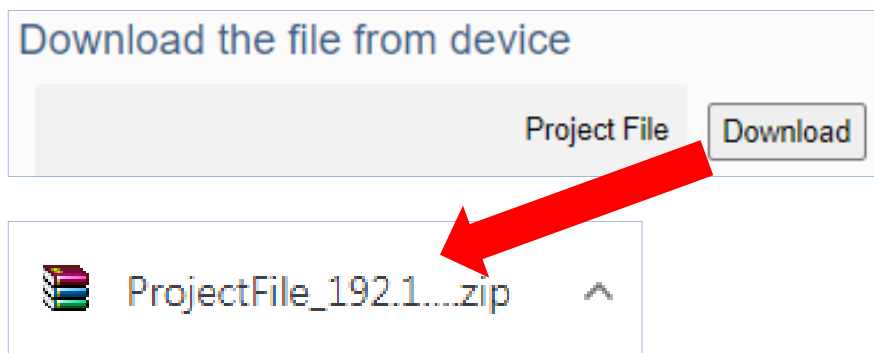

## Upload the file to the device

Upload the project file into the UA I/O. This function can quickly replace the previously backed up project file, and then restore the project setting parameters.

Click [Upload] button, select the project file in the PC.


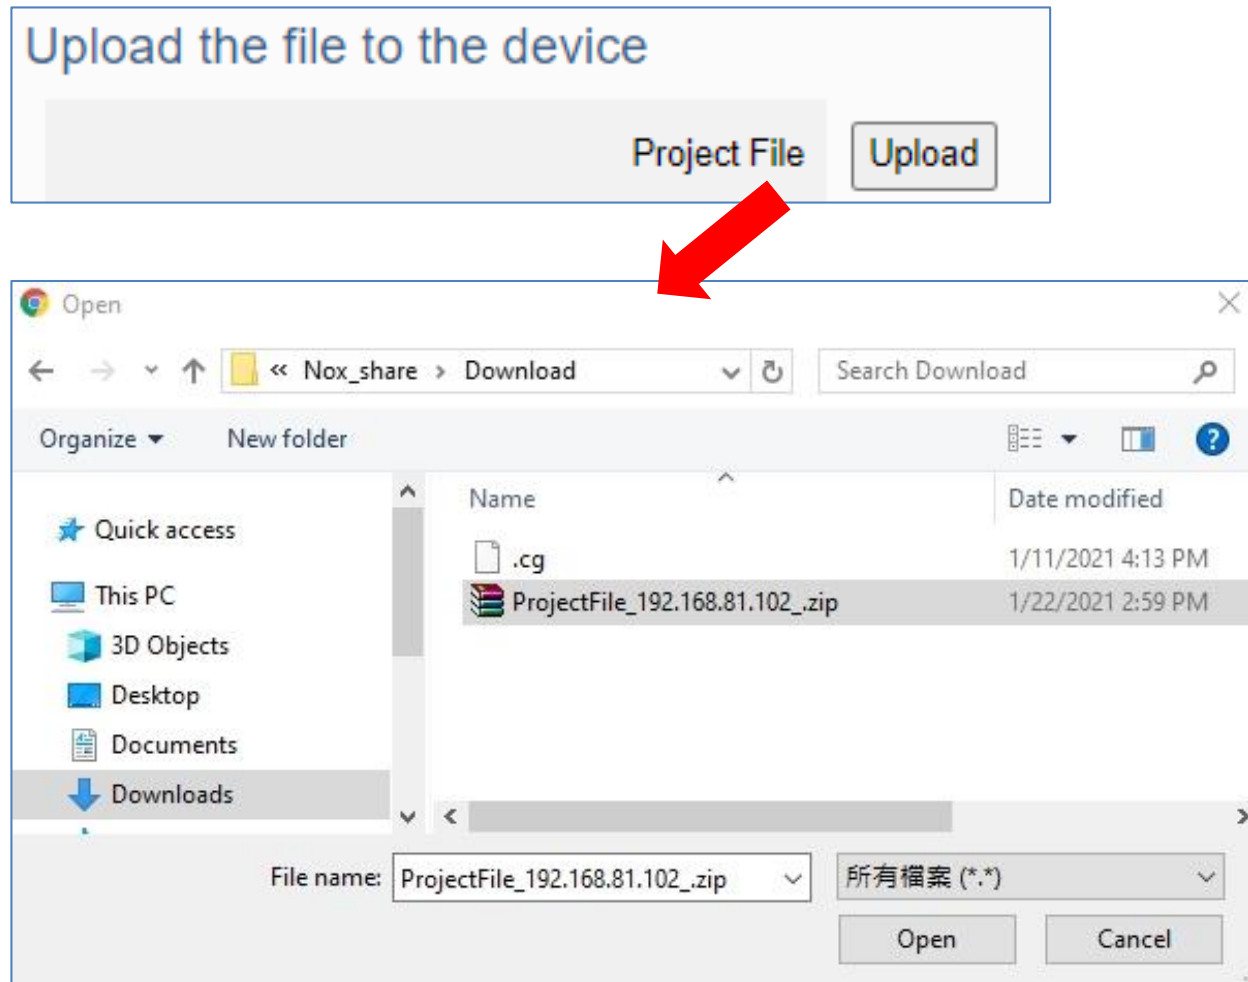


## 4.3 Main Menu - OPC UA Setting


This main menu aggregates all OPC UA related settings. This chapter focuses on parameter descriptions. About the detailed steps and notices for using OPC UA connection/certificate, please refer to [3.1 Settings for Using OPC UA Connection](#) of [Chapter 3 Main Function Settings](#).

### NOTE:

When the main menu “**OPC UA Setting**” has a message of “[Please remove the server certificate](#)” (as the picture below), that means there is something error about the server certificate file.

Please click the menu **【OPC UA Setting】** → **【Certificate】**  →  ([Appendix A](#)) to remove the Server Certificate, the function of OPC UA menu will be normal again.

The operation to remove the Server Certificate, please refer to the next two section “[4.3.2 Certificate](#)”.

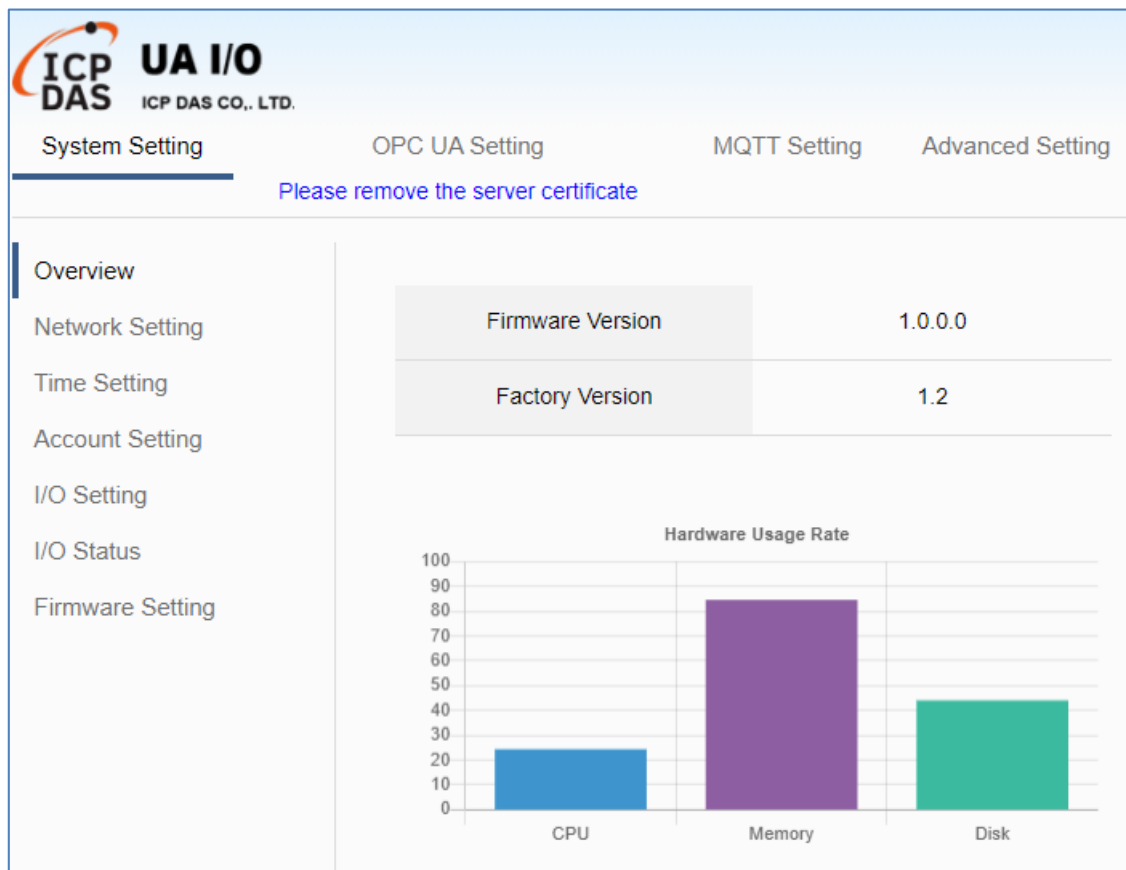

### 4.3.1 Server Setting

**Function:** Provide the Server settings for using the OPC UA connection.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【OPC UA Setting】 → 【Server Setting】 OPC UA Setting → Server Setting ([Appendix A](#)).

**Sample:** For a simple setting example, please refer to [Section 3.1](#) .

#### Connection Setting

Port	<input style="width: 80%;" type="text" value="48010"/>
Anonymous Login	<input checked="" type="checkbox"/> Enable
Username Password Login	<input checked="" type="checkbox"/> Enable
Certificate Login	<input type="checkbox"/> Enable


OPC UA Setting > Server Setting - Connection Setting	
Port	The communication port number of the OPC UA Server. System Default: 48010.
Anonymous Login	Check to enable the anonymous login from OPC UA clients.
Username Password Login	Check to enable the user password login from OPC UA clients. (The username and password here are the same as the login username and password of the Web UI.)
Certificate Login	Check to enable the certificate login from OPC UA clients. (refer to next section, Server Certificate)
Save	Click to save the connection settings of the OPC UA Server.

### 4.3.2 Server Certificate

**Function:** When selecting the OPC UA certificate connection, the UA I/O (Server side) needs to exchange the certificate with the connecting client side. This page is about setting the OPC UA Certificate for security and encryption, e.g. upload, download, delete the certificate.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【OPC UA Setting】 → 【Server Certificate】   ([Appendix A](#)).

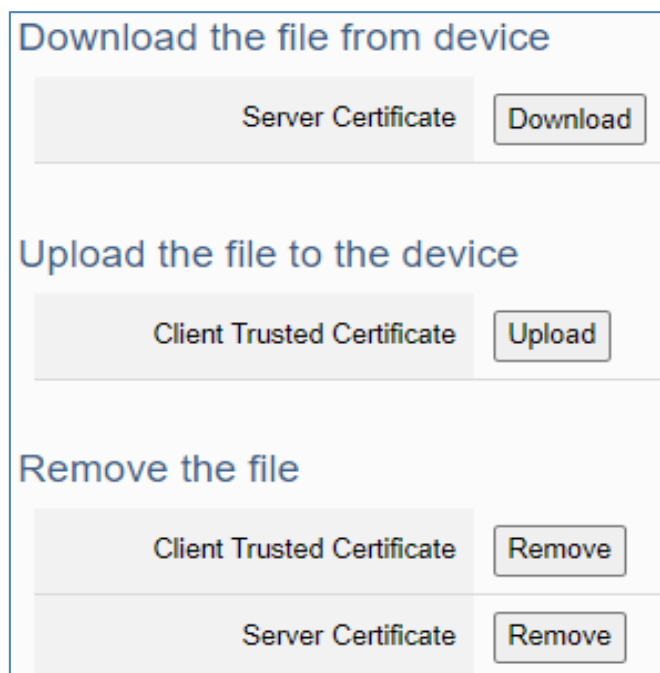

OPC UA Setting > Server Certificate – Download the file from device	
Server Certificate	Click “Download” to download the OPC UA Server Certificate file to the PC for the use of the client-side device. File Name: icpdasuaserver.der
OPC UA Setting > Server Certificate –Upload the file to the device	
Client Trusted Certificate	Click “Upload” to select the OPC UA Client Trusted Certificate file on your PC, and upload the Trusted Certificate file to the UA I/O module.
OPC UA Setting > Server Certificate – Remote the file	
Client Trusted Certificate	Click “Remove” to delete all Client Trusted Certificate files.
Server Certificate	Click “Remove” to delete all Server Certificate files.

### 4.3.3 Client Setting

**Function:** The OPC UA Client connection settings.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【OPC UA Setting】 → 【Client Setting】 OPC UA Setting → Client Setting ([Appendix A](#)).

#### Functional Status

OPC UA Client

☒
Enable

Save

OPC UA Setting > Client Setting - Functional Status	
OPC UA Client	To use this function, select Enable and click the Save button.

#### Connection Setting

IP	<input type="text" value="192.168.81.150"/>
Port	<input type="text" value="48010"/>
Security Policy	<div style="border: 1px solid #ccc; padding: 2px;">None</div>
Message Security Mode	<div style="border: 1px solid #ccc; padding: 2px;">None</div>
Authentication Setting	<div style="border: 1px solid #ccc; padding: 2px;">Anonymous</div>
Sampling Interval (ms)	<input type="text" value="1000"/>
Test Connection	<div style="display: flex; align-items: center;"> <span style="border: 1px solid #ccc; padding: 2px 10px;">Connect and get the Node Id</span> <span style="margin-left: 10px; color: green;">Success</span> </div>

OPC UA Setting > Client Setting - Connection Setting	
IP	The IP address of the OPC UA Server.
Port	The port used by the OPC UA Server.
Security Policy	The security policy to use so that you can secure messages that are read from the OPC-UA source. Choose one of the following: None, Basic128Rsa15, Basic256.
Message Security Mode	The message security mode to use to secure connections to the OPC-UA source. Choose one of the following: None, Sign, Sign & Encrypt.
Authentication Setting	The client makes the settings for user authentication. Choose one of the following: Anonymous, Username, Password, Certificate, Private Key.
Sampling Interval (ms)	Synchronize the time interval of I/O data so the data of the module and OPC UA Server are synchronized.
Test Connection	Click "Connect and get node Id" to connect to OPC UA Server. Success: You can connect and get the node ID of the Server side.

Channel	Node Id
DI0	<input type="text" value="ns=2;s=U-7526M.DI0"/>
DI1	<input type="text" value="ns=2;s=U-7526M.DI1"/>
DI0_Counter	<input type="text" value="ns=2;s=U-7526M.DI0_Counter"/>
DI1_Counter	<input type="text" value="ns=2;s=U-7526M.DI1_Counter"/>

OPC UA Setting > Client Setting – Connection Setting	
Channel	The Nickname name in the function of [Module Setting] ➔ [I/O Setting]
Node Id	Select the node Id on the OPC UA Server and synchronize the channel I/O data to the Server.

### 4.3.4 Client Certificate

**Function:** When OPC UA Certificates are connected, they need to exchange certificates with each other. The interface provides Certificate Upload, Download, and Remove functions.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【OPC UA Setting】 → 【Client Certificate】 OPC UA Setting → Client Certificate ([Appendix A](#)).

**Download the file from device**

Client Certificate
Download

**Upload the file to the device**

Server Trusted Certificate
Upload

**Remove the file**

All Certificates and Private Keys
Remove

OPC UA Setting > Client Certificate – Download the file from device	
Client Certificate	Click “download” to get the Client Certificate. File Name: icpdasuasclient.der.
OPC UA Setting > Server Certificate – Upload the file to the device	
Server Trusted Certificate	Click “Upload” to select the OPC UA Server Trusted Certificate file on your PC.
OPC UA Setting > Client Certificate – Remote the file	
All Certificates and Private Keys	Click "Remove" to delete Client Certificates, Server trusted Certificates and. the certificate and private key in the OPC UA setting.



## 4.4 Main Menu – MQTT Setting

This main menu aggregates all MQTT-related settings. This chapter focuses on parameter descriptions. For the detailed steps and notices for using MQTT connection/certificate, please refer to [3.2 Settings for Using MQTT Connection](#) of [Chapter 3 Main Function Settings](#).


### 4.4.1 Connection Setting

**Function:** Provide the remote MQTT Broker settings for using the MQTT connection.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【MQTT Setting】 → 【Connection Setting】  →  ([Appendix A](#)).

**Sample:** For a simple setting example, please refer to [Section 3.2](#).

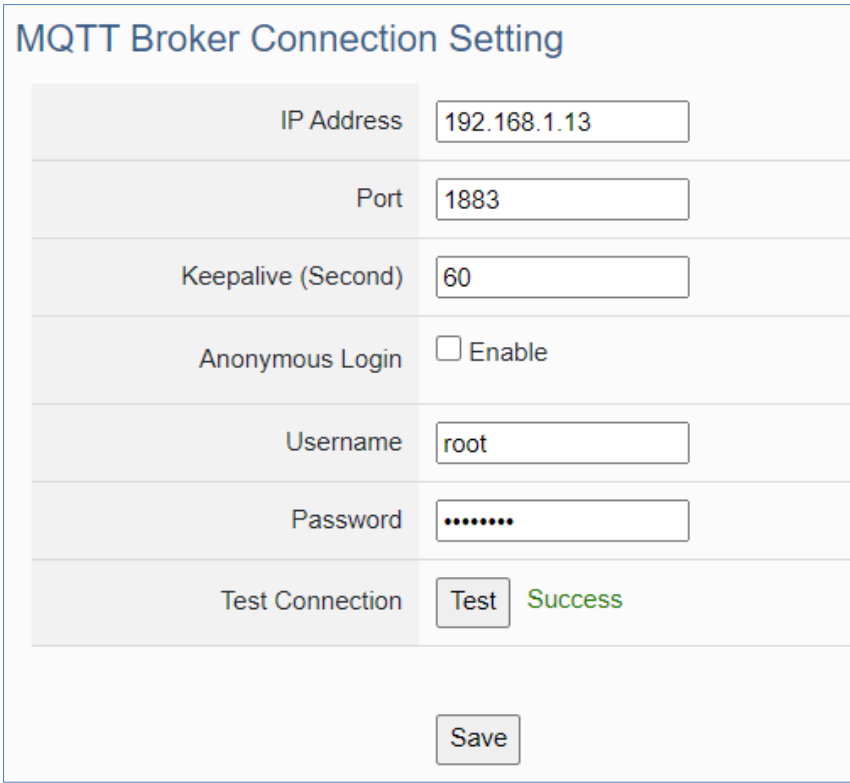

MQTT Broker Connection Setting	
IP Address	192.168.1.13
Port	1883
Keepalive (Second)	60
Anonymous Login	<input type="checkbox"/> Enable
Username	root
Password	.....
Test Connection	<input type="button" value="Test"/> Success
<input type="button" value="Save"/>	

MQTT Setting > Connection Setting	
IP Address	The IP address of the remote MQTT Broker
Port	The communication port number of the remote MQTT Broker.
Keepalive (Second)	Keep alive detection time. Default: 60
Anonymous Login	When checking the item box, it can connect without a username and password. If not checked, it needs to set a username and password.
Username	The username to login the remote MQTT Broker
Password	The password to login the remote MQTT Broker
Test Connection	Click the Test button to test whether the connection to the MQTT Broker is successful.
Save	Click to save the setting of this page.

## 4.4.2 Client Setting

**Function:** Provide the MQTT Client settings for using MQTT connection.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【MQTT Setting】 → 【Client Setting】 MQTT Setting → Client Setting ([Appendix A](#)).

**Sample:** For a simple setting example, please refer to [Section 3.2](#) .

### Content Setting

Scan Rate(ms)	<input style="width: 80%;" type="text" value="1000"/>
Dead Band	<input style="width: 80%;" type="text" value="0"/>
Will Topic	<input style="width: 80%;" type="text"/>
Will	<input style="width: 80%;" type="text"/>
JSON Format	<input checked="" type="checkbox"/> Enable

MQTT Setting > Client Setting – Content Setting	
Update Rate(ms)	Set an update frequency for the task data. Default: 1000 (Unit: ms)
Dead Band	Give a dead bend value for updating a float signal. Default: 0 Dead Band description please refer to <a href="#">Appendix C</a> .
Will Topic	Topic with abnormal disconnection. Default: Null. When the Broker detects that the client is disconnected abnormally, it will publish the Will message to Specified Will Topic. (Topic cannot contain “#”, “+”, and “\$”)
Will	Enter a disconnect notice. Default: Null.
JSON Format	Switch the format for sending MQTT messages. If "Enable" is checked, the message will send in groups. For the message format, please refer to <a href="#">Appendix B</a> . If "Enable" is not checked, the message will send in singly.

If the JSON format is checked as "Enable", the message is sent as a group. For its setting items and parameter descriptions, please see the next page.

If the JSON format is not checked, the message is sent in singly. For its setting items and parameter descriptions, please see the page after the next page.

- JSON Format: **Enable** (message is sent as a group):

### Publish & Subscribe

Publish Topic	<input type="text" value="/Name/Publish"/>
Publish QoS	<input type="text" value="2"/>
Subscribe Topic	<input type="text" value="/Name/Subscribe"/>
Subscribe QoS	<input type="text" value="2"/>
Retain	<input type="text" value="False"/>

Save

MQTT Setting > Client Setting - Publish & Subscribe (JSON Format: <input checked="" type="checkbox"/> Enable)	
Publish Topic	The topic of sending data/publishing messages.
Publish QoS	The publish Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Subscribe Topic	The topic of receiving data / subscribing messages. It can copy the Publish Topic of the linked device.
Subscribe QoS	The subscribe Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Retain	Set up if the Broker retains the message.
Save	Click to save the setting of this page.

- JSON Format: **Not Enable** (message is sent in singly):

JSON Format ☐ Enable

### Publish & Subscribe

Details ☐ Unfold

Nickname	Publish Topic	Subscribe Topic
<input type="text" value="DI0"/>	<input type="text" value="/U-7526M/DI0/Publish"/>	<input type="text"/>
<input type="text" value="DI1"/>	<input type="text" value="/U-7526M/DI1/Publish"/>	<input type="text"/>
<input type="text" value="DI0_Counter"/>	<input type="text" value="/U-7526M/DI0_Counter/Publish"/>	<input type="text"/>
<input type="text" value="DI1_Counter"/>	<input type="text" value="/U-7526M/DI1_Counter/Publish"/>	<input type="text"/>
<input type="text" value="DI0_Preset"/>	<input type="text" value="/U-7526M/DI0_Preset/Publish"/>	<input type="text" value="/U-7526M/DI0_Preset/Subscribe"/>
<input type="text" value="DI1_Preset"/>	<input type="text" value="/U-7526M/DI1_Preset/Publish"/>	<input type="text" value="/U-7526M/DI1_Preset/Subscribe"/>
<input type="text" value="DI0_CounterClear"/>	<input type="text" value="/U-7526M/DI0_CounterClear/Pub"/>	<input type="text" value="/U-7526M/DI0_CounterClear/Sub"/>
<input type="text" value="DI1_CounterClear"/>	<input type="text" value="/U-7526M/DI1_CounterClear/Pub"/>	<input type="text" value="/U-7526M/DI1_CounterClear/Sub"/>
<input type="text" value="DO0"/>	<input type="text" value="/U-7526M/DO0/Publish"/>	<input type="text" value="/U-7526M/DO0/Subscribe"/>

MQTT Setting > Client Setting - Publish & Subscribe (JSON Format: <input checked="" type="checkbox"/> Enable)	
Details	Check "Unfold" to display all fields.
Nickname	The Nickname name in the function of [Module Setting] → [I/O Setting]
Publish Topic	The topic of sending data / publishing message.
Publish QoS	The publish Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Subscribe Topic	The topic of receiving data / subscribing message. It can copy the Publish Topic of linked device.
Subscribe QoS	The subscribe Qos (Quality of Service) levels. Default: 2 0: Delivering a message at most once. 1: Delivering a message at least once. 2: Delivering a message at exactly once.
Save	Click to save the setting of this page.

### 4.4.3 Certificate

**Function:** When selecting MQTT certificate connection, the UA I/O needs to exchange the certificate with the connecting device. This page is about setting the MQTT Certificate for the security and encryption.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【MQTT Setting】 → 【Client Setting】 MQTT Setting → Client Setting ([Appendix A](#)).

1. “SSL/TLS” is not "enable" by default. When not enabled, other setting items will be hidden.

MQTT Setting > Certificate – Content Setting	
SSL/TLS	Check the box and click “Save” to enable the settings for SSL/TLS secure communication. Default: uncheck. The setting items will not appear until clicking the "Save" button.

2. Authentication setting item will show up after enable “SSL/TLS”. Select one way or two way authentication.

**One-way authentication:** The **Client verifies** the validity of **Broker** credentials.

**Two-way authentication:** The **Client and Broker verify** the validity of the certificate with **each other**.

This setting page is setting for the MQTT secure encrypted communication (SSL/TLS: Secure Socket Layer / Transport Layer Security). Before setting this function, you need to download or upload the relevant certificates. There are three types of certificates: Trusted Certificate, Certificate, and Private Key. Please upload the files to the UA I/O module according to the type of certificates.

**To perform the One-way authentication, you need to upload the Trusted Certificate.**

**To perform the Two-way authentication, you need to upload the Trusted Certificate first, and then upload the Certificate and Private Key.**

Parameter Function Descriptions:

### One-way Authentication Screen

Upload the file to the device

Authentication	One-way Authentication ▼
Trusted Certificate	<input type="button" value="Upload"/>

Remove the file

Trusted Certificate	<input type="button" value="Remove"/>
---------------------	---------------------------------------

### Two-way Authentication Screen

Upload the file to the device

Authentication	Two-way Authentication ▼
Trusted Certificate	<input type="button" value="Upload"/>
Certificate	<input type="button" value="Upload"/>
Private Key	<input type="button" value="Upload"/>

Remove the file

Trusted Certificate	<input type="button" value="Remove"/>
Certificate	<input type="button" value="Remove"/>
Private Key	<input type="button" value="Remove"/>

MQTT Setting > Certificate – Upload the file to the device	
Authentication	<p><b>One-way authentication:</b> The Client verifies the validity of Broker credentials; need to upload the Trusted Certificate.</p> <p><b>Two-way authentication:</b> The Client and Broker verify the validity of the certificate with each other; need to upload the Trusted Certificate first, and then upload the Certificate and Private Key.</p>
Trusted Certificate	<p><b>Upload:</b> Click to select the MQTT Trusted Certificate file of the device, and upload the MQTT Trusted Certificate file to the UA I/O module.</p> <ul style="list-style-type: none"> <li>File format must be PEM. Extension name must be “pem”, “cer”, or “crt”.</li> </ul>
Certificate	<p><b>Upload:</b> Click to select the MQTT Certificate file of the device, and upload the MQTT Certificate file to the UA I/O module.</p> <ul style="list-style-type: none"> <li>File format must be PEM. Extension name must be “pem”, “cer”, or “crt”.</li> </ul>
Private Key	<p><b>Upload:</b> Click to select the MQTT Private Key of the device, and upload the MQTT Private Key file to the UA I/O module.</p> <ul style="list-style-type: none"> <li>File format must be PEM. Extension name must be “key”.</li> </ul>
MQTT Setting > Certificate – Remove the file	
Trusted Certificate	Click “Remove” to delete all Trusted Certificate files in the UA I/O module.
Certificate	Click “Remove” to delete all Certificate files in the UA I/O module.
Private Key	Click “Remove” to delete all Private Key files in the UA I/O module.

## 4.5 Main Menu – Advanced Setting

This main menu aggregates the advanced settings, such as the Scaling setting that function can convert the analog signal to a more readable value. The scaling function is only available for AI/AO channels. ICP DAS will develop more advanced functions in the future.

### 4.5.1 Event Log

#### 4.5.1.1 Main Setting

**Function:** When the I/O value changes, record the current I/O value for easy device tracking in the future.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【Event Log】 → 【Main Setting】



Digital Input / Output			
Nickname	OFF to ON (Log Message)	ON to OFF (Log Message)	Enable
<input type="text" value="DI0"/>	<input type="text" value="ON"/>	<input type="text" value="OFF"/>	<input type="checkbox"/>
<input type="text" value="DI1"/>	<input type="text" value="ON"/>	<input type="text" value="OFF"/>	<input type="checkbox"/>
<input type="text" value="DO0"/>	<input type="text" value="ON"/>	<input type="text" value="OFF"/>	<input type="checkbox"/>
<input type="text" value="DO1"/>	<input type="text" value="ON"/>	<input type="text" value="OFF"/>	<input type="checkbox"/>

Advanced Setting > Event Log> Main Setting > Interface Setting > Digital Input / Output	
Nickname	The nickname in the function of [Module Setting] → I/O Setting]
Off to On (log message)	When I/O is ON, the log file will store this log message. Easy for customers to read.
On to Off (log message)	When I/O is OFF, the log file will store this log message. Easy for customers to read.
Enable	Check this item to enable the event log function for this I/O. Default: not enabled

## Analog Input / Output

Nickname	Boundary Value	Log Message	Enable
二樓_A房_電熱水器	Upper Limit Value 1 Lower Limit Value 0 Deadband Value 1	Upper Limit Log Message Over Message Lower Limit Log Message Below Message Normal Range Log Messages Normal Range Message	<input type="checkbox"/>
2階_B室_電氣溫水器	Upper Limit Value 1 Lower Limit Value 0 Deadband Value 1	Upper Limit Log Message Over Message Lower Limit Log Message Below Message Normal Range Log Messages Normal Range Message	<input type="checkbox"/>

Advanced Setting > Event Log > Main Setting > Interface Setting > Analog Input / Output	
Nickname	The Nickname name in the function of [Module Setting] → [I/O Setting]
Boundary value	Upper limit: Above the upper limit, it is considered abnormal. Preset: 1
	Lower limit: Below the lower limit, it is considered abnormal. Preset: 0
	Deadband: Dead zone, inactive zone. Set the Deadband value for the floating point data update. Default: 1 (Refer to <a href="#">Appendix C</a> )
Log message	Upper log message: Above the upper limit, this log message is recorded.
	Lower log message: Below the upper limit, this log message is recorded.
	Normal range log message: This log message is recorded between the upper limit value and the lower limit value (only recorded once).
Enable	Check this item to enable the event log function for this I/O. Default: not enabled



Setting		Log File Download
<input type="button" value="Delete"/>	File Name	Download
<input type="checkbox"/>	log_2023-2-14.csv	<input type="button" value="Download"/>
<input type="checkbox"/>	log_2023-2-15.csv	<input type="button" value="Download"/>


Advanced Setting > Event Log > Main Setting – Log File Download	
File Name	The file name is composed of year, month, day, hour, minute, and second. This time is the time of the first content.
Download	Click this button to download the log file.

#### 4.5.1.2 Send Messages To Line

**Function:** When the I/O value changes, the I/O value is sent to Line as an alarm notification.

**Module Support:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【Event Log】 → 【Send Messages TO Line】



Before using, please make sure that [the main setting](#) is checked and enabled

##### ● Test Token

### Test Token

Click the link to get the token

<https://notify-bot.line.me/my/>

Test Token

Enter the token

qBtSC5ti

Finish

Advanced Setting > Event Log > Send messages To Line – Test Token	
Click the link to get the token	<ol style="list-style-type: none"> <li>1. Click the link and enter your Line account and password.</li> <li>2. Follow the steps to get Line's token.</li> </ol>
Test Token	Enter the token in the column and click the Test token button. When the transmission is successful, " Finish " will be displayed.

##### ● Line Setting

### Line Setting

Send Messages To Line

☒ Enable

Delete	No.	Token
<input type="checkbox"/>	Add	
<input type="checkbox"/>	1	qBtSC5ti

Save

Advanced Setting > Event Log > Send messages To Line – Line Setting	
Send Messages To Line	Enable this item to allow the module to send messages to Line.
Delete	Check this item and click the Delete button to delete the item.
No.	The number is automatically given by the system for identification.
Token	The token obtained by Line is used to connect the module to Line.

#### How to use Line setting:

1. Enter the token obtained from Line by yourself.
2. Click the "Add" button.
3. Click the "Save" button.

### Line Setting

Send Messages To Line
☒ Enable

Delete	No.	Token
<input type="checkbox"/>	<input type="button" value="Add"/>	qBtSC5tiXu <input type="text"/>
<input type="checkbox"/>	1	qBtSC5tiX <input type="text"/>

Success

## 4.5.2 Rule Setting

### 4.5.2.1 Main Setting

**Function:** The Rule Setting function provides simple logic condition rule setting, let UA I/O do automatic condition judgment and action control, to achieve simple AI.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【Rule Setting】 → 【Main Setting】



**Sample:** For a simple setting example, please refer to [Section 3.5](#).

**Content Setting:**

### Content Setting

Sampling Interval Time  
(milliseconds)

Advanced Setting > Rule Setting – Content Setting	
Sampling Interval Time (milliseconds)	Enter the interval time (milliseconds) to obtain the current value of UA I/O.

**Rule Setting:**

### Rule Setting

Details

Advanced Setting > Rule Setting – Rule Setting	
Details	Unfold: Display more fields and expand the web page width. Improve the readability of scripts and facilitate editing. Fold: Only the necessary fields are displayed.

**Fold View:**

Rule Name
IF
THEN
ELSE

☐


Add a new Condition

Add a new Action

Add a new Action

AND ▼

## Unfold View:

Delete	Rule Name	IF	THEN	ELSE	Resident Execution	Remark
<input type="checkbox"/>	<input type="text"/>	<input type="button" value="Add a new Condition"/> <input type="text" value="AND"/>	<input type="button" value="Add a new Action"/>	<input type="button" value="Add a new Action"/>	<input type="checkbox"/>	
<input type="button" value="Save"/>						



Advanced Setting > Rule Setting > Rule Setting > Unfold /Fold	
Delete	Check this item and press the delete button to delete this rule.
Rule Name	The rule name auto-given by the system is used for <b>schedule</b> identification. (For the schedule function, refer to 【Advanced Setting】 > 【Schedule】 )
IF	Set the IF Condition statement of the logic rule. The values or status for evaluation criteria: DI, DO, AI, AO, Virtual Point. Conditions Type: AND, OR.
THEN	When the IF Condition is “ <b>Yes</b> ”, execute the <b>THEN Action</b> statement setting. Action statement: DO, AO, Virtual Point, Delay.
ELSE	When the IF Condition is “ <b>No</b> ”, execute the <b>ELSE Action</b> statement setting. Action statement: DO, AO, Virtual Point, Delay.
Resident Execution	Check: the rule will be executed 24 hours a day. Default: enabled. Uncheck: the “ <b>Schedule</b> ” has been set. (For <b>Schedule</b> function, refer to 【Advanced Setting】 > 【Schedule】 )
Remark	Set a more detailed description for the rule to improve recognition. Items: No. Rule Name, Depiction.
Save	Click the “Save” button to save the rule settings.


**\*\*Note:** For the logic condition setting steps of rule setting, please refer to [Section 3.5](#).

#### 4.5.2.2. I/O Control

**Function:** Provide UA-I/O series modules to package the I/O points into highly Identifying names. **Must be used with rule setting.**

**Support Module:** This function is only supported by U-7504M, U-7526M, U-7555M, U-7560M, U-7519ZM, and U-7517M-10.


**Manu Path:** 【Advanced Setting】 → 【I/O Control】  →  (Appendix A).

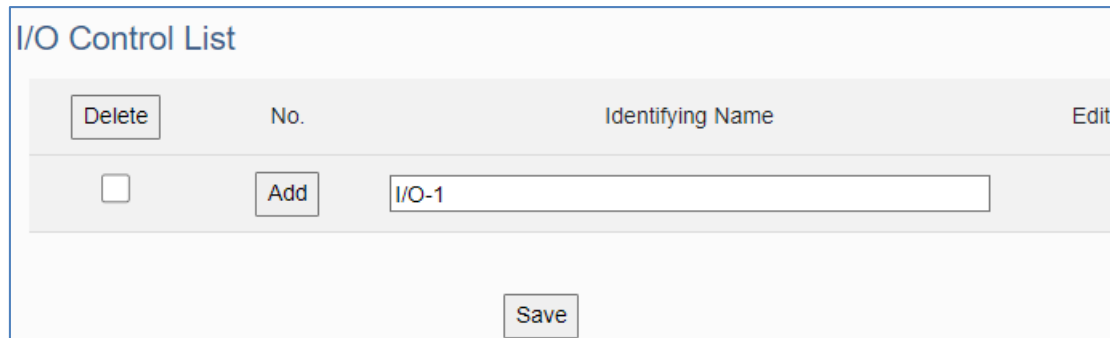

Advanced Setting > Rule Setting > I/O Control	
Delete	Check the box and press the Delete button to delete the item.
No.	The number automatically given by the system for easy identification.
Identifying Name	Can input Multi-language text. For convenient <b>Rule Setting</b> and recognition. (For the function of Rule Setting, please refer to [Advanced Settings] > [Rule Setting])
Edit	Enter the Edit Setting screen to provide more detailed settings.

#### Setting method:

1. Fill in the name in the identifying name, for example: I/O-1.
2. Click the "Add" button.
3. Click the "Edit" button of the item to enter the setting page, and set the I/O action of the device.

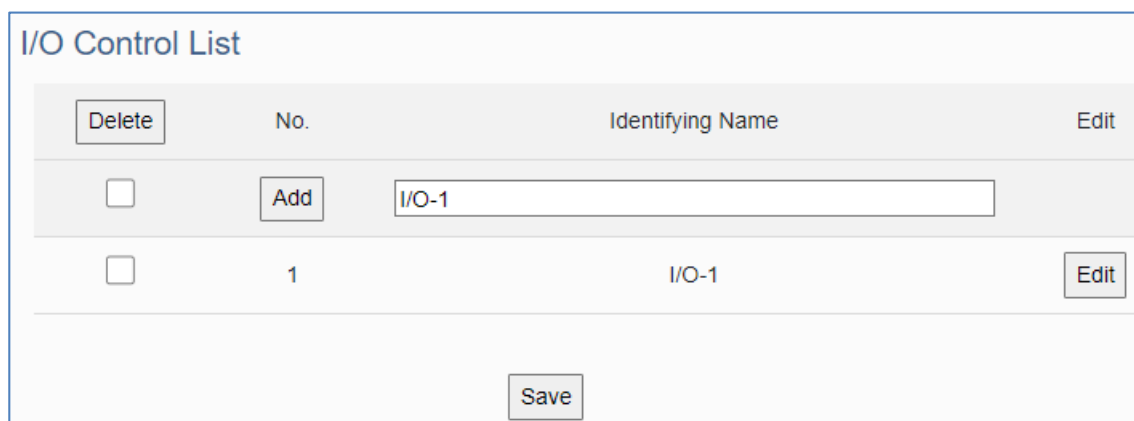

Setting

Delete	Item	DO / AO	Value	Depiction
			ON=1 OFF=0	
<input type="checkbox"/>	Add	DO0 ▾	= 0	
<div>OK Cancel</div>				



Advanced Setting > Rule Setting > I/O Control > I/O Control(Edit) > Setting	
Delete	Check the box and press the Delete button to delete the item.
Item	The number automatically given by the system for easy identification.
DO / AO	According to the module model, select the corresponding I/O.
Value	Set the I/O value. Default: 0.
Depiction	Used to set a more detailed description of the item to improve recognition.

After setting, remember to click OK to return to the I/O control list, and click Save.

### 4.5.2.3 Schedule

**Function:** The Schedule function can achieve the timing control for the rule list in Rule Setting.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【Schedule】  →  (Appendix A).

**Sample:** For a simple setting example, please refer to [Section 3.5](#) .

**Note:** This webpage will display the rule items (number and name) that have been set in 【Rule Setting】 ; if no rules are set in 【Rule Setting】 , there will not be any list on this page.

Rule Setting List

No.	Rule Name	Edit
1	RuleName	<input type="button" value="Edit"/>

Advanced Setting > Rule Setting > Schedule > Rule Setting List	
No.	The number automatically given by the system corresponds to the number of the 【Rule Setting】 function, users can find it in the menu: 【Advanced Setting】 → 【Rule Setting】 .
Rule Name	The names are the corresponding to the Rule Name of the 【Rule Setting】 function, users can find it in the menu: 【Advanced Setting】 → 【Rule Setting】 → 【Rule Name】 .
Edit	Click “Edit” to enter the editing screen to edit more detailed settings.

Content Setting

No.	1
Rule Name	<input type="text" value="RuleName"/>

Advanced Setting > Rule Setting > Schedule > Rule Setting List (Edit) > Content Setting	
No	The number automatically given by the system. It is the same as the number in the menu: 【Advanced Setting】 → 【Rule Setting】
Rule Name	This name can be modified to a more recognizable name here. It is the same as the rule name in the menu: 【Advanced Setting】 → 【Rule Setting】 → 【Rule Name】 .



Cycle

Week	Start Time			End Time			Display
Sunday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable
Monday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable
Tuesday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable
Wednesday	<input type="text" value="11"/>	<input type="text" value="45"/>	<input type="text" value="0"/>	<input type="text" value="12"/>	<input type="text" value="30"/>	<input type="text" value="0"/>	11:45:0~12:30:0 Enable
Thursday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable
Friday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable
Saturday	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	<input type="text" value="hr"/>	<input type="text" value="min"/>	<input type="text" value="sec"/>	Disable

Specified Range

Delete	No.	Start Time			End Time		
<input type="checkbox"/>	<input type="button" value="Add"/>	<input type="text" value="Year"/>	<input type="text" value="Month"/>	<input type="text" value="Day"/>	<input type="text" value="Year"/>	<input type="text" value="Month"/>	<input type="text" value="Day"/>
		<input type="text" value="Hour"/>	<input type="text" value="Minute"/>	<input type="text" value="Second"/>	<input type="text" value="Hour"/>	<input type="text" value="Minute"/>	<input type="text" value="Second"/>

Exclude

Delete	No.	Exclude Date		
<input type="checkbox"/>	<input type="button" value="Add"/>	<input type="text" value="Year"/>	<input type="text" value="Month"/>	<input type="text" value="Day"/>

Advanced Setting > Rule Setting > Schedule > Rule Setting List (Edit) >	
Cycle	The rule is enabled and executed every week. Set the start/end time in any day, it will be automatically enabled.
Specified Range	The rule is enabled and executed within a specific time period. Need to set the Start/End time.
Exclude	Specify the exclude date for not execute the rule. If the above two time settings overlap, set the Exclude Date not to execute the rule. Specify the date to exclude the rule.

### 4.5.3 IoTstar Setting

**Function:** The IoTstar Setting function can connect to ICP DAS IoTstar cloud IoT management software.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【IoTstar Setting】 

([Appendix A](#)).

**Sample:** For a simple setting example, please refer to [Section 3.6](#) .

#### Currently supported features:

1. Through ICP DAS IoTstar management software, remote operating the web settings.
2. Through ICP DAS IoTstar management software, remote operating the web I/O status reading.
3. Through ICP DAS IoTstar management software, remote operating the web firmware update.
4. Through ICP DAS IoTstar management software, display Real-time I/O data.
5. Through ICP DAS IoTstar management software, display Historical I/O data.
6. Through ICP DAS IoTstar management software, the meter version can control DO, AO value remotely.
7. I/O data of U-7500M → Access to the database via ICP DAS IoTstar management software.

**Note:** When operating the web interface, please keep only one user in the web interface.

## Connection Setting

Server IP	<input type="text" value="iotstardemo.icpdas.com"/>
Server Port	<input type="text" value="1234"/>
Username	<input type="text" value="iotstar_rd9"/>
Password	<input type="password" value="....."/>
Nickname	<input type="text" value="U-7500M"/>
FTP Port	<input type="text" value="1231"/>
History Data Intervals (Seconds)	<input type="text" value="60"/>
KEY (8 characters)	<input type="password" value="....."/>
IV (8 characters)	<input type="password" value="....."/>
Real-Time I/O Data	<input type="checkbox"/> Enable
Historical I/O Data	<input type="checkbox"/> Enable



### Advanced Setting > IoTstar Setting > Connection Setting

Server IP	The IP address or domain name of the IoTstar.
Username	Enter the account username registered with the IoTstar.
Password	Enter the password registered with the IoTstar.
Nickname	Default: U-7500M. This item is the title name of the IoTstar Device List.
Historical Data Interval	Default: 60 This item is the interval time for sending I/O historical data to IoTstar.
Real-time I/O information	Allows all UA-I/O data to be sent to IoTstar. Factory default: Not enabled.
Historical I/O information	When enabled, the UA-I/O data is temporarily stored in the module and sent to IoTstar. Factory default: Not enabled.


## 4.5.4 EZ-UAQ Utility

**Function:** Settings related to the EZ-UAQ Utility network management tool.

**Support Module:** All UA I/O modules support this function.

**Manu Path:** 【Advanced Setting】 → 【EZ-UAQ Utility】  → 

([Appendix A](#)).

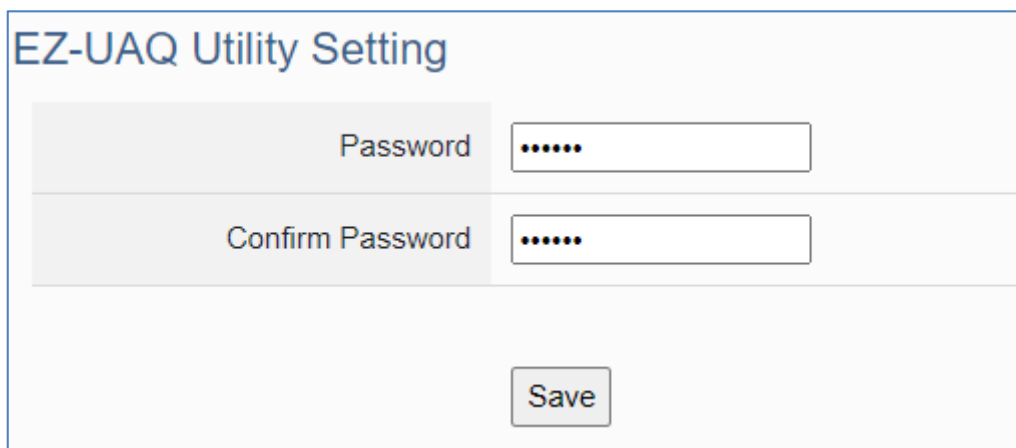

The image shows a web-based configuration interface titled "EZ-UAQ Utility Setting". It contains two input fields: "Password" and "Confirm Password", both masked with dots. Below these fields is a "Save" button.


Advanced Setting > EZ-UAQ Utility	
Password	Set a password to restrict the authorization of the EZ-UAQ Utility. When the EZ-UAQ Utility gets the same password, you can control the module.
Confirm Password	Retype the password for the operation conform when setting the new account information.

## 5. Recovering Firmware Setting (Reset)

This chapter explains how to use the Reset button to recover the firmware settings.

The steps are as follows:

1. Please find the **Reset** button on the UA I/O bottom side, and then press the **Reset** button.

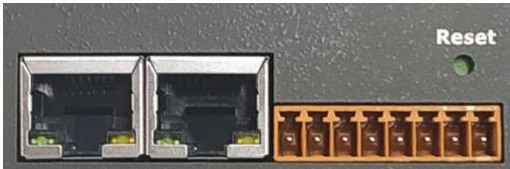

2. When starting the recovering process, all the LEDs on the panel will light up red or green.



3. If all LEDs light on red, it indicates an error. When this happens, please press the Reset button again.



4. If all LEDs light on green, it means the recovering process is successful.





5. After restarting, the module will recover the UA I/O settings as follows:


Recovering Firmware of UA I/O Modules			
Network	IP (LAN)	Keep the original setting	Assign UA I/O a new IP setting according to your case.
	Mask	Keep the original setting	
	Gateway	Keep the original setting	
Web UI Account	Username	root	After login, change the default username/password to use other functions.
	Password	root	

## Appendix A. Menu Path Diagram Description

【Menu Path】 diagram shows the main menu function section path in a brief way that user can follow the menu path order (text/diagram) to select the main menu and the sub-menu, then can go to the function setting web page. Please see the examples below for detail description.


**[Example 1]** Description for the menu path of 【System Setting】 → 【Overview】 :

1. Click 【System Setting】 function of main menu on the upper side, such as .
2. Click 【Overview】 function of sub-menu appeared on the left side, such as .
3. Check or set up the information or function items on the setting area of the 【Overview】.

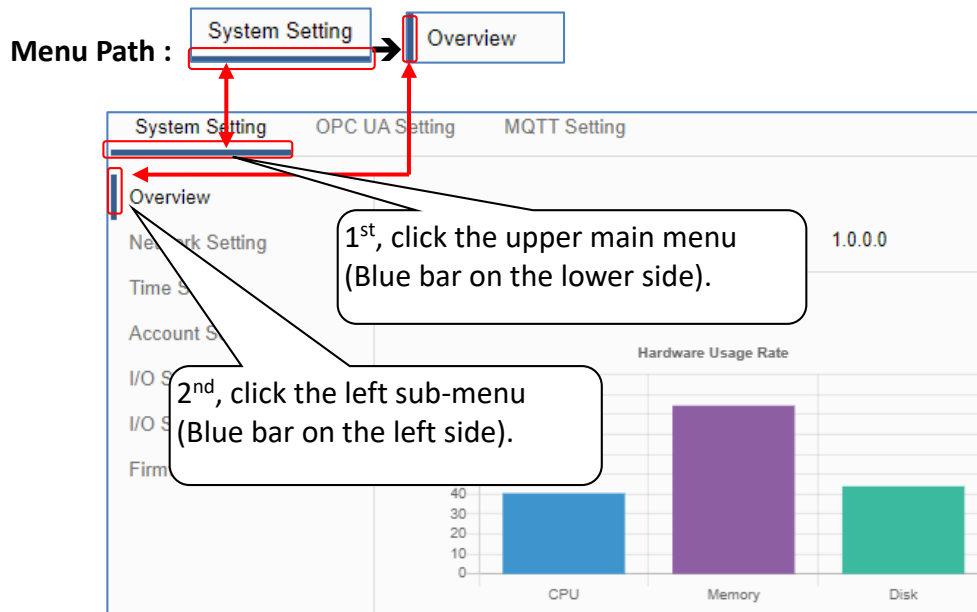

**[Example 2]** Description for the menu path of 【OPC UA Setting】 → 【Certificate】 :

1. Click 【OPC UA Setting】 function of main menu on the upper side, as below.
2. Click 【Certificate】 function of sub-menu appeared on the left side, as below.
3. Set up the function items on the setting area of the 【Certificate】.

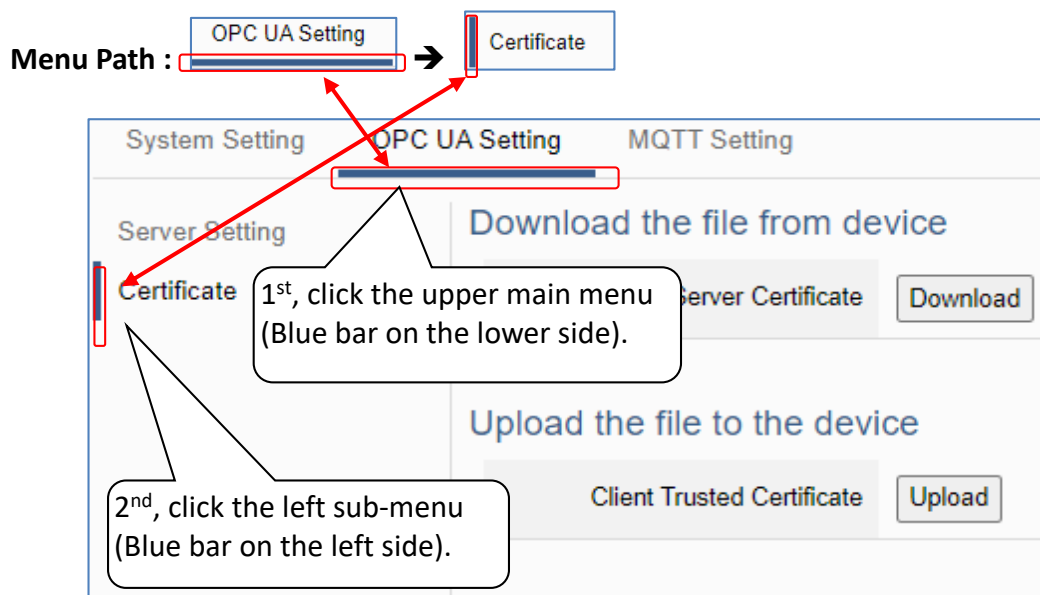

## Appendix B. MQTT JSON Format of the UA I/O Series

### MQTT JSON Example & Format Descriptions for the U-7526M:

```
{
  "DO0": 0,
  "DO1": 0,
  "DI0": 0,
  "DI1": 0,
  "Vout0": 4.999,
  "Vout1": 4,
  "Vin0": 5.003,
  "Vin1": -32.768,
  "Vin2": -32.768,
  "Vin3": 0,
  "Vin4": 0,
  "Vin5": 0,
  "DI0_Counter": 0,
  "DI1_Counter": 0,
  "DI0_Preset": 0,
  "DI1_Preset": 0,
  "DI0_CounterClear": 0,
  "DI1_CounterClear": 1,
  "Scale_Vout0": 34.997,
  "Scale_Vout1": 32,
  "Scale_Vin0": 35.009,
  "Scale_Vin1": -78.304,
  "Scale_Vin2": -78.304,
  "Scale_Vin3": 20,
  "Scale_Vin4": 20,
  "Scale_Vin5": 20
}
```

Name	Description
Left column (such as DO0, DO1...etc.)	the name of the variable. <b>It will change according to the module.</b>
Right column	The current value of the variable.

Method 1 to get the variable name: Login to the web interface

Through 【 Module Setting 】 → 【 I/O status 】

Module Setting

I/O Status

**Channel items** can be obtained.

#### Digital Input

Channel	Nickname	Value	Status
DI0	DI0 tim	<input type="checkbox"/>	GOOD
DI1	DI1 tim	<input type="checkbox"/>	GOOD
DI0_Counter	DI0 tim_Counter	0	GOOD
DI1_Counter	DI1 tim_Counter	0	GOOD

Method 2 to get the variable name: Login to the web interface

Through 【 Module Setting 】 → 【 Overview 】

Module Setting

Overview

For common settings, click the download button. You can get

[CommonSettings.csv](#) .


**I/O Channel items** can be obtained.

MQTT							
I/O Channel	Nickname	JSON Format	Enable	Publish Top	Publish QoS	Subscribe T	Subscribe C
DI0	DI0	TRUE		/Name/Publ	2	/Name/Subs	2
DI0_Counter	DI0_Counter	TRUE		/Name/Publ	2	/Name/Subs	2
DI0_CounterClear	DI0_CounterClear	TRUE		/Name/Publ	2	/Name/Subs	2
DI0_Preset	DI0_Preset	TRUE		/Name/Publ	2	/Name/Subs	2
DI1	DI1	TRUE		/Name/Publ	2	/Name/Subs	2
DI1_Counter	DI1_Counter	TRUE		/Name/Publ	2	/Name/Subs	2
DI1_CounterClear	DI1_CounterClear	TRUE		/Name/Publ	2	/Name/Subs	2
DI1_Preset	DI1_Preset	TRUE		/Name/Publ	2	/Name/Subs	2
DO0	DO0	TRUE		/Name/Publ	2	/Name/Subs	2
DO1	DO1	TRUE		/Name/Publ	2	/Name/Subs	2
Vin0	Vin0	TRUE		/Name/Publ	2	/Name/Subs	2
Vin1	Vin1	TRUE		/Name/Publ	2	/Name/Subs	2



## Appendix C. Dead Band Description

(B) If select **AIO variable**, then Condition is "Value" and can set the "Dead Band". The condition will be triggered and send the message when the detected value exceeds the upper or lower Dead Band. (Below is a CO<sub>2</sub> example. Detect per 500 ms.)

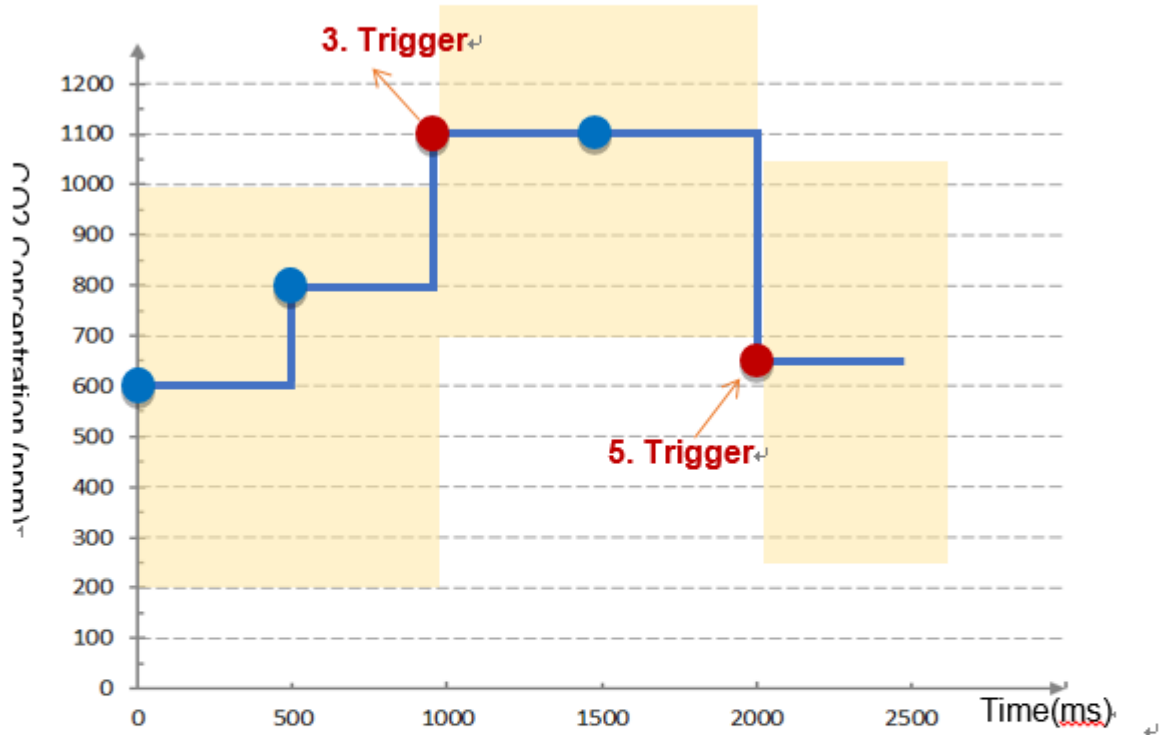

**AIO Trigger:** (Detect per 500 ms. The yellow block means the Dead Band.)

1. Detect initial CO<sub>2</sub> concentration 600 (ppm).  
Set Dead Band=400 (Initial Trigger Condition:  $\geq 1000$  or  $\leq 200$ )
2. Detect CO<sub>2</sub> concentration 800. It is in the range of Dead Band.
3. Detect CO<sub>2</sub> concentration 1100. It exceeds the upper value ( $\geq 1000$ ) of Dead Band, so trigger a message for danger notification.
4. Detect CO<sub>2</sub> concentration 1100. It is in the new range of Dead Band.  
Dead Band=400 (New Trigger Condition:  $\geq 1500$  or  $\leq 700$ )
5. Detect CO<sub>2</sub> concentration 650. It is below the lower value ( $\leq 700$ ) of Dead Band, so trigger a message for safety notification.